



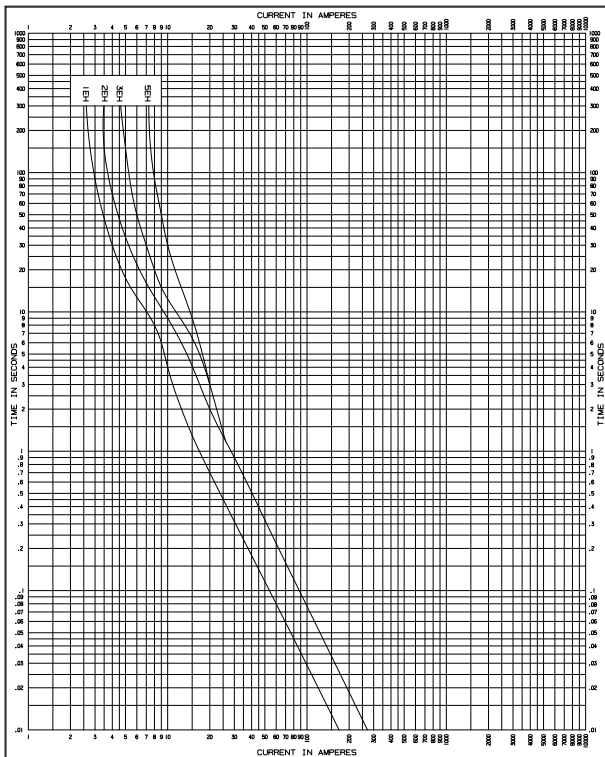

Reference Data
R240-91-7
Page 1 of 2

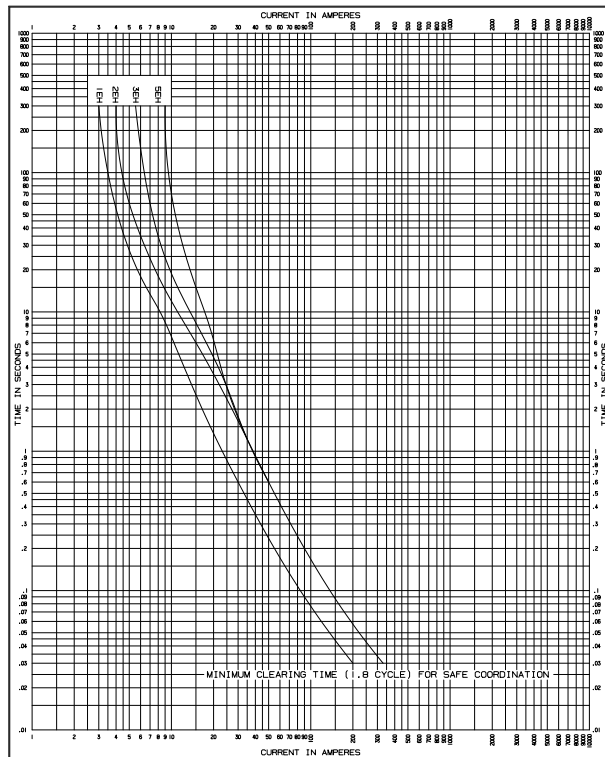

Reference Data
R240-91-7
Page 2 of 2

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CHKD]
DATE 9-21-00 DATE
REPLACES 00/00 REV 00 REG NO. 19892
DWG NO. 42 39640 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
FOR HIGH SURGE TYPE EH

Tests made at 240 Volts ac at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1992)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CHKD]
DATE 9-21-00 DATE
REPLACES 00/00 REV 00 REG NO. 19892
DWG NO. 42 39640 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
FOR HIGH SURGE TYPE EH

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1992)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.