


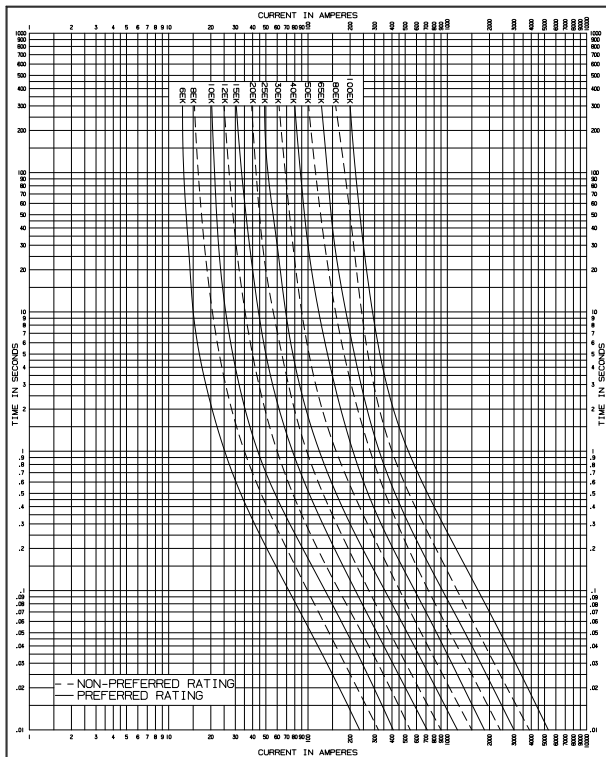

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CHKD] DATE 8-16-00
REPLACES 02/70 [REV 00] REG NO. 19892
DWG NO. 42 39638 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
EET-NEMA TYPE EK-TIN


Tests made at 240 Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-5
Page 1 of 2

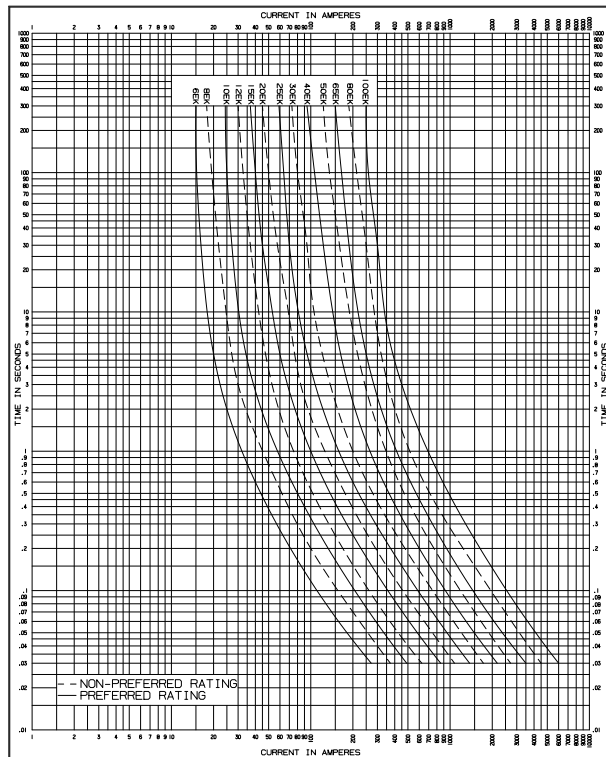

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CHKD] DATE 8-16-00
REPLACES 02/70 [REV 00] REG NO. 19892
DWG NO. 42 39638 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEARING
EET-NEMA TYPE EK-TIN

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-5
Page 2 of 2