



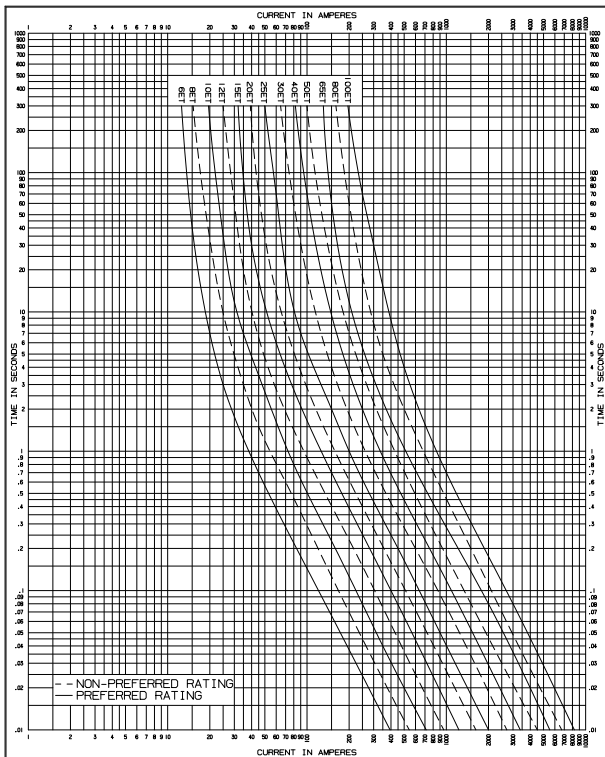

COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT			TIME-CURRENT CHARACTERISTIC CURVES MINIMUM MELT FOR TYPE EEI-NEWA TYPE ET-TIN	
DRAWN BY JFR DATE 9-14-00 REPLACES 00/00 DWG NO. 42 39639 B 00	CHKD DATE REV 00 REG NO. 19892	Tests made at 240 Volts ac at HIGH pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981 (R1982) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

Reference Data
R240-91-6
Page 1 of 2

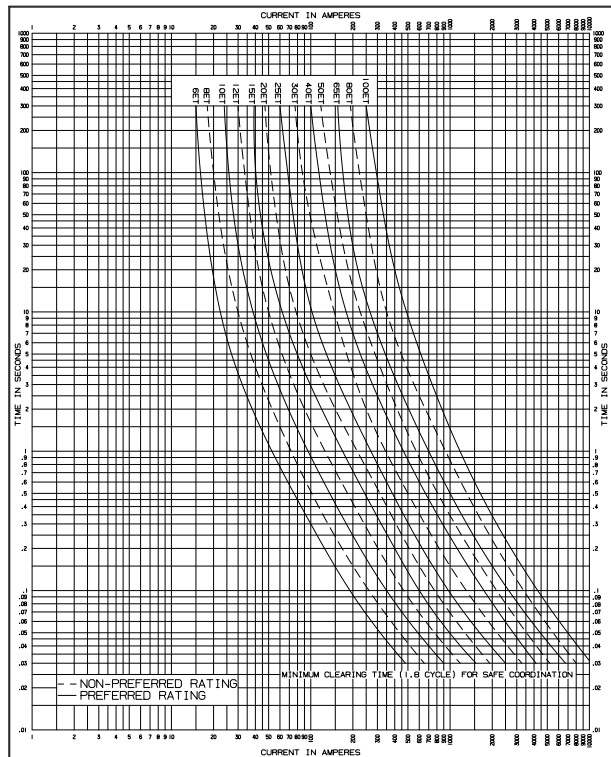

COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT			TIME-CURRENT CHARACTERISTIC CURVES MAXIMUM CLEAR FOR TYPE EEI-NEWA TYPE ET-TIN	
DRAWN BY JFR DATE 9-14-00 REPLACES 00/00 DWG NO. 42 39639 B 00	CHKD DATE REV 00 REG NO. 19892	Tests made at RATED Volts ac at LOW pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981 (R1982) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

Reference Data
R240-91-6
Page 2 of 2