


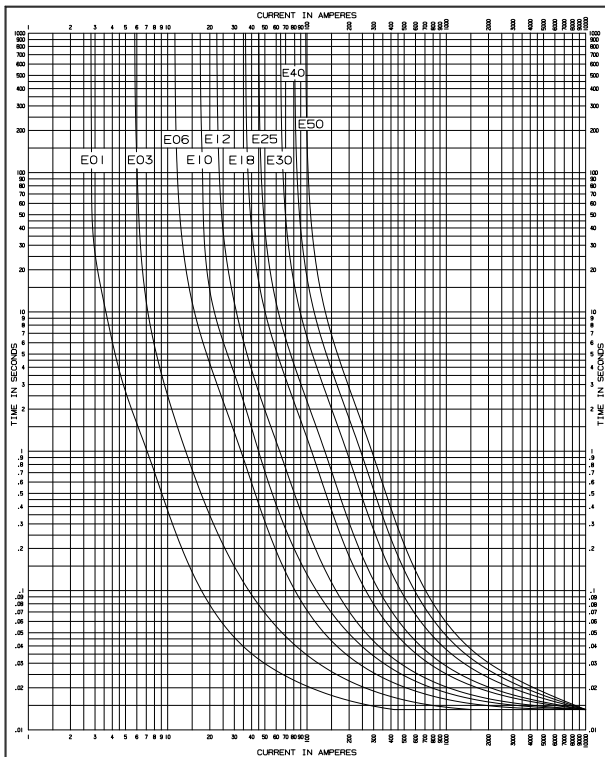

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY: DG [CHKD] JAW
DATE: 05-27-03 DATE: 05-27-03
REPLACES: 04/03 [REV] 02 [REQ] NO. 21742


DWG NO. 42 39753 B 00

TIME-CURRENT CHARACTERISTIC CURVES
MINIMUM TRIP CURVES FOR 3PH MAGNEX

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1982)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-302
Page 1 of 2

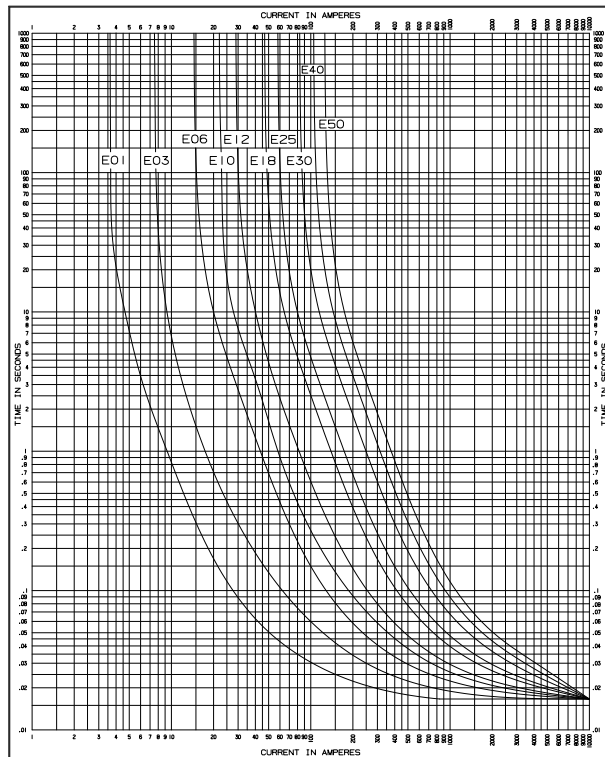

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY: DG [CHKD] JAW
DATE: 05-27-03 DATE: 05-27-03
REPLACES: 04/03 [REV] 02 [REQ] NO. 21742

DWG NO. 42 39753 B 00

TIME-CURRENT CHARACTERISTIC CURVES
MAXIMUM CLEAR CURVES FOR 3PH MAGNEX

Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1982)
MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-302
Page 2 of 2