

COOPER POWER SYSTEMS DIVISION
COMPONENTS & PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES


MINIMUM MELT TIME-CURRENT CHARACTERISTIC CURVES
4.3 & 5.5 kV X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE

DRAWN BY **RJC** CHK'D
DATE **1-10-96** DATE
REPLACES **5 / 89** REV **01** REQ. NO.

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

DWG NO. **TCC303 M**

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

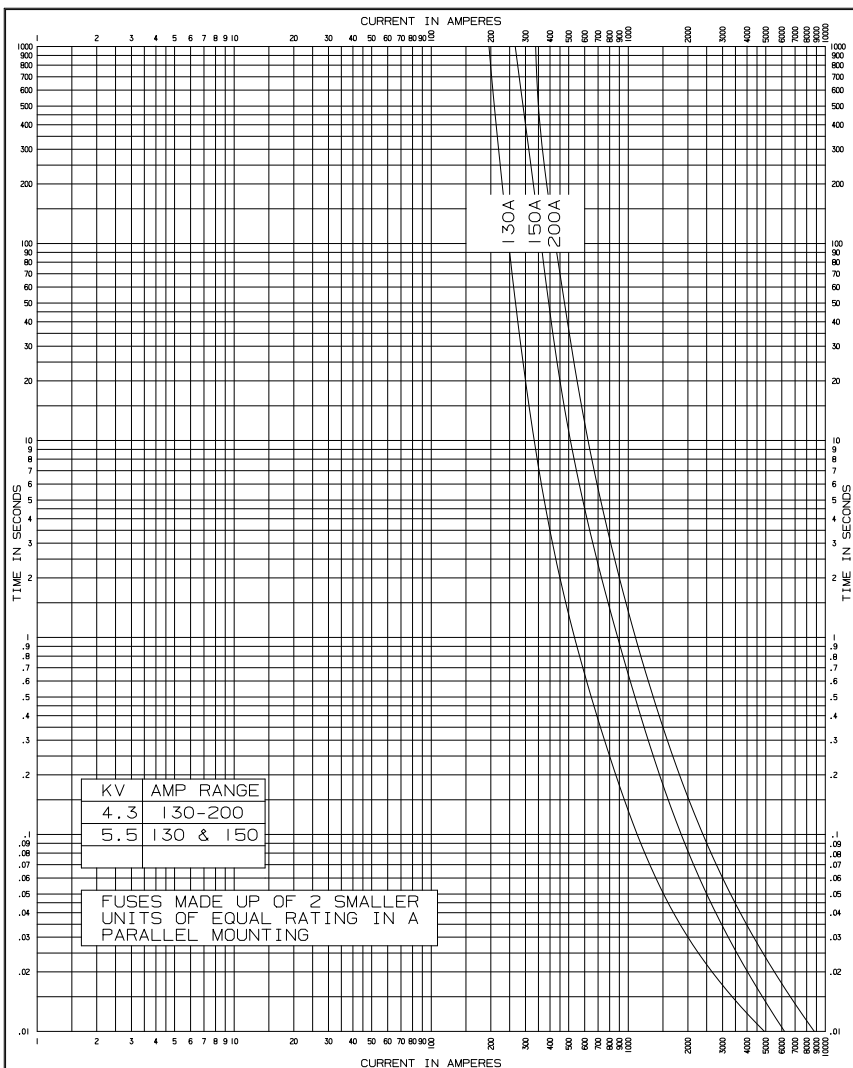

COOPER POWER SYSTEMS DIVISION
COMPONENTS & PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES
4.3 & 5.5 kV X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE

DRAWN BY **RJC** CHK'D

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

DATE **1-10-96** DATE

Standards used as basis for data: ANSI C37.47-1981

REPLACES **5/89** REV **01** REQ. NO.

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

DWG NO. **TCC303 C**

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-106
Page 2