


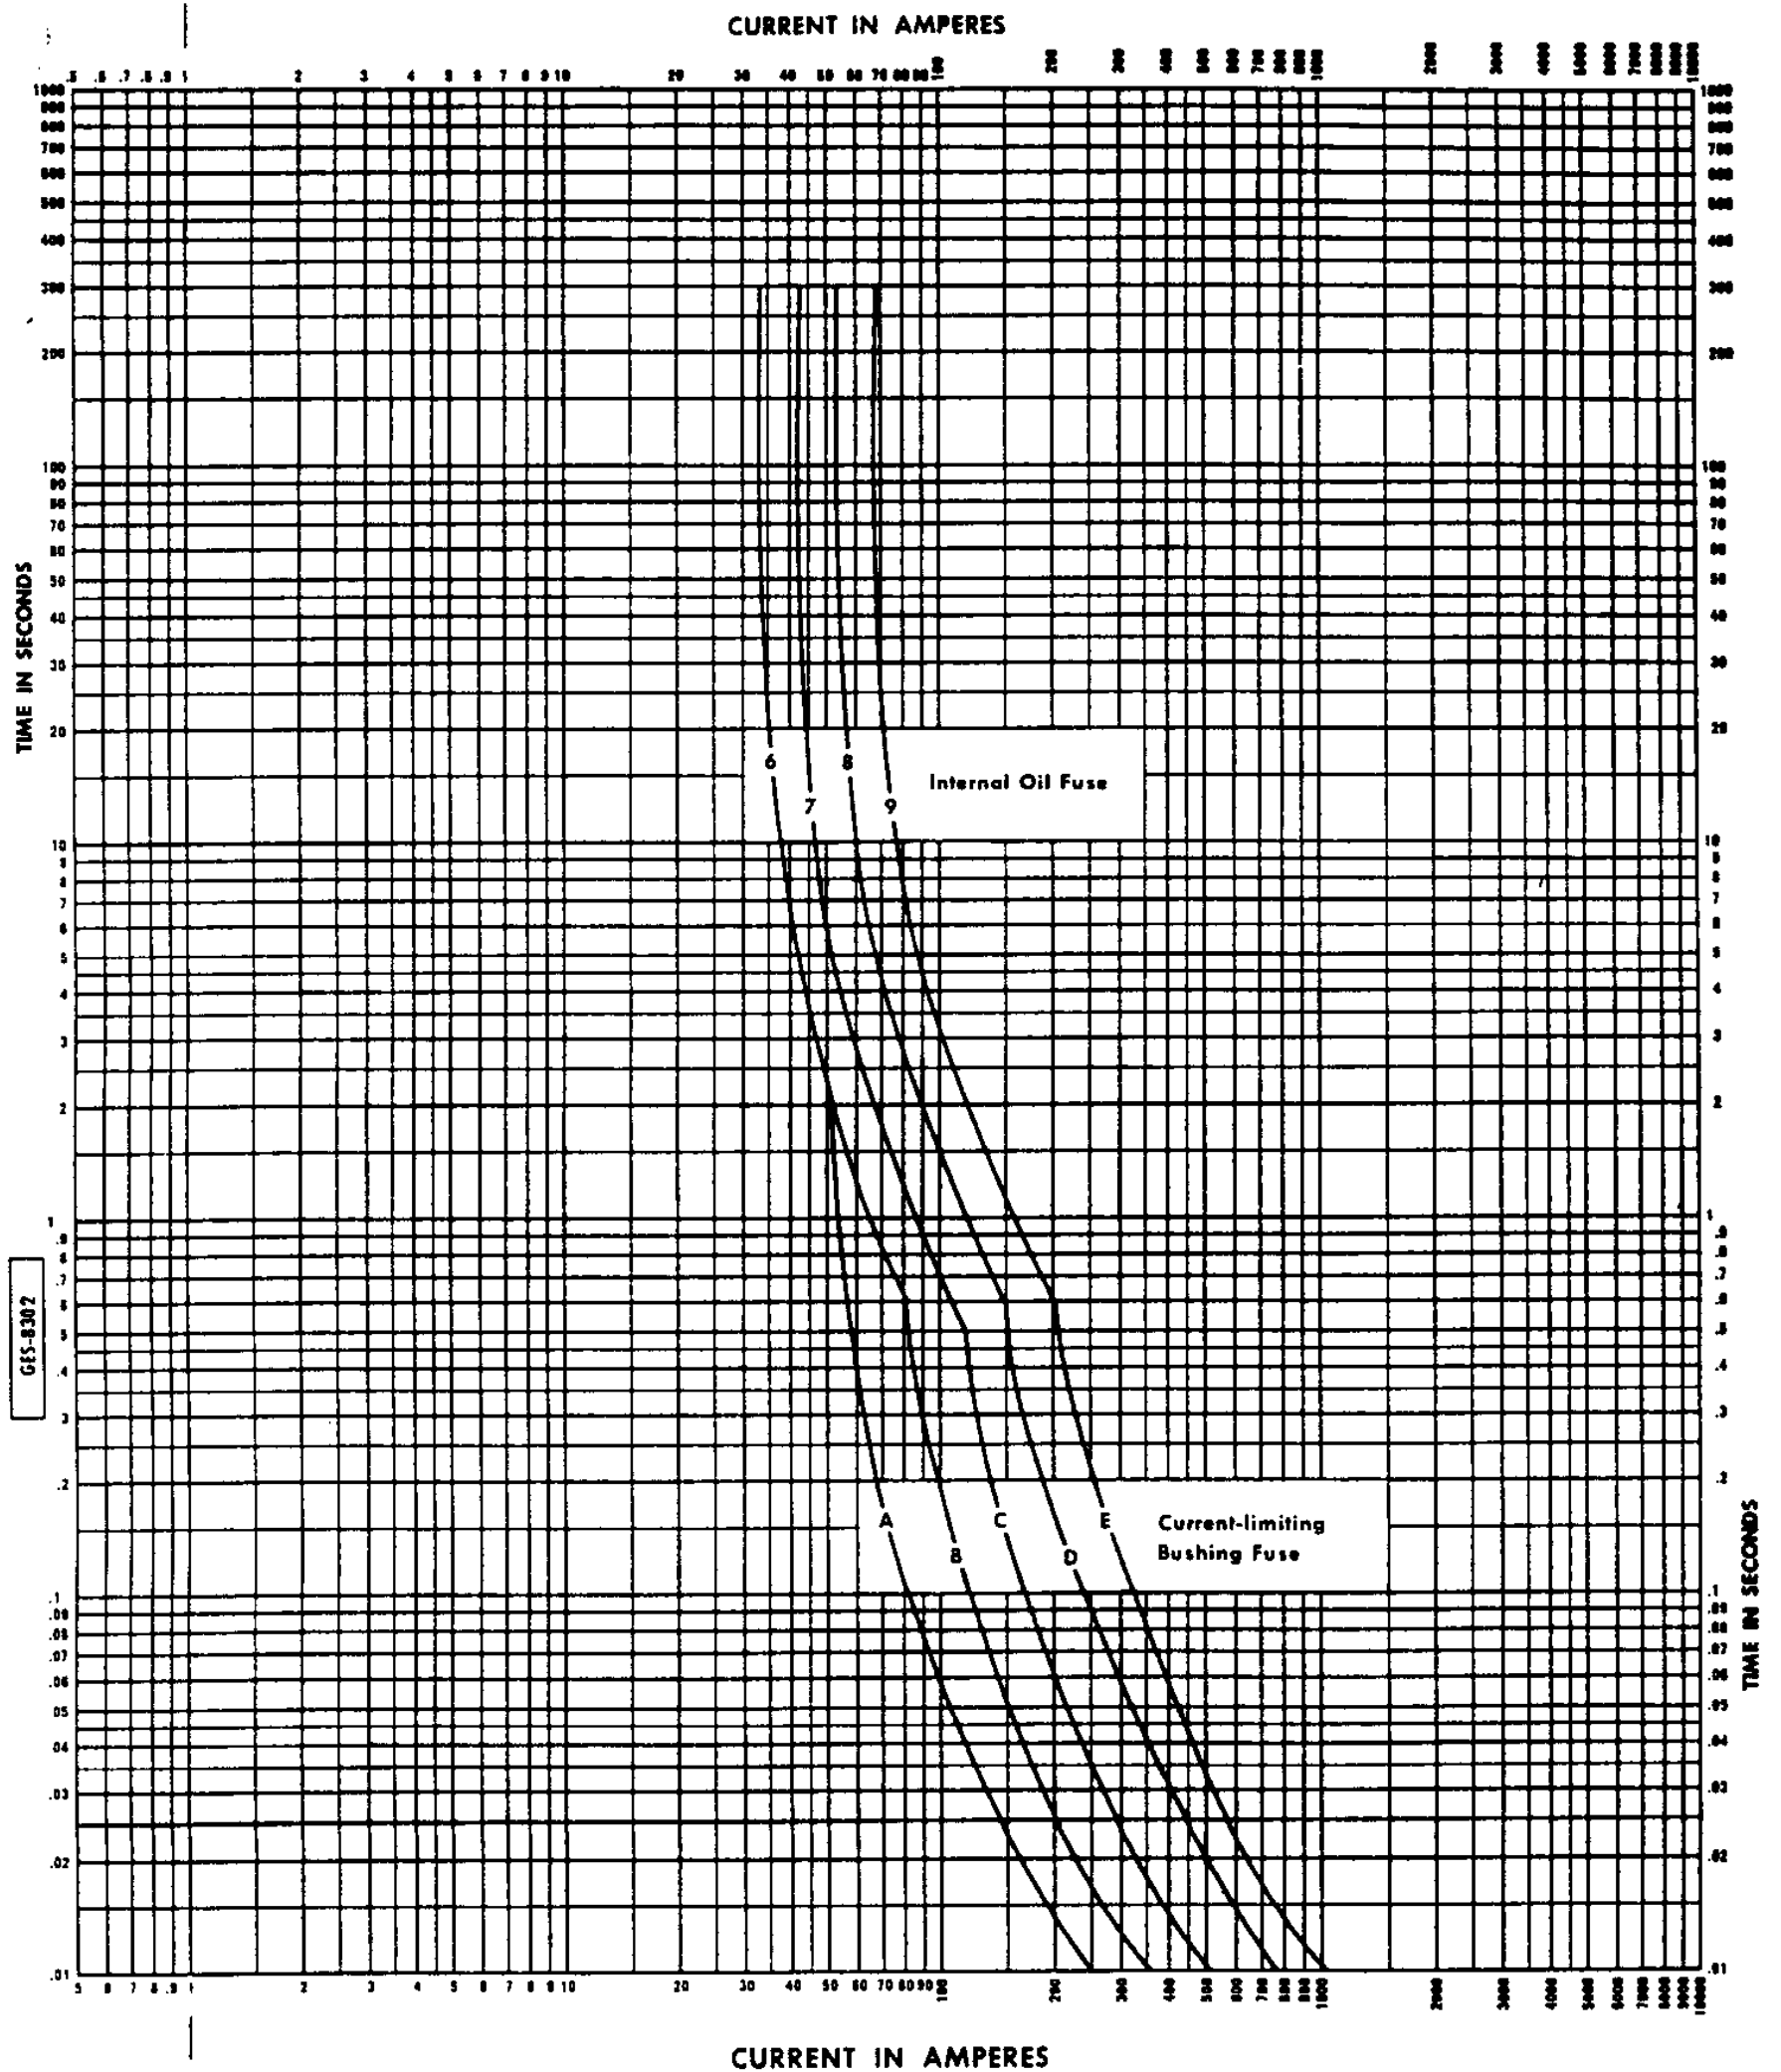

GENERAL ELECTRIC	DISTRIBUTION TRANSFORMER INTERNAL FUSES SERIES COMBINATION OF INTERNAL FUSES AND BUSHING FUSES Internal Oil Fuse Numbers 6 to 9 and Current-limiting Bushing Fuse Letters A to E Combined Maximum Total-clearing Time-current Curves (At 60 cycles and 25 C ambient with no initial load)	GES-8302 Tests made at 7.8 kv
-------------------------	--	---