


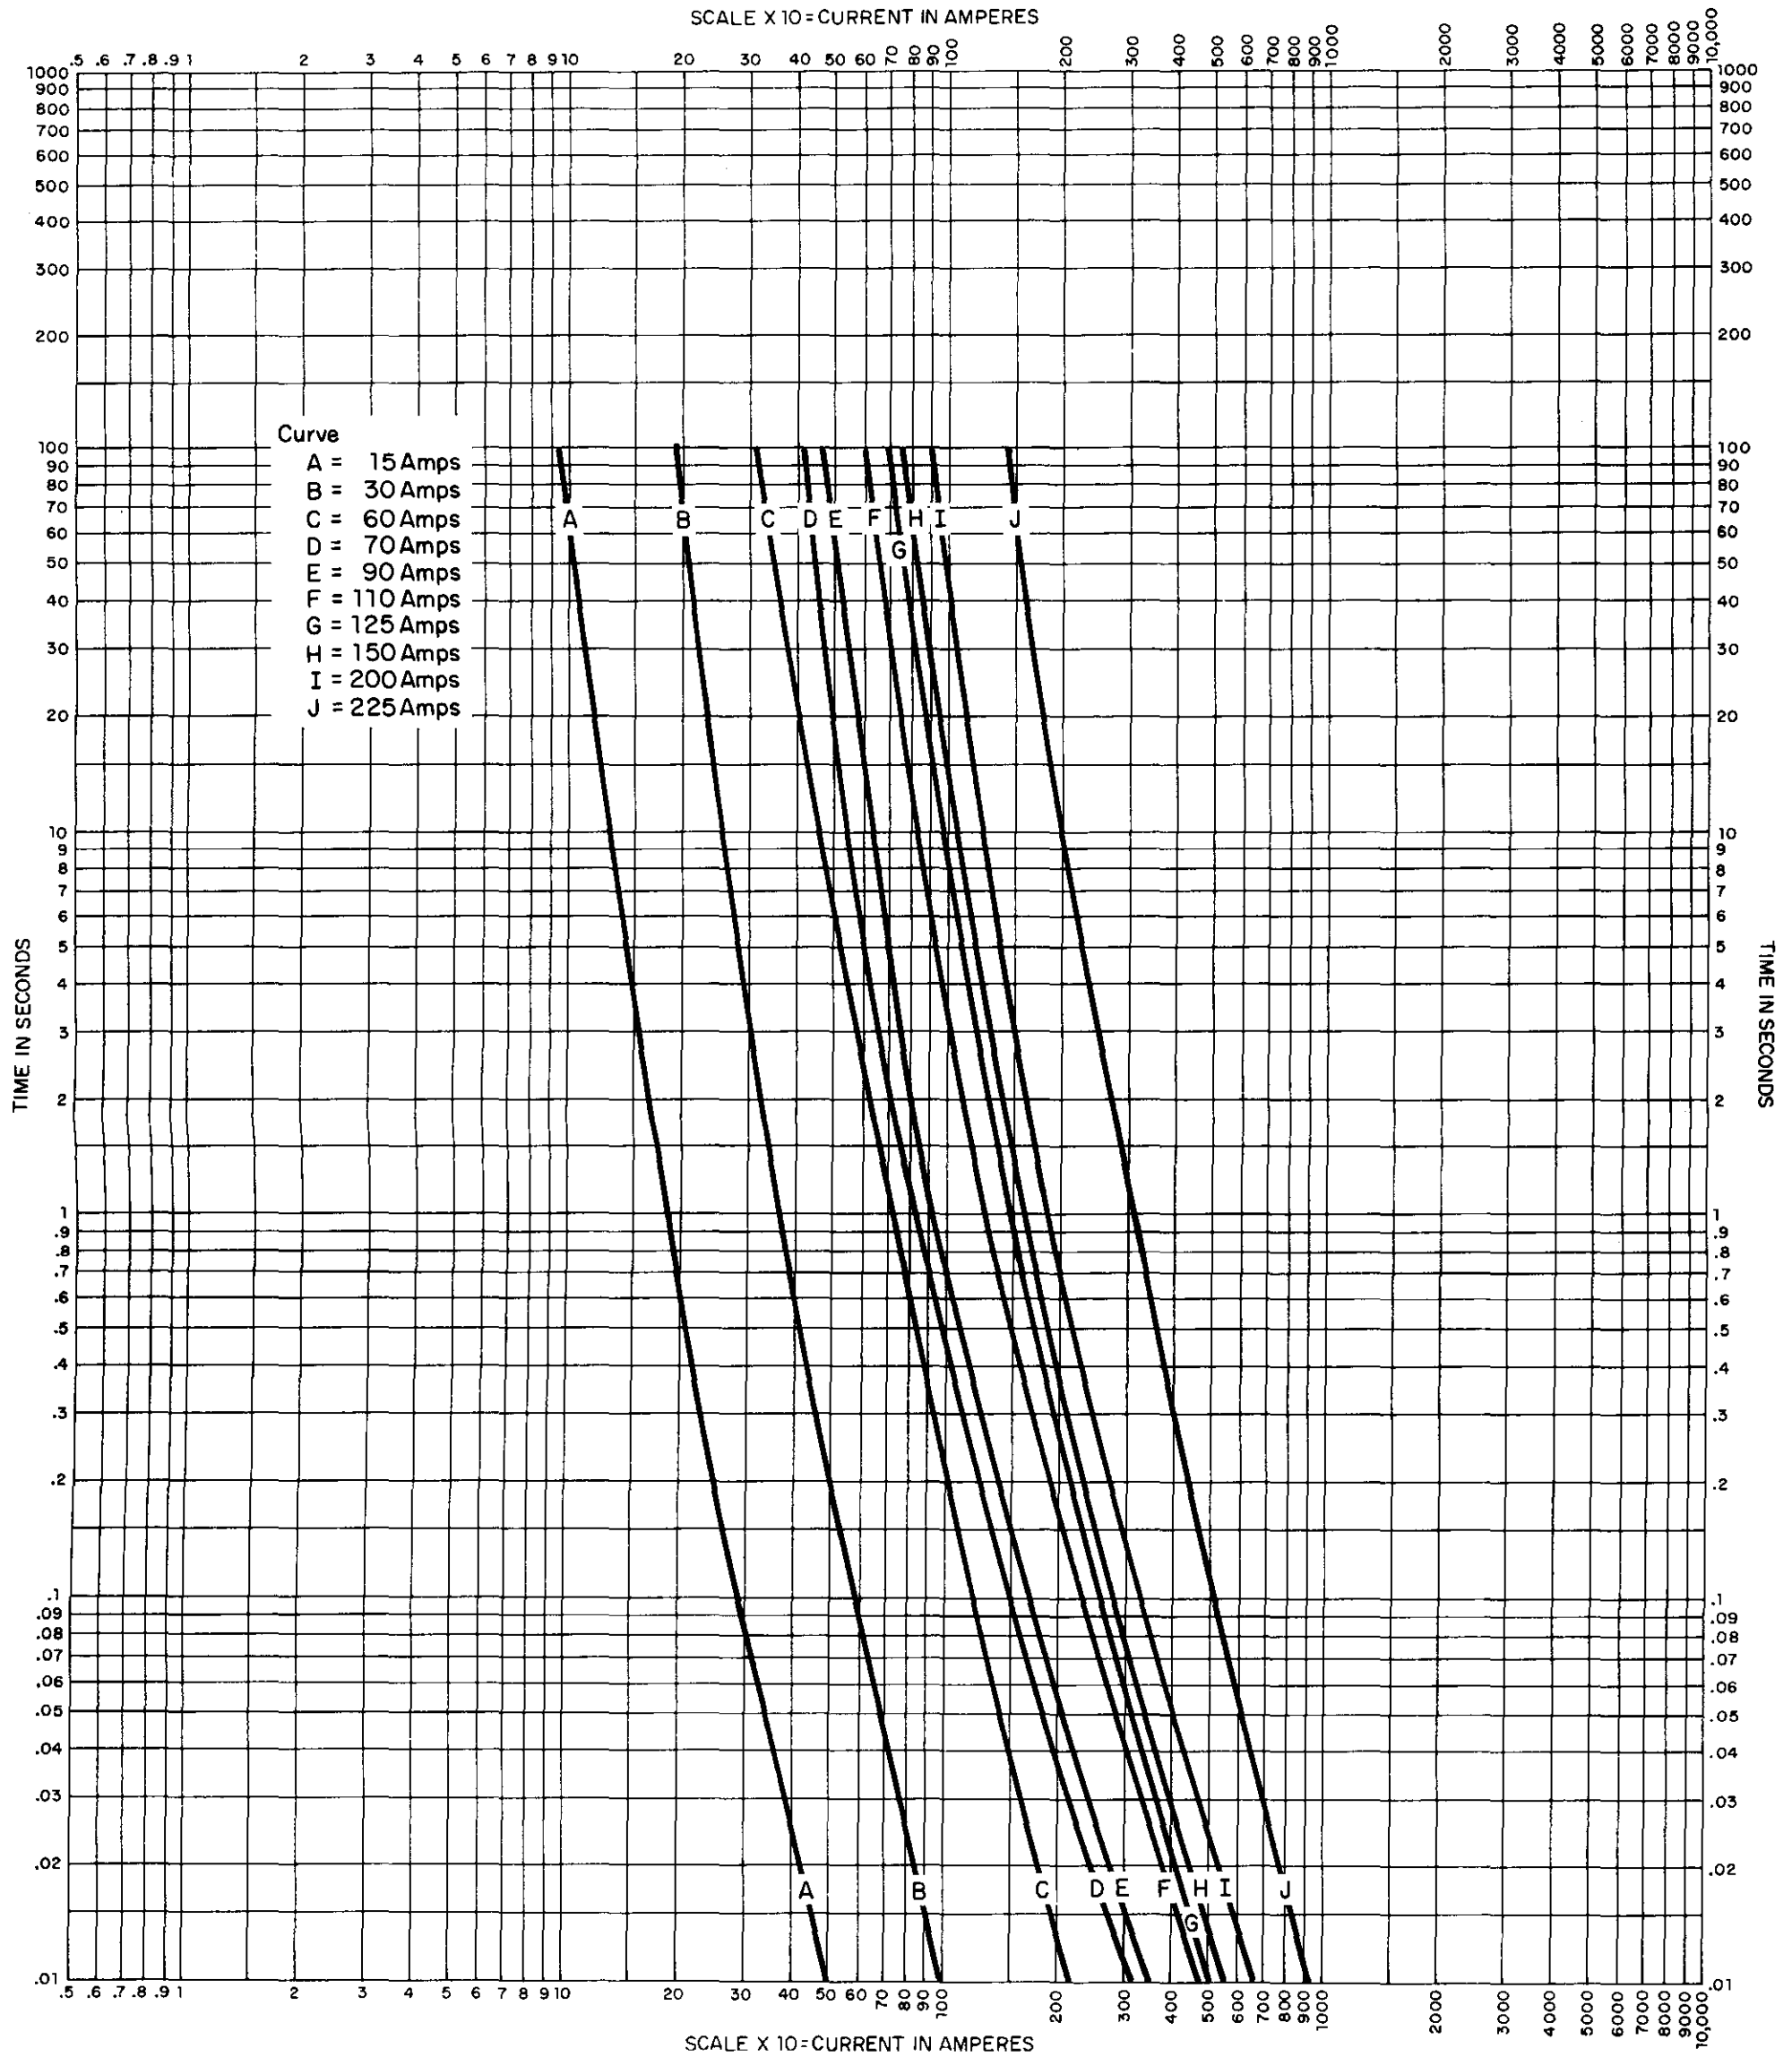

Type CLS-18, CLS-28 Motor Starter Current Limiting Fuses

Total Clearing Time-Current Characteristics, 8.3 Kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to minimum test points so variations should be negative.

Westinghouse Electric Corporation
Distribution and Control Business Unit
Greentree, PA 15220
Printed in USA

Supersedes Curve No. 8
dated December, 1979

January, 1986

8

Reference Data

Curve: A, B, C, D, E, F, G, H, I, J
Ref. Curve No. 666643
Date: 10-29-73