


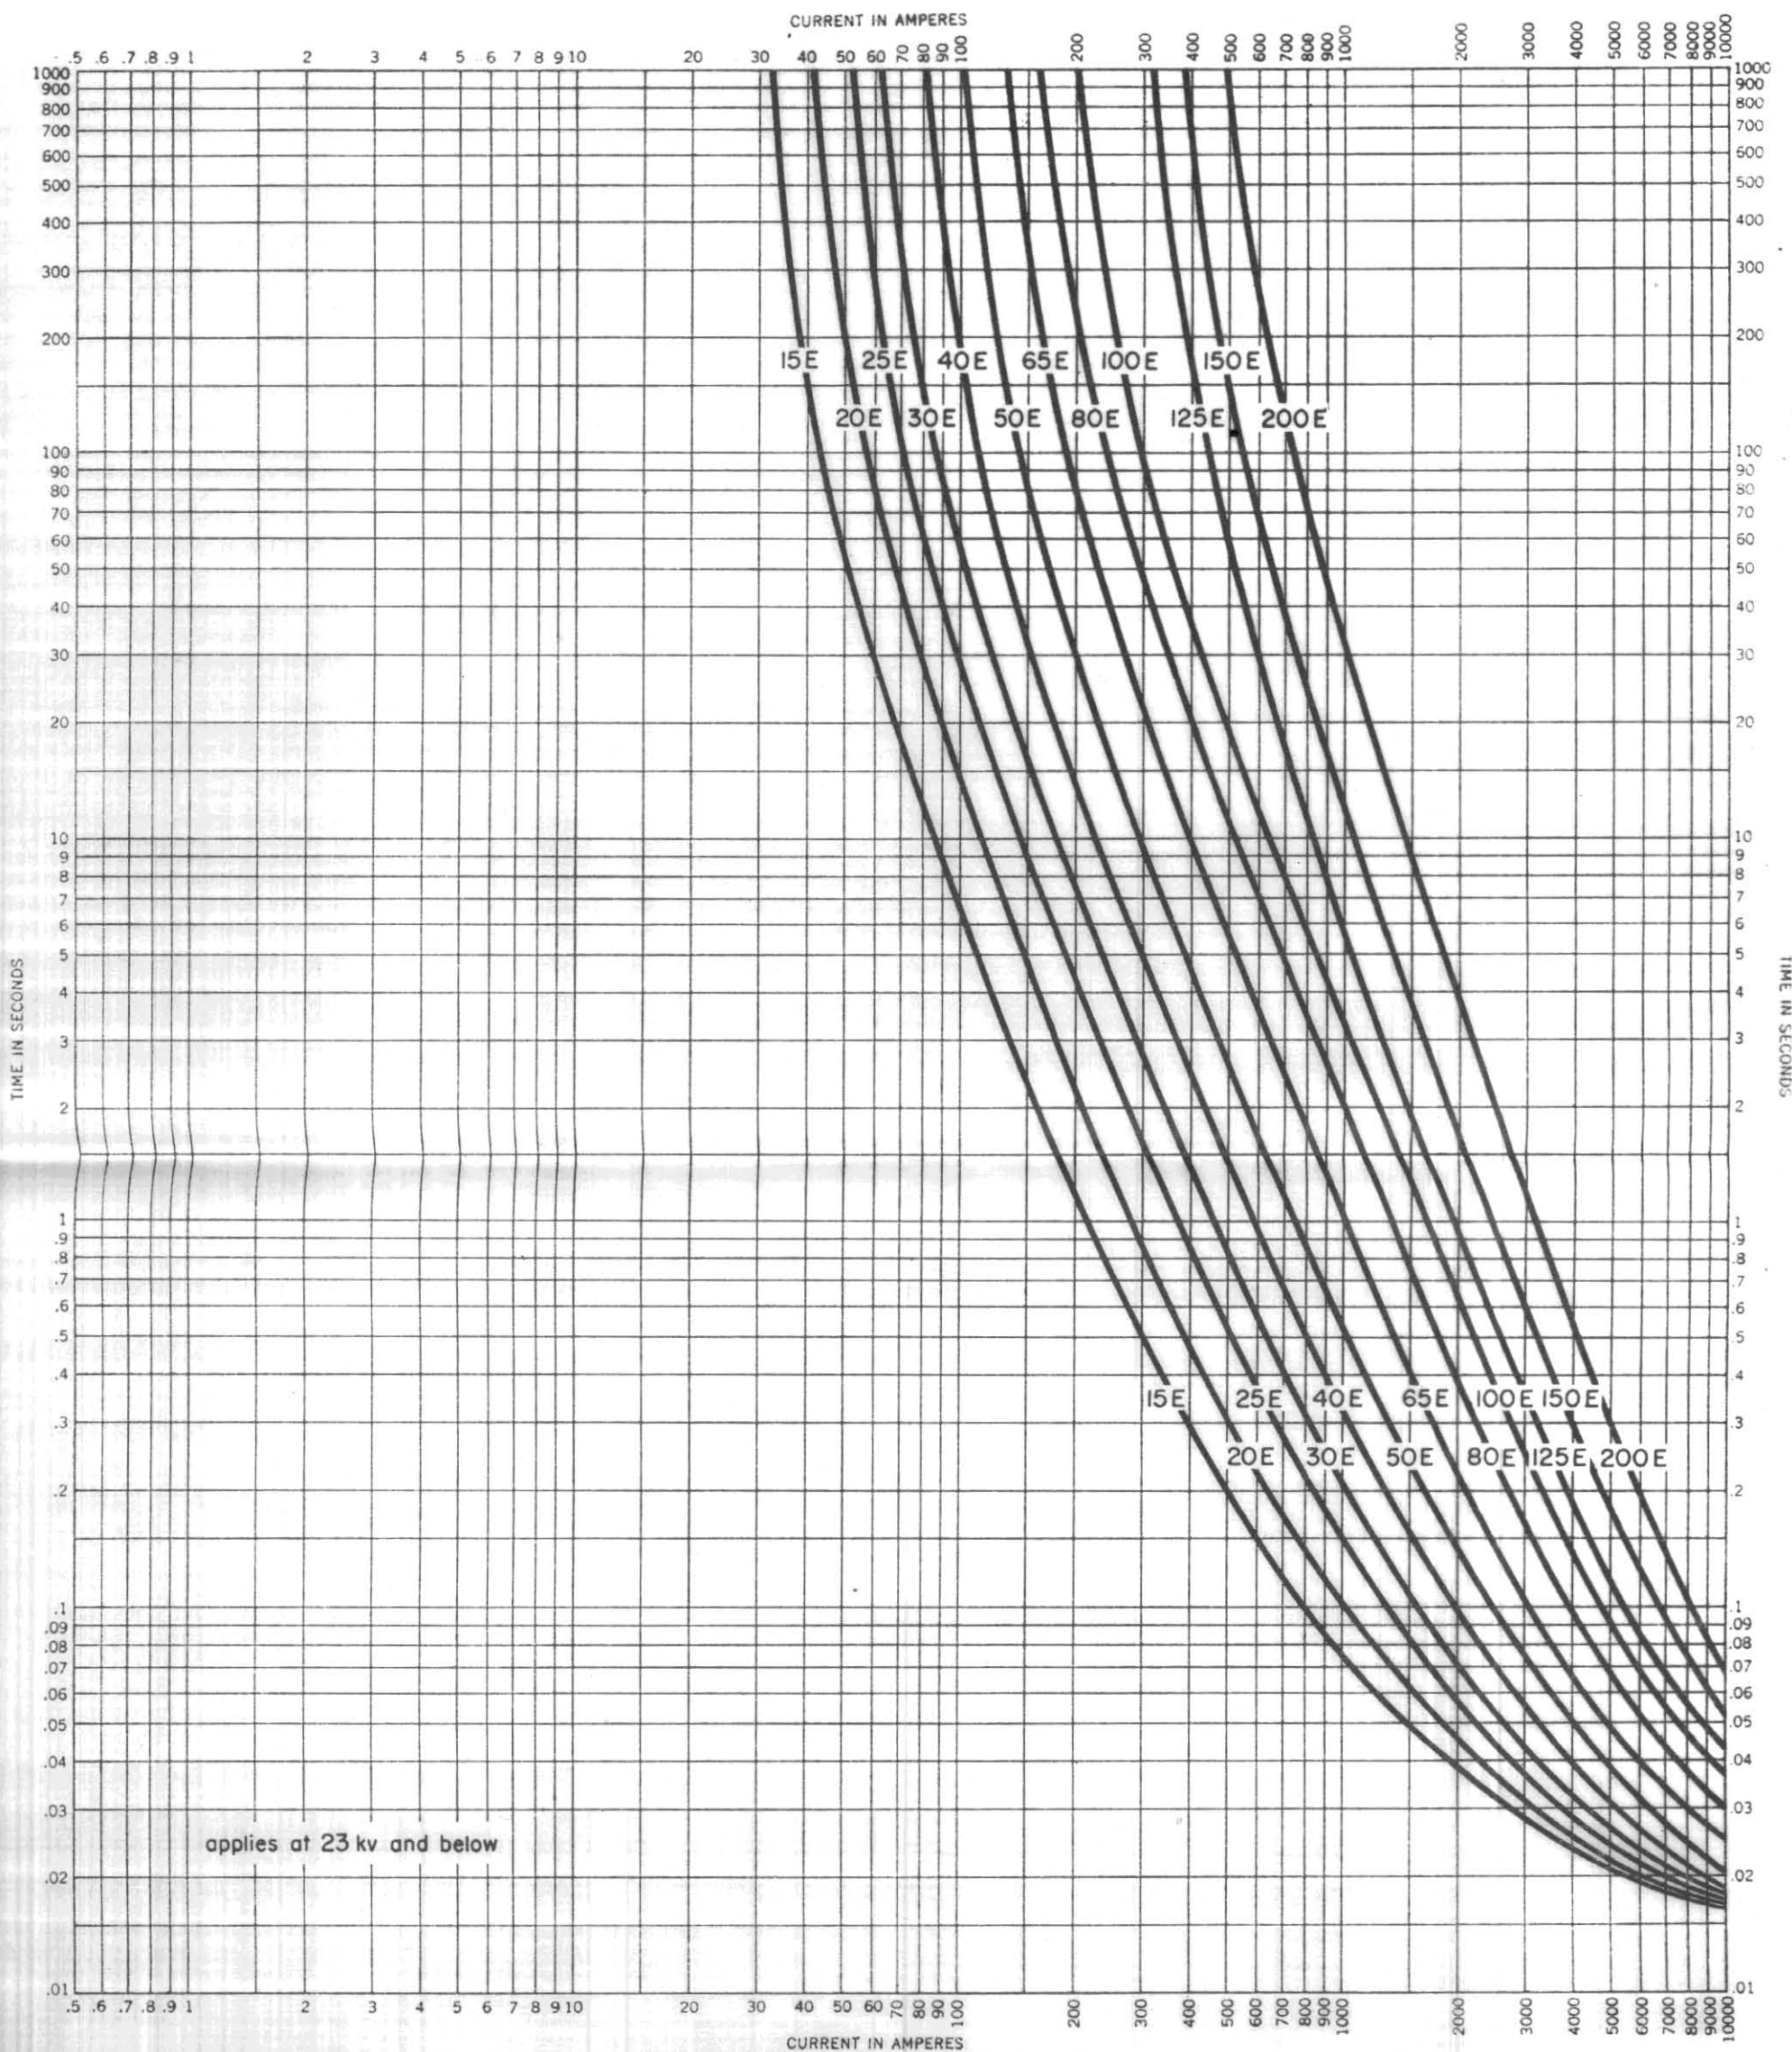

type DBA-1 dropout power fuses • time lag fuse elements

total clearing time-current characteristics—2.4 to 23 kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so all variations should be negative.

Westinghouse Electric Corporation

Assembled Switchgear and Devices Dept.: East Pittsburgh Division • East Pittsburgh, Pa.

printed in U.S.A.

curve no.

15

reference no. 459356

January, 1961