


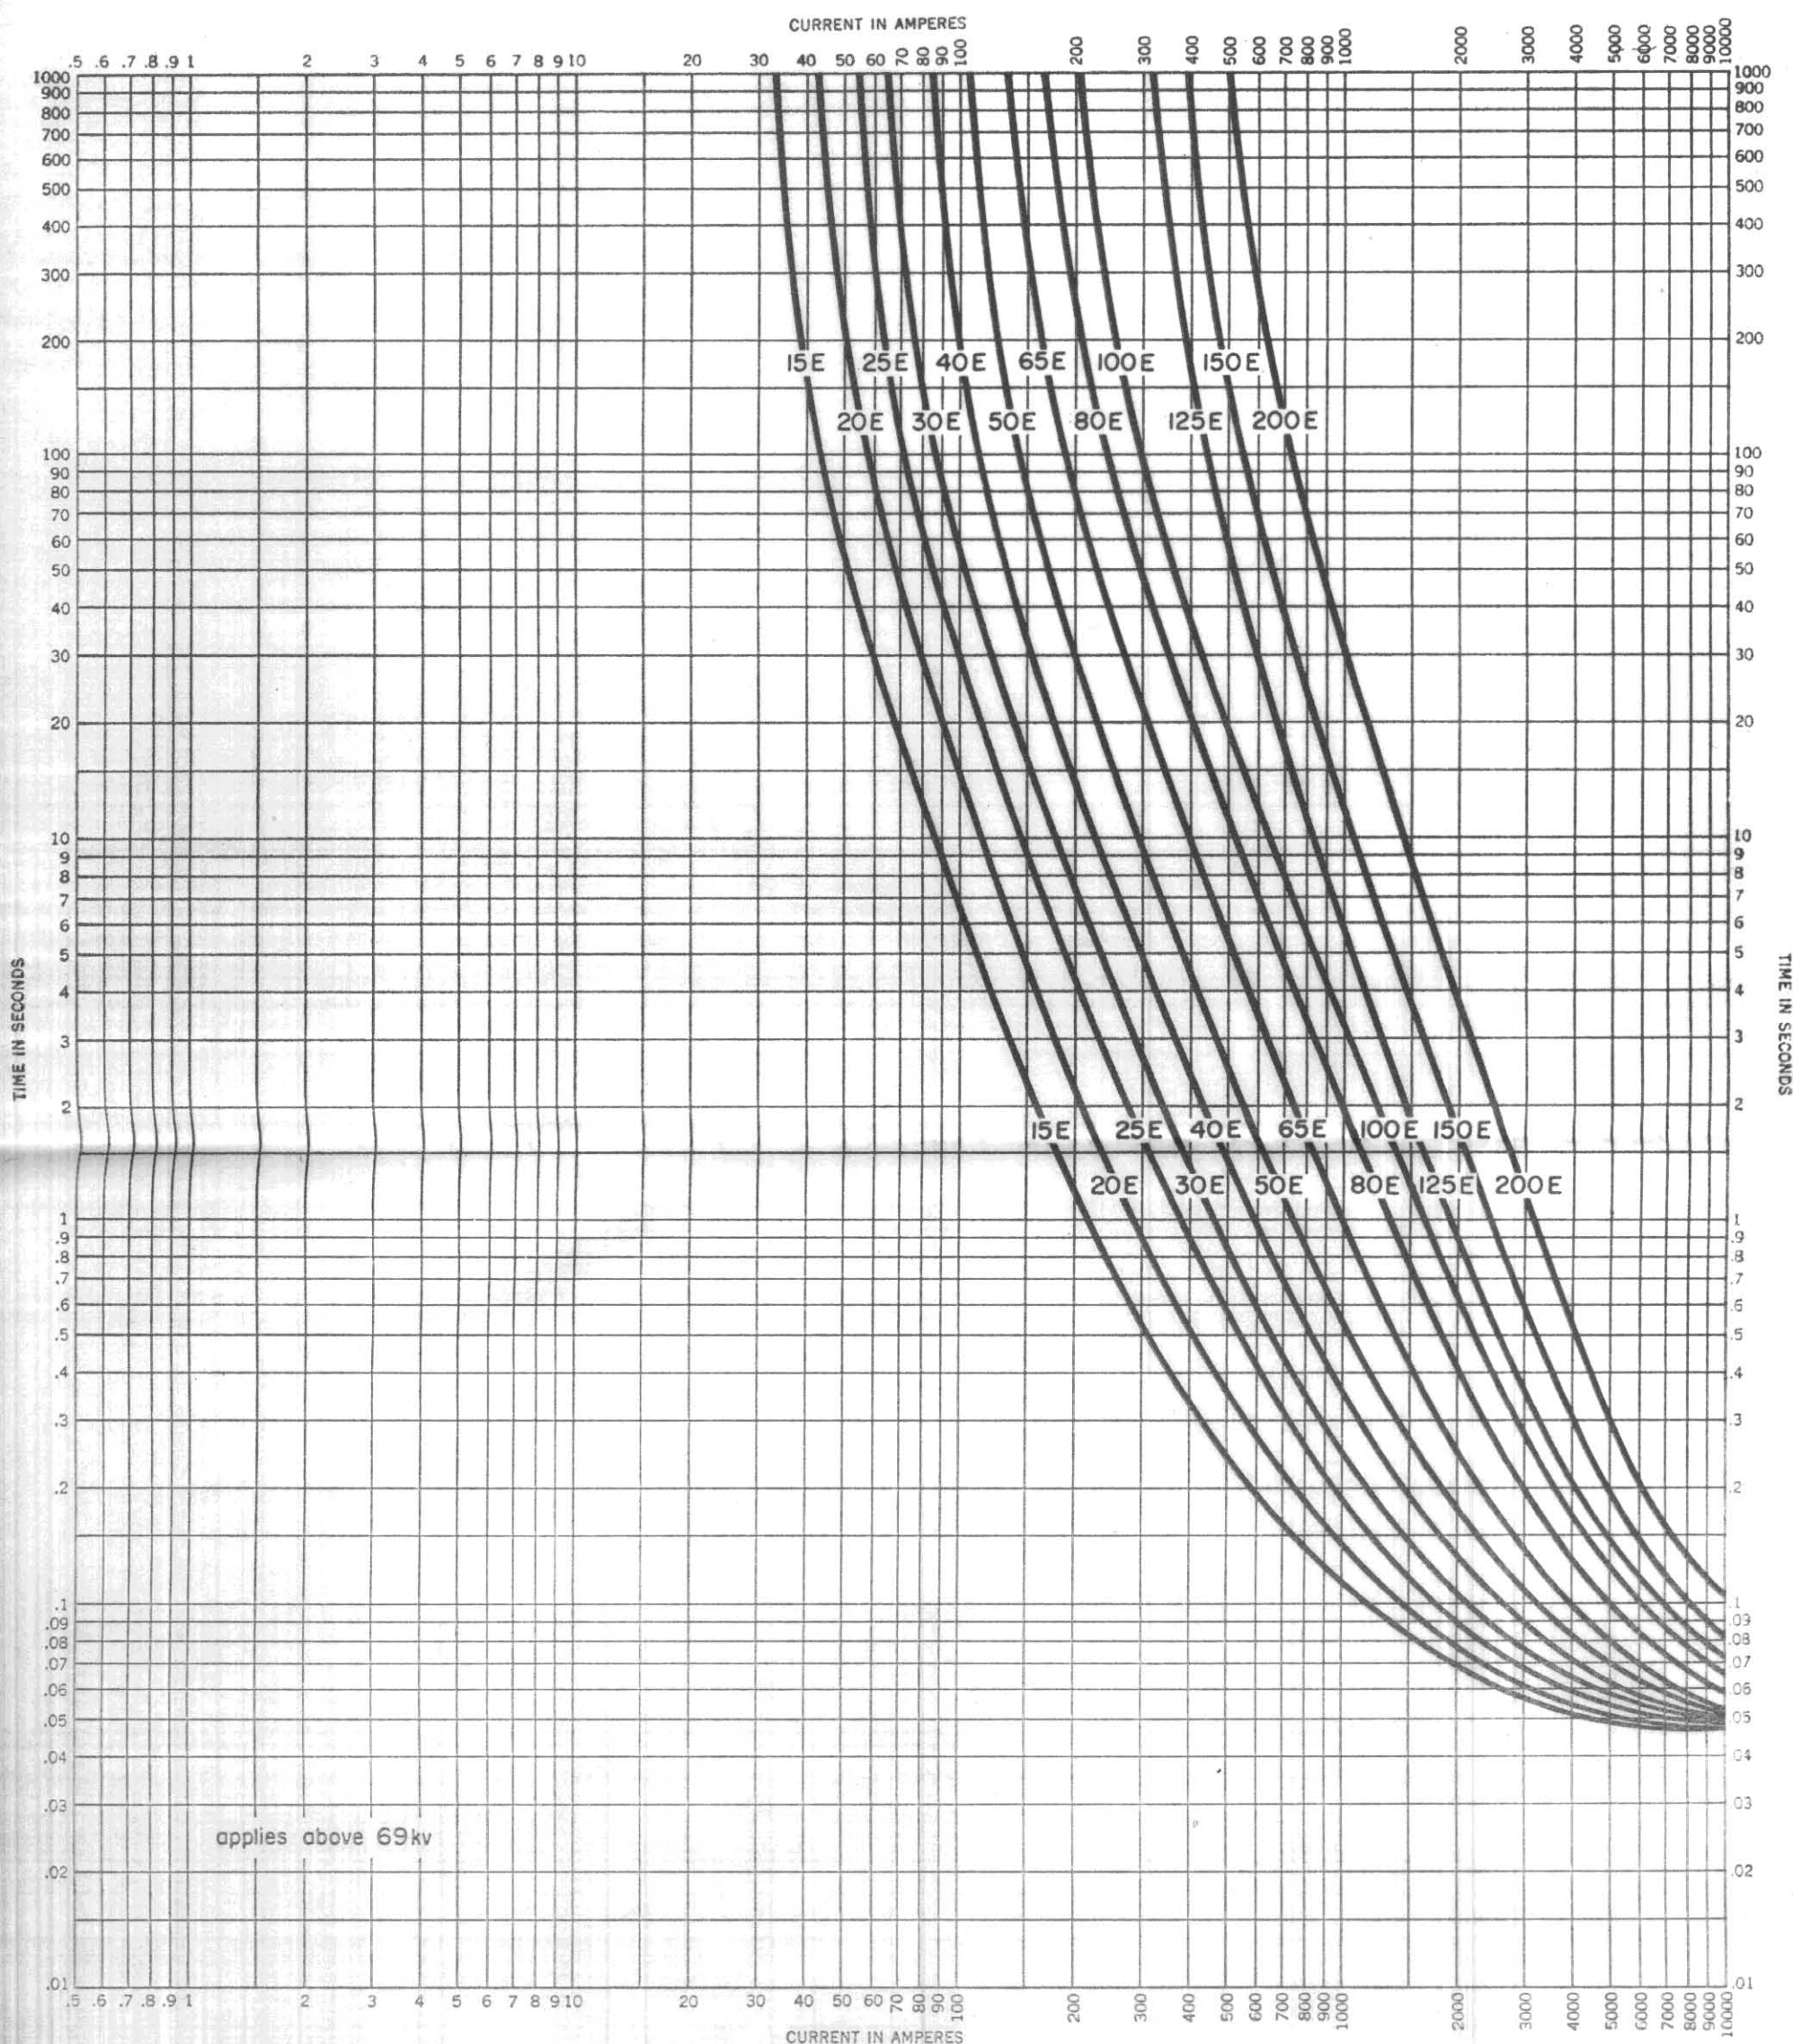

type DBA-2 dropout power fuses • time lag fuse elements
total clearing time-current characteristics—92 to 138 kv

Curves are based on tests starting with fuse units at an ambient temperature of 25°C and without initial load. Curves are plotted to maximum test points so all variations should be negative.

Westinghouse Electric Corporation
Assembled Switchgear and Devices Dept.: East Pittsburgh Division • East Pittsburgh, Pa.
 printed in U.S.A.

curve no.

17

reference no. 459358

January, 1961