


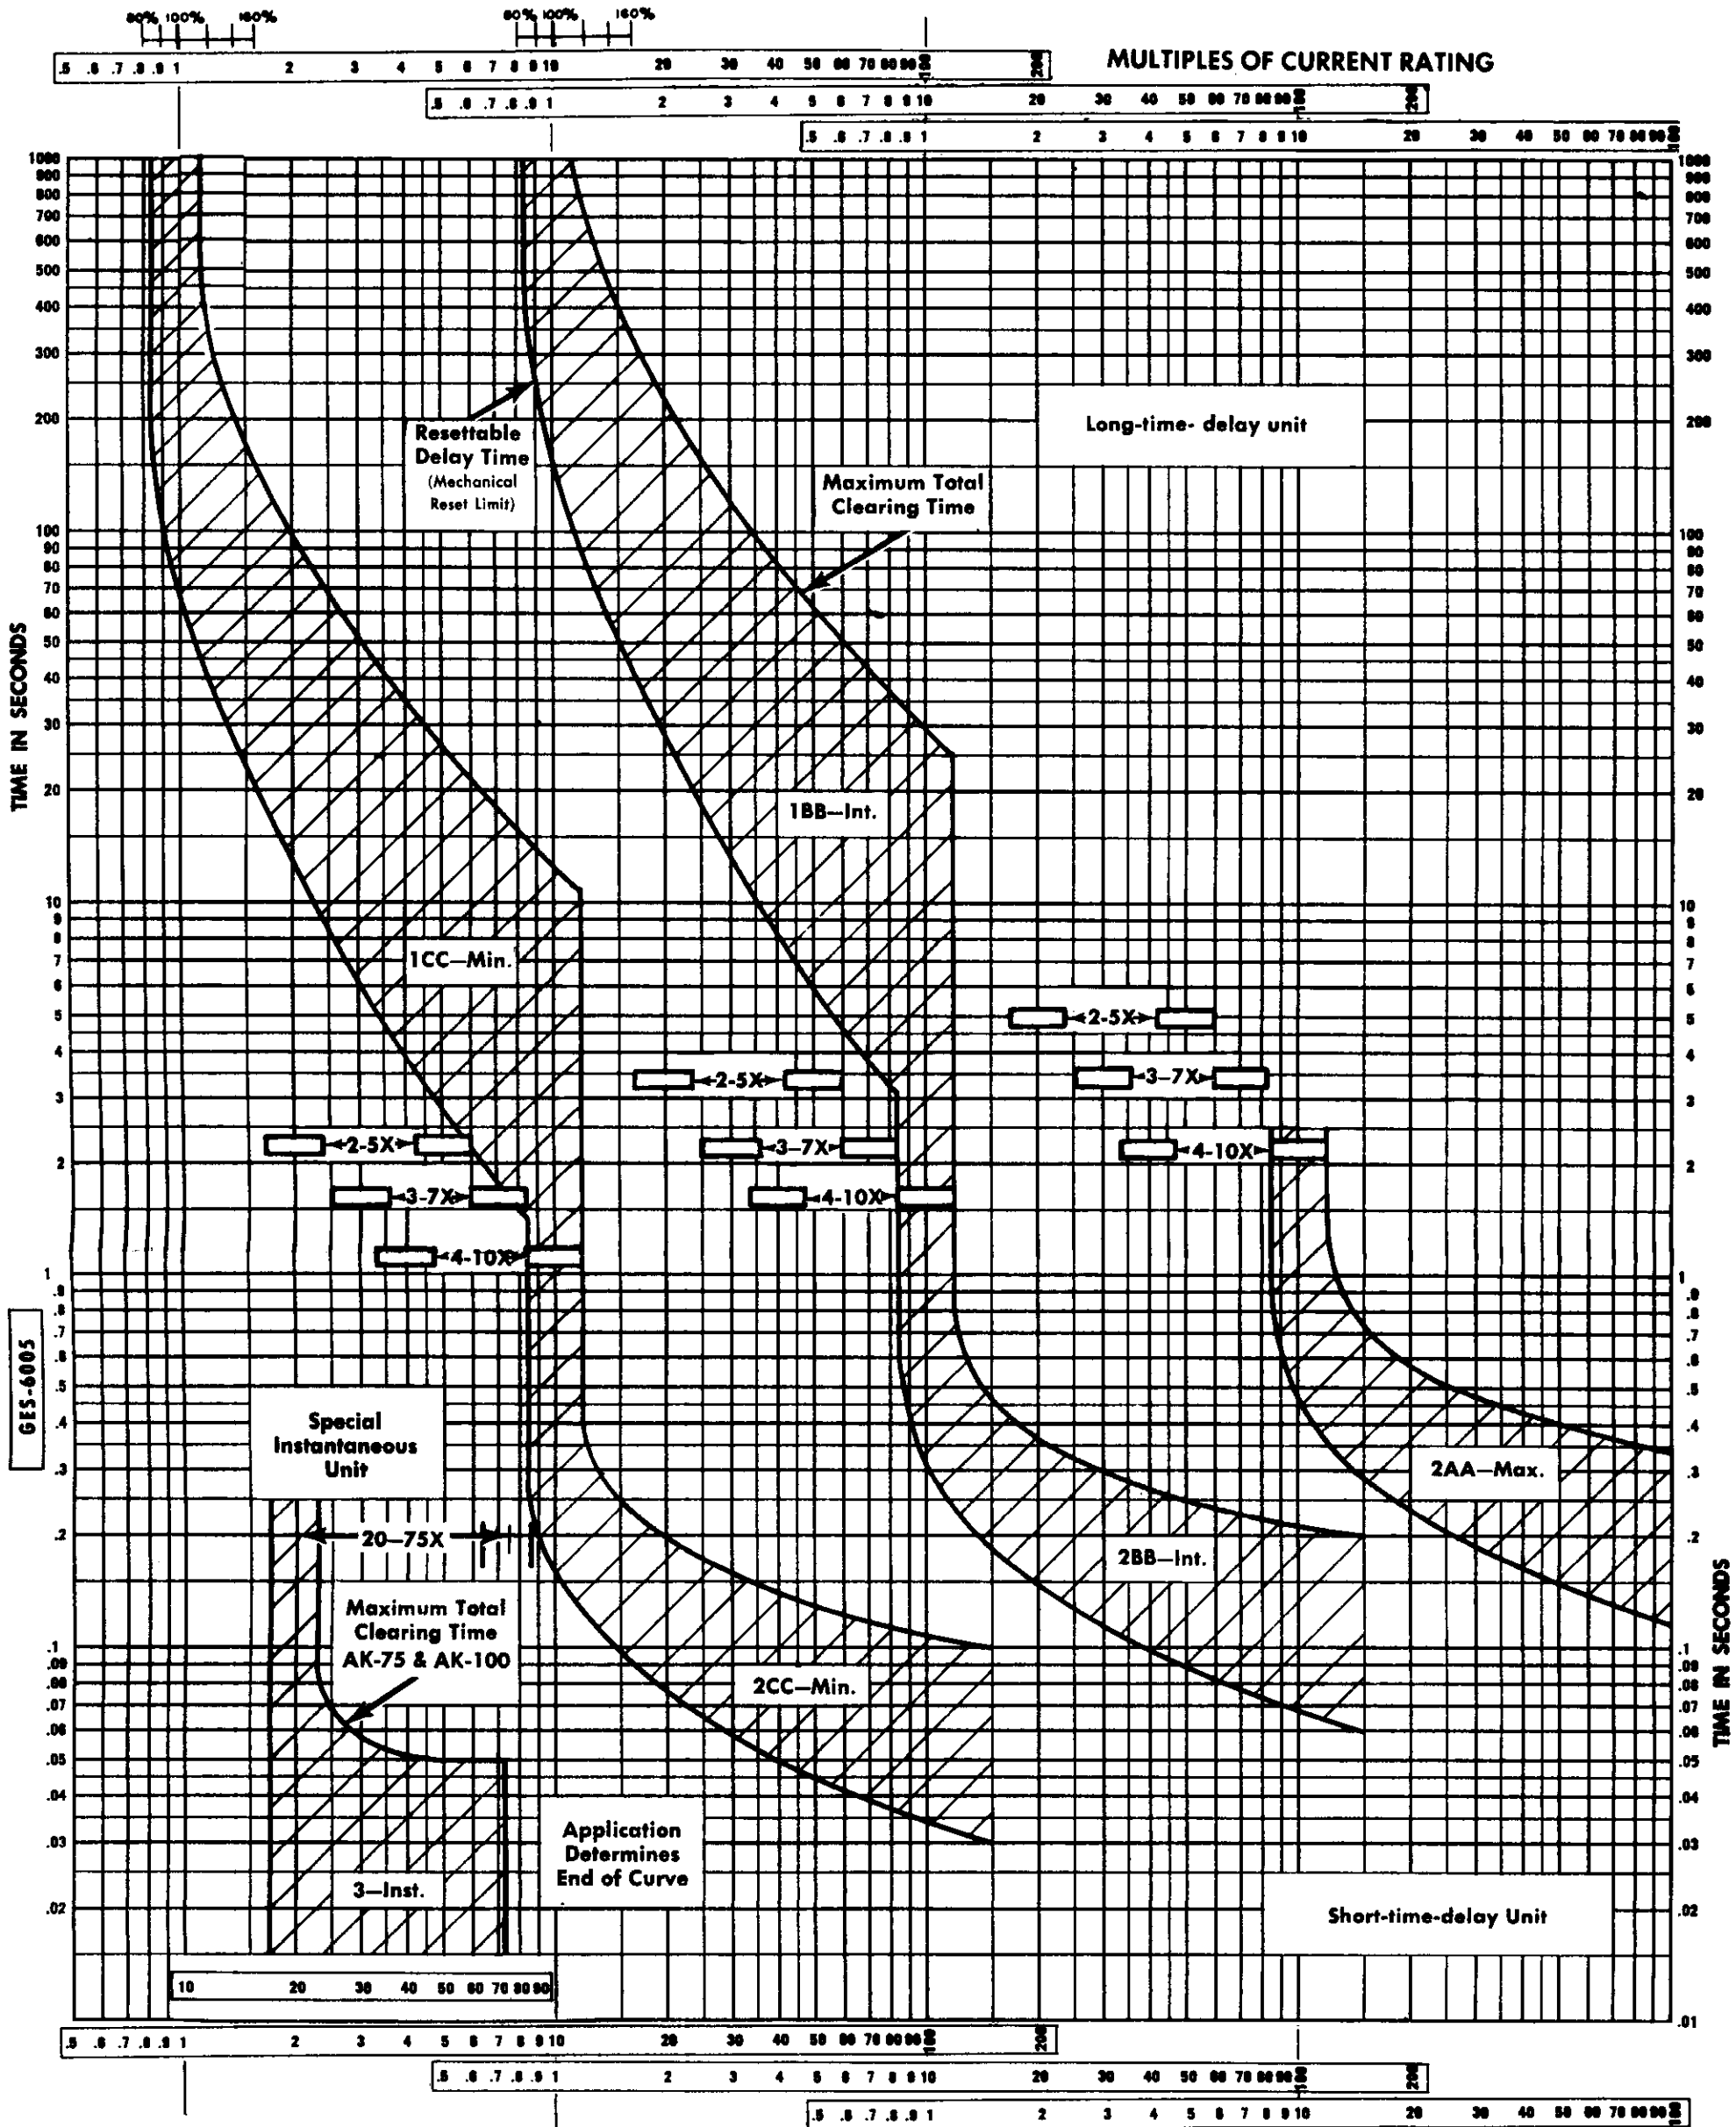

GENERAL ELECTRIC	TYPE AK LOW-VOLTAGE POWER CIRCUIT BREAKER	GE-6005
EC-1B SERIES TRIP DEVICE		
Current Ratings (Amperes)	Long-time-delay, Short-time-delay and Instantaneous Time-current Curves	Adjustments
AK-75 AK-100	2000, 2500, 3000 2000, 2500, 3000, 4000	Long-time-delay Unit: Pickup current settings are 80 to 160% of rating. (Settings higher than 100% do not increase the continuous current ratings.) Short-time-delay Unit: Pickup current settings are 2 to 5X, or 3 to 7X, or 4 to 10X of ratings. Instantaneous Unit: Special pickup current settings are 20-75X of ratings.
(Curves apply at 60 Hertz for ambient temperature of 25 C)		