


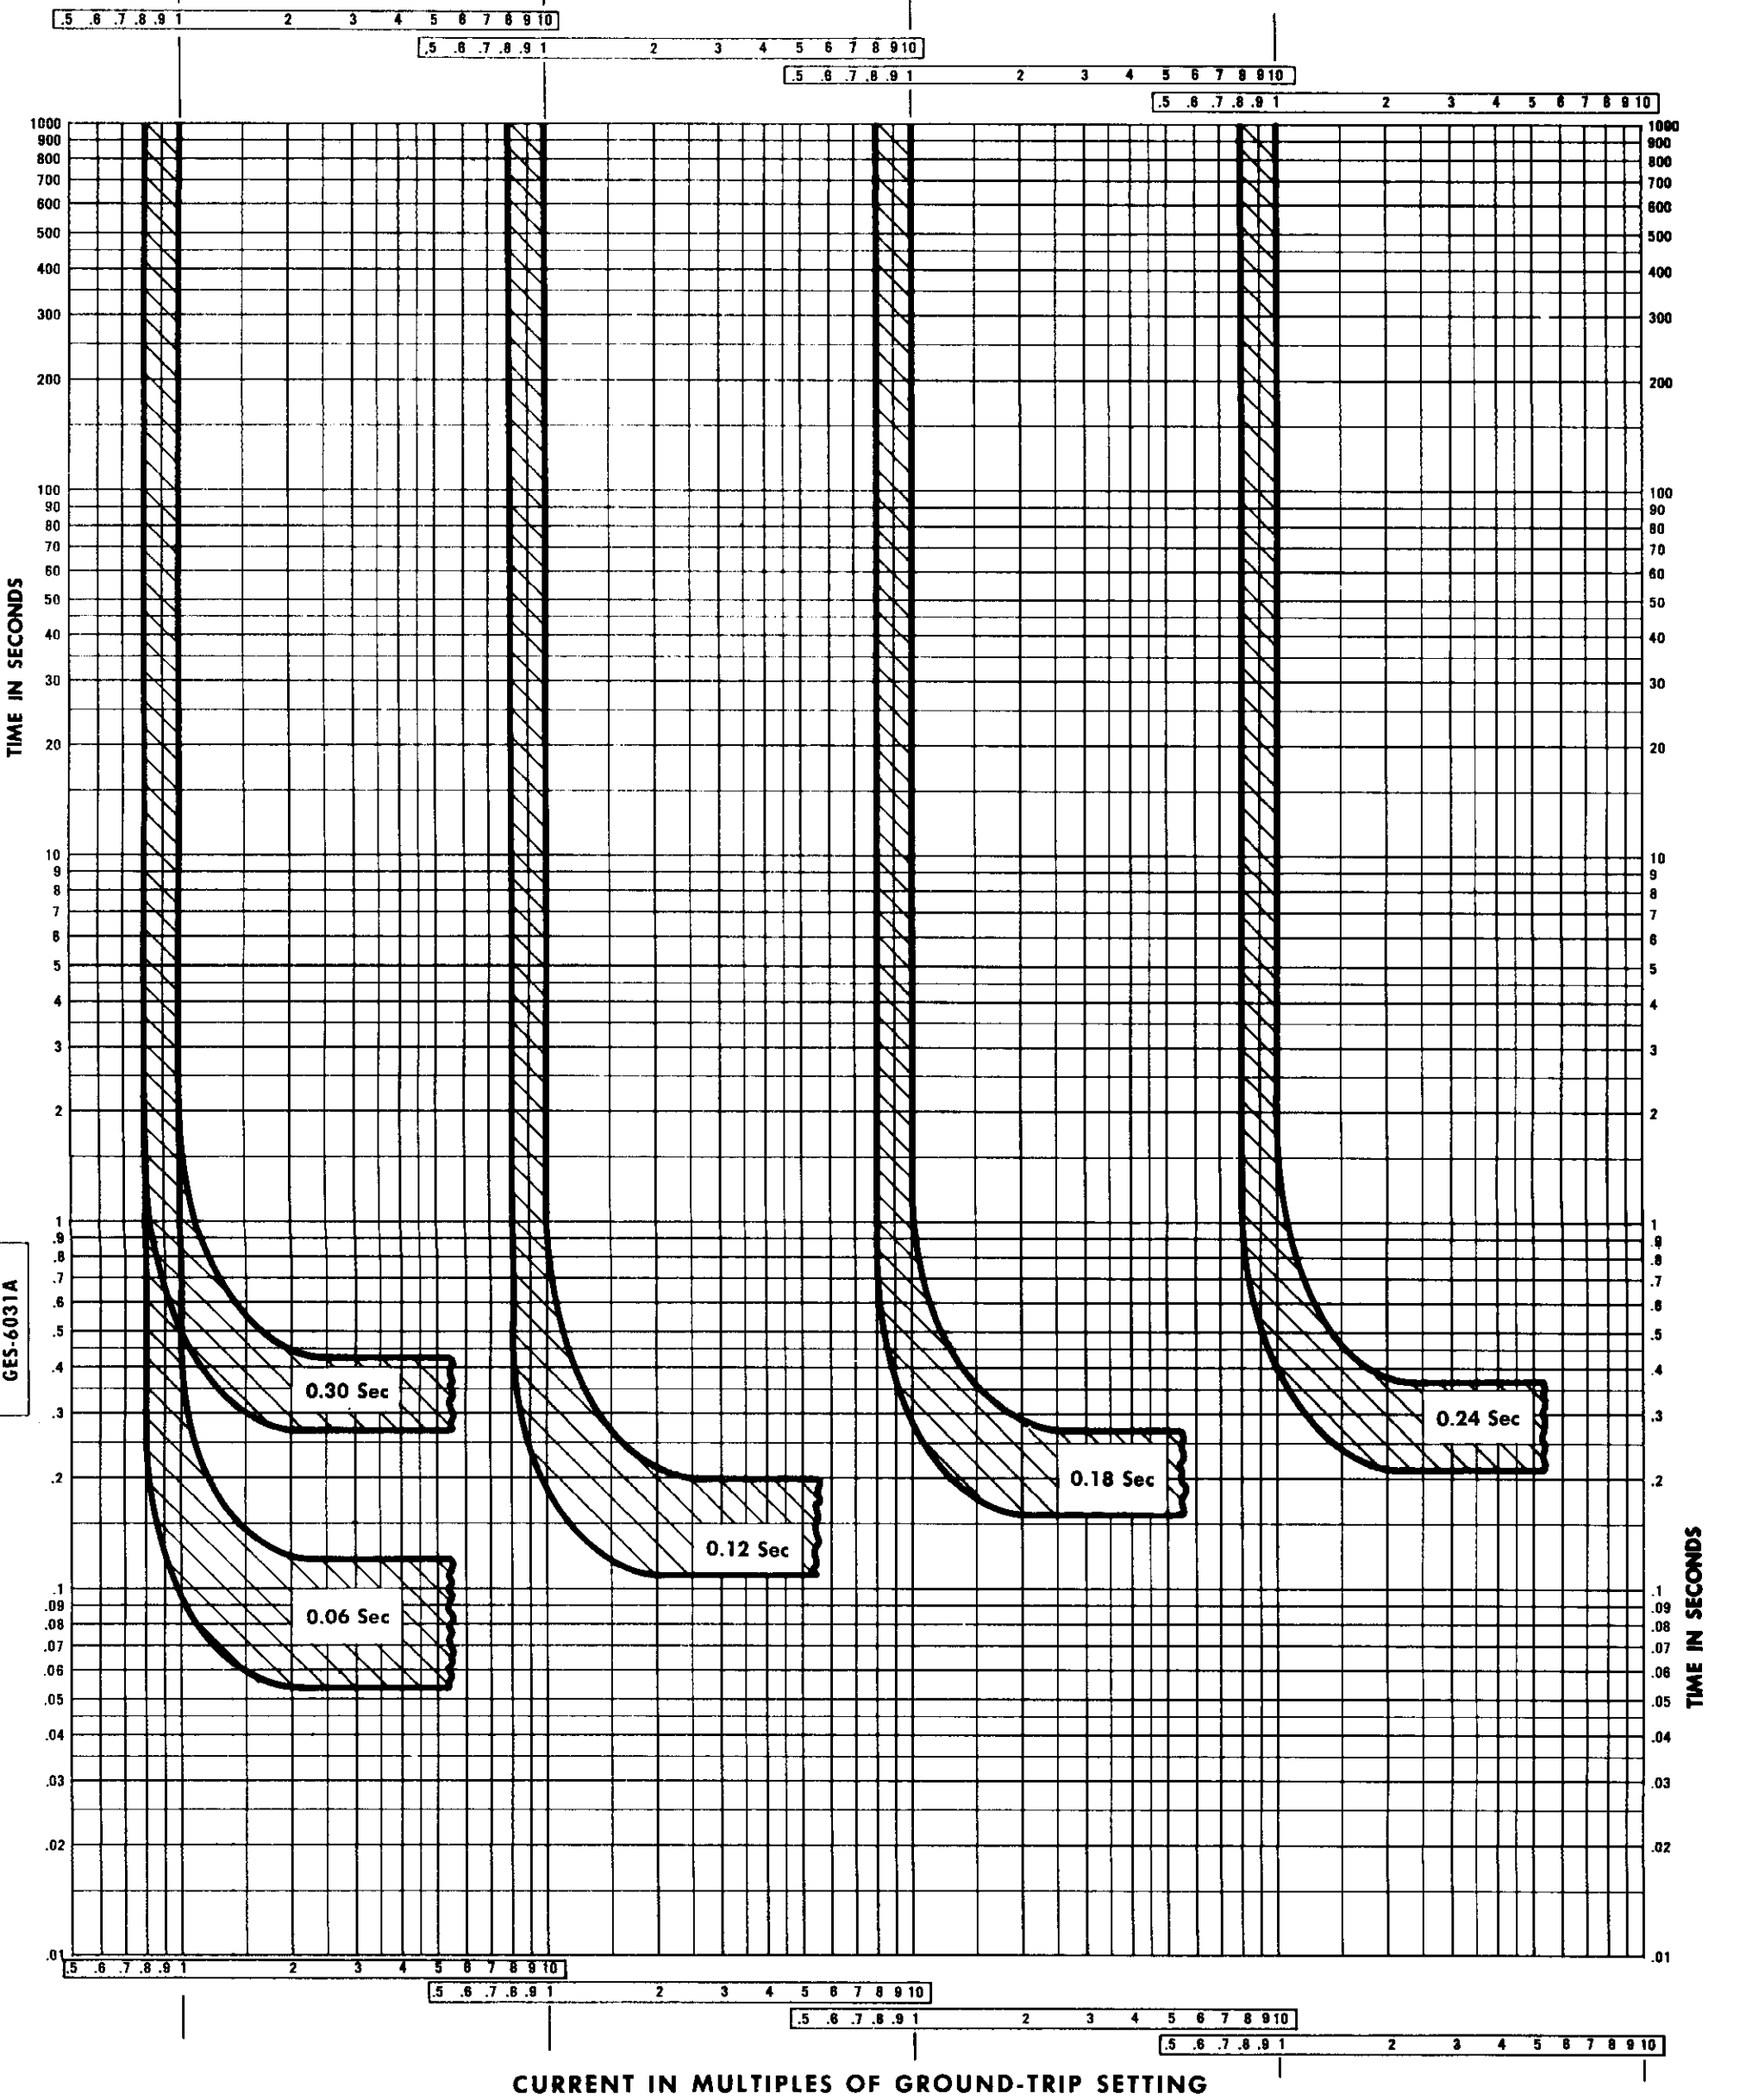

GENERAL ELECTRIC

**TYPE AK LOW-VOLTAGE POWER CIRCUIT BREAKER
POWER SENSOR[†] SOLID-STATE GROUND-TRIP DEVICE**

GES-6031A

Ground-trip Settings (Amperes)

AK-25	100, 200, 300, 400
AK-25 & 50	300, 600, 900, 1200
AK-75 & 100	750, 1500, 2250, 3000 (see Note ①)
	750, 1200, 2250, 3000 (see Note ②)

[†] Trade-mark of General Electric Company

**Type PS-1A Ground Trip
Time-current Curves**

(Curves apply at 60 Hertz and from -20 C to +55 C ambient)

Adjustments

Short-time-delay Unit: Time settings are 0.06, 0.12, 0.18, 0.24, and 0.30 seconds.

NOTES:

- ① For Logic Units with 184L373G—Series Cat. Nos.
- ② For Logic Units with 184L410G—Series Cat. Nos.