

Front Busbar Connection

Piezas frontales de conexión a barras

Plages de raccordement avant

U.S. Cat. No. | Euro Order No.

Item: SSBP 3VL9800-4EF01

SSBPH 3VL9800-4EG01

For Use With Frame NG, PG

Para Usar Con Caja Base NG, PG

Installation Instructions / Instructivo de Instalación

	 Danger	 Peligro	 Danger
	Hazardous Voltage. Will cause death or serious injury. Turn off and lock out all power supplying this device before working on this device. Replace all covers before power supplying this device is turned on.	Tensión peligrosa. Puede causar la muerte o lesiones graves. Desenergice totalmente antes de instalar o darle servicio. Reemplace todas las barreras y cubiertas antes de energizar el interruptor.	Tension dangereuse. Danger de mort ou risque de blessures graves. Couper l'alimentation de l'appareil et barrer avant de travailler. Remplacez tous les couverts avant que l'alprovisionnement de pouvoir soit alimenté.

Use only with Siemens certified Components.

Utilizar únicamente con componentes certificados de Siemens.

A utiliser uniquement avec les composants certifiés Siemens.

TERMINAL SHIELD CATALOG # TSLP3M




THIS SHIELD MUST BE USED WITH CONNECTOR STRAP KITS CAT. # SSBP AND SSBPH. REPLACE THIS SHIELD BEFORE ENERGIZING DEVICE.

CUBREBORNES CATALOGO # TSLP3M

LA CUBIERTA DEBE SER USADA CON EL JUEGO DE BARRA DE CONNEXION CAT. # SSBP Y SSBPH. REEMPLACE LA CUBERTA ANTES DE ENERGIZAR EL APARATO.





CACHE-BORNES CATALOGO # TSLP3M

LA CACHE-BORNES DOIT ETRE EMPLOYEE AVEC KIT DE BARRE DE CONNECTEUR CAT. # SSBP ET SSBPH. REMPLACEZ LA CACHE-BORNES AVANT D'ACTIVER LE DISJONCTEUR.

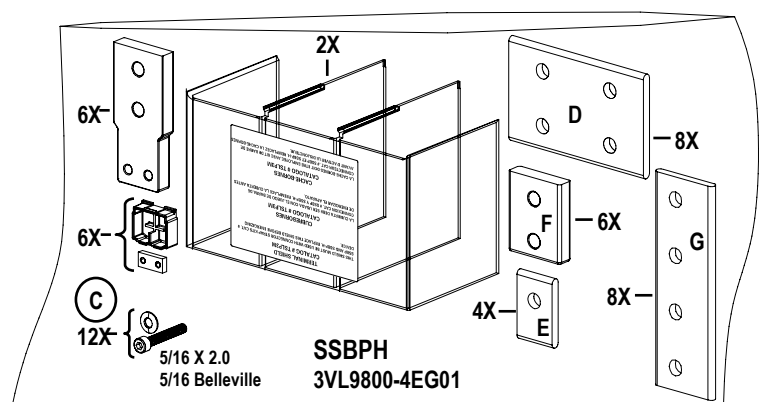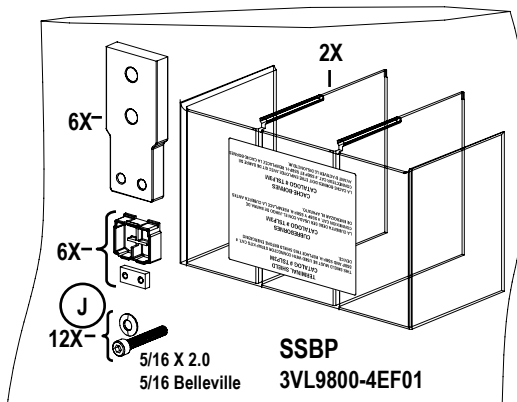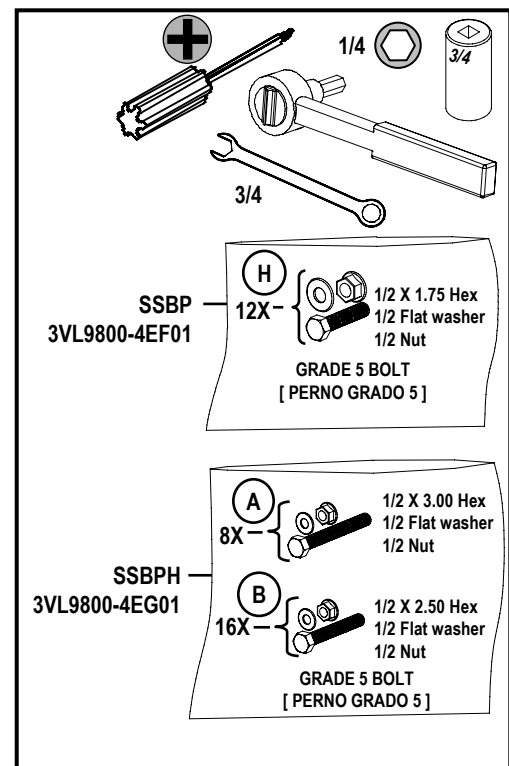


SSBP / 3VL9800-4EF01

LINE / LOAD
[Línea / Carga]

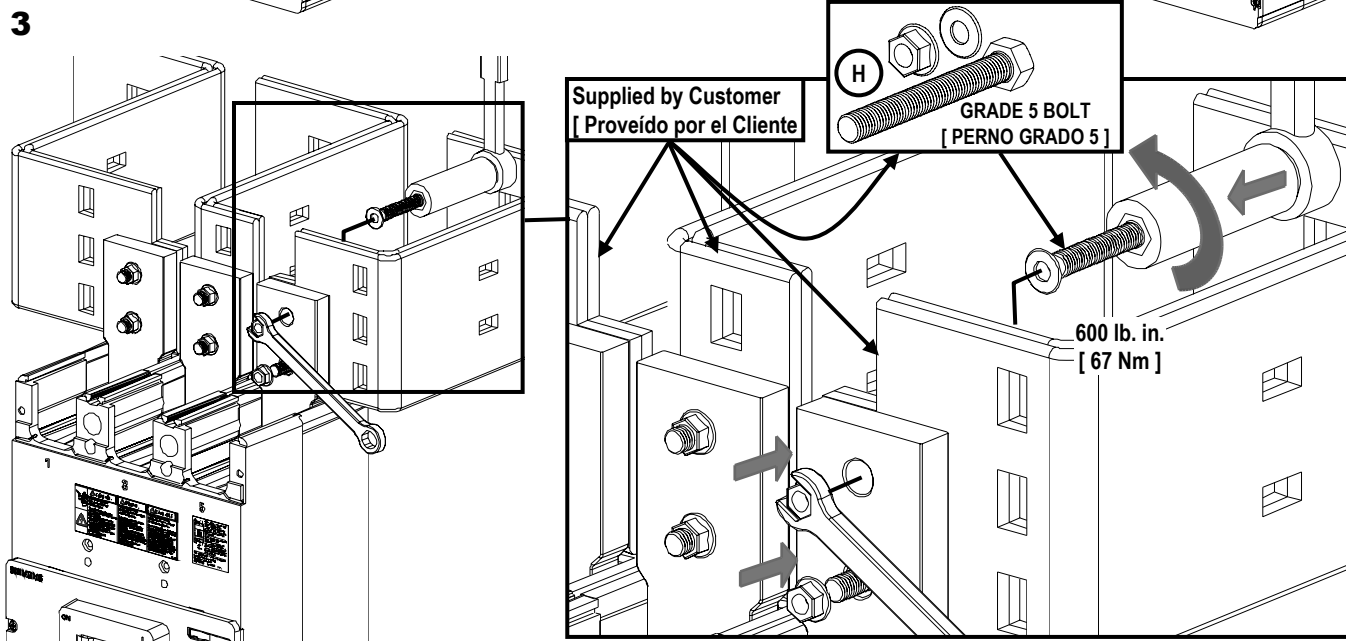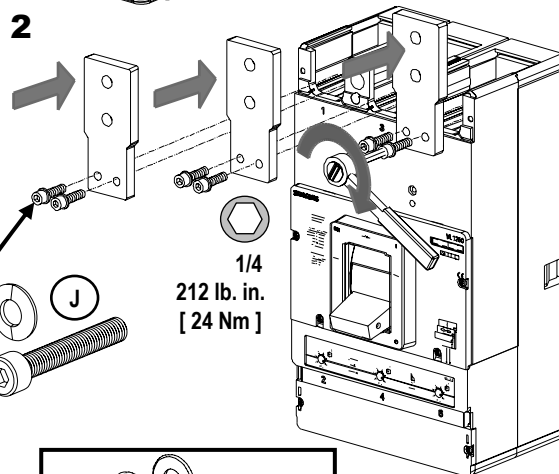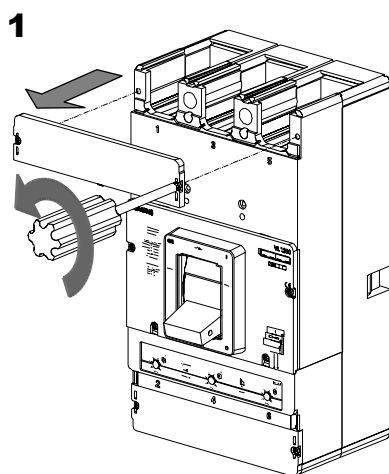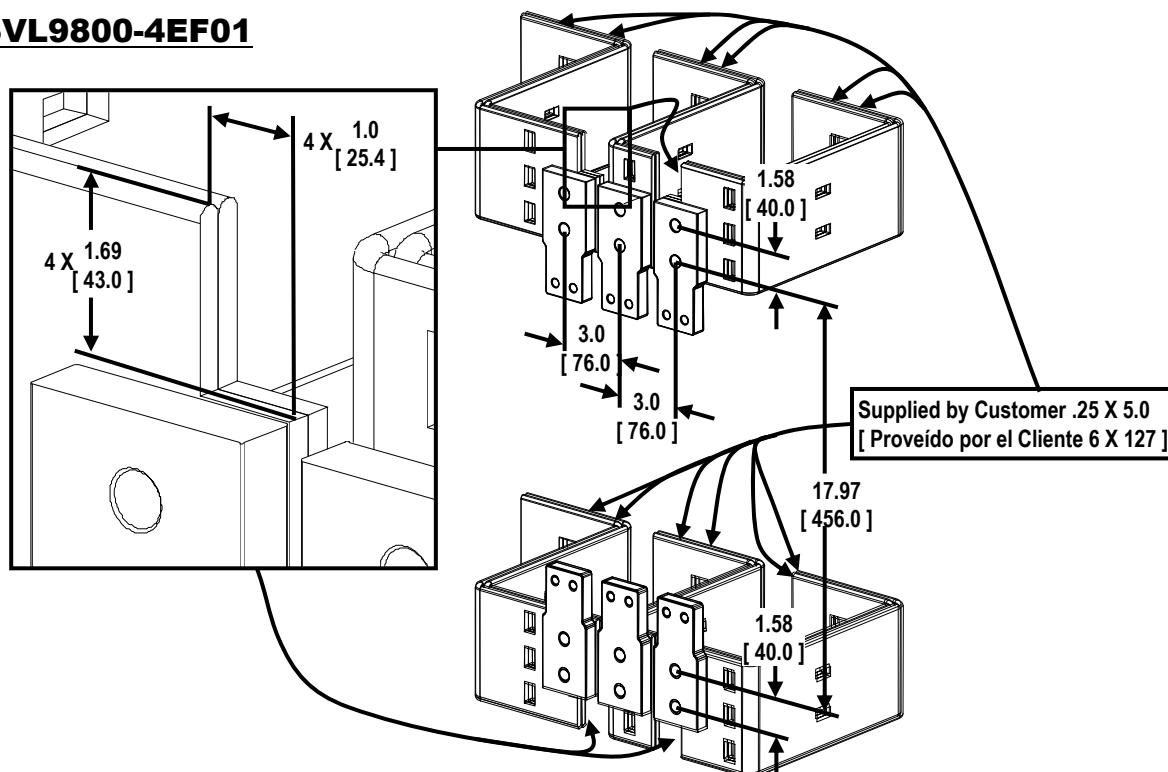


	⚠ Danger Hazardous Voltage. Will cause death or serious injury. Turn off and lock out all power supplying this device before working on this device. Replace all covers before power supplying this device is turned on.	⚠ Peligro Tensión peligrosa. Puede causar la muerte o lesiones graves. Desenergice totalmente antes de instalar o darle servicio. Reemplace todas las barreras y cubiertas antes de energizar el interruptor.	⚠ Danger Tension dangereuse. Danger de mort ou risque de blessures graves. Couper l'alimentation de l'appareil et barrer avant de travailler. Remplacez tous les couverts avant que l'approvisionnement de pouvoir soit alimenté.
---	---	--	--

4


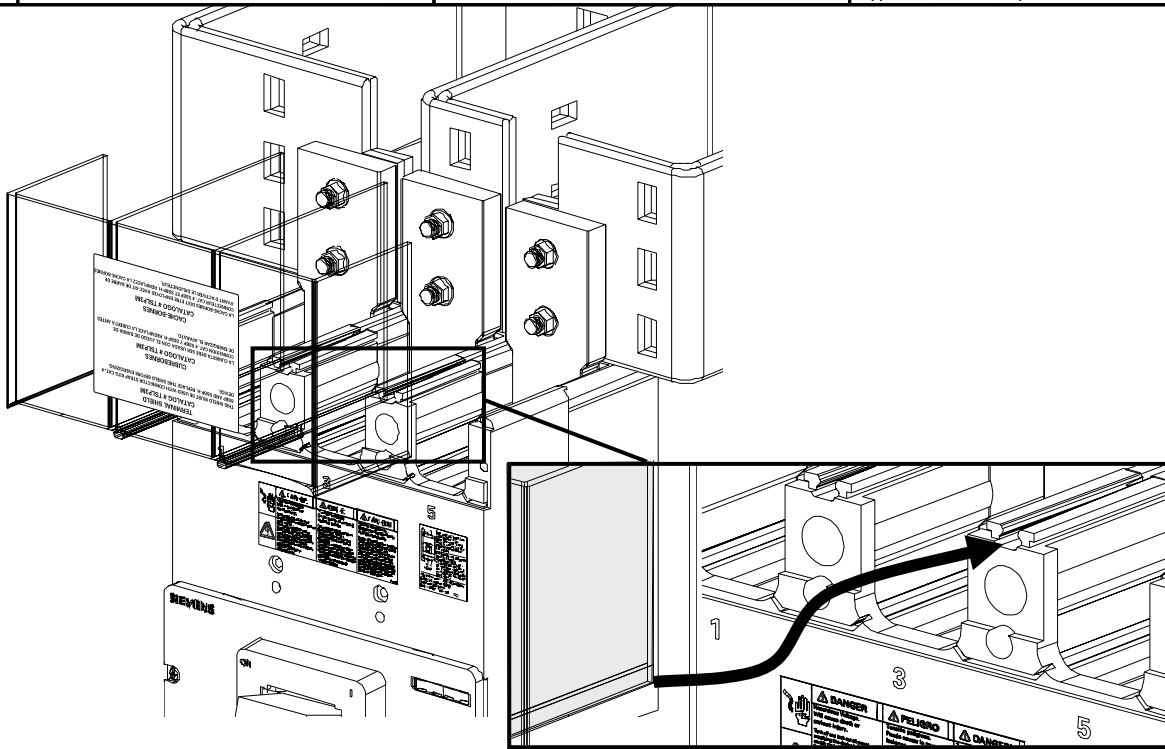


5


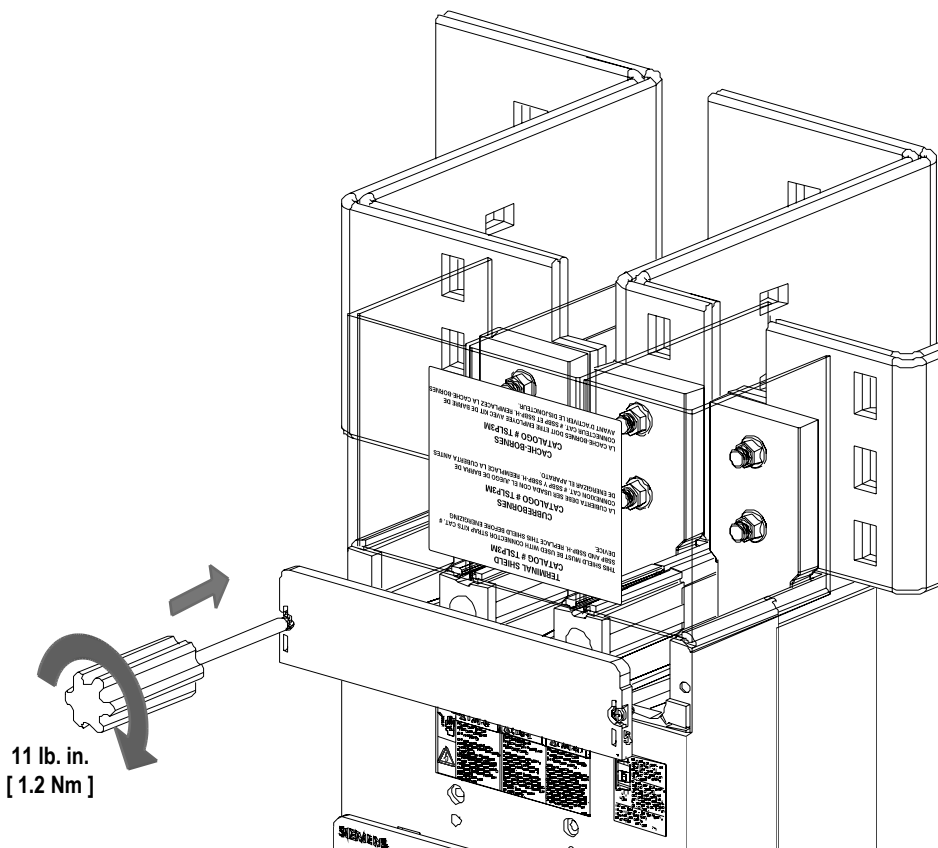


SSBPH / 3VL9800-4EG01

LINE / LOAD
[Línea / Carga]

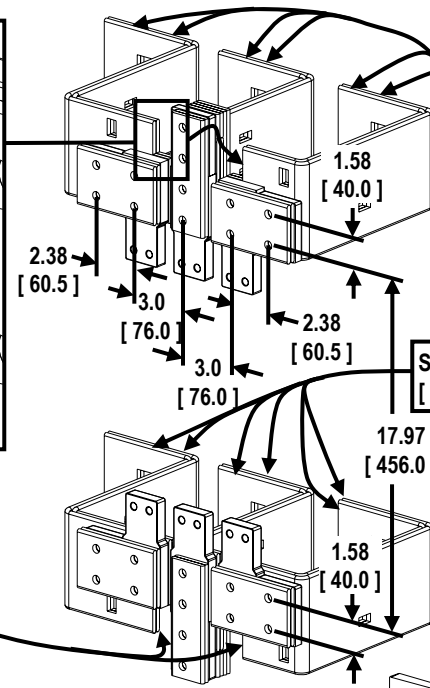
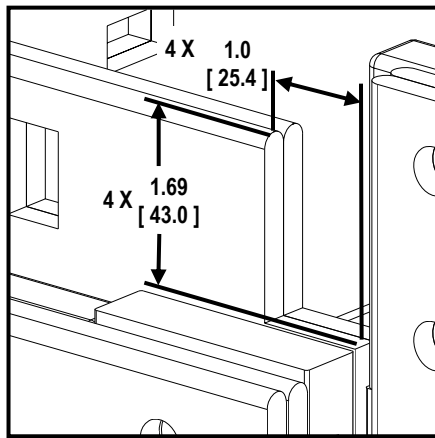


Supplied by Customer .25 X 5.0
[Proveído por el Cliente 6 X 127]

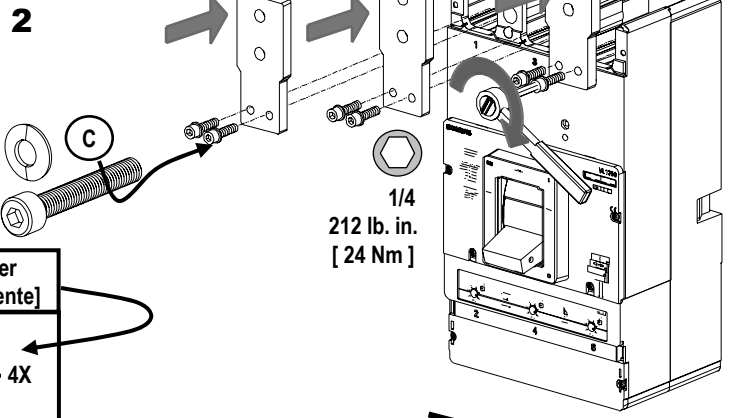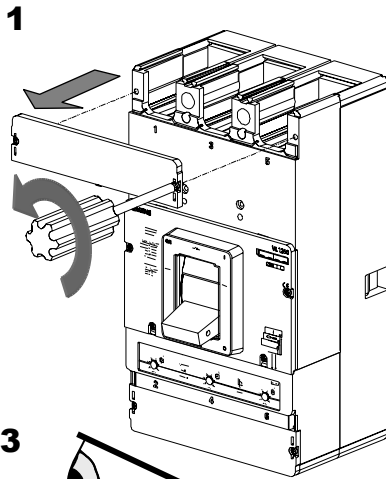

Supplied by Customer
[Proveído por el Cliente]

(A) 4X
GRADE 5 BOLT
[PERNO GRADO 5]

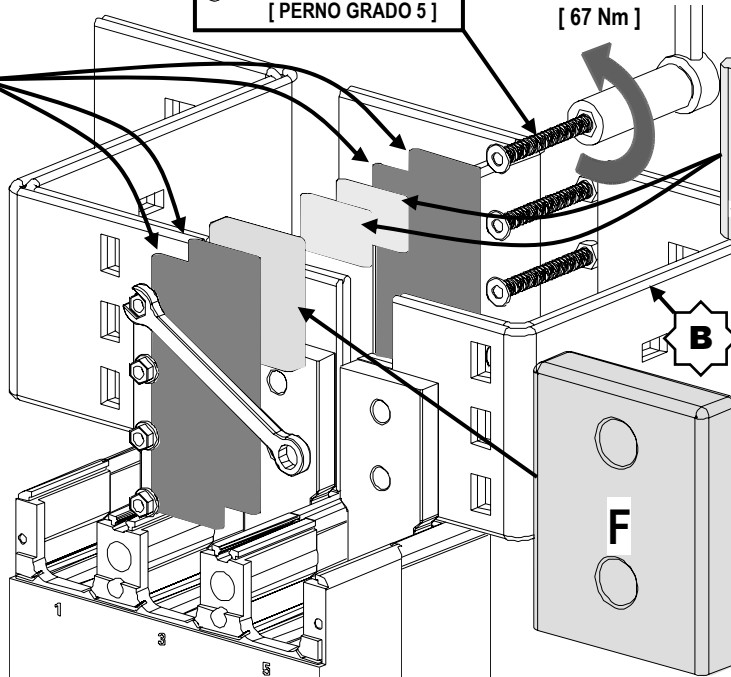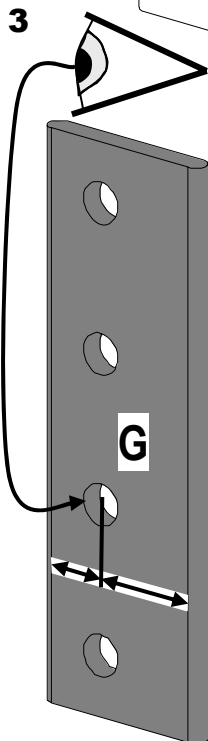

A	B	Supplied by Customer [Proveído por el Cliente]	
		.25 [6mm]	.25 X 5.0 [6 X 127]



Danger

Hazardous Voltage.

Will cause death or serious injury.

Turn off and lock out all power supplying this device before working on this device.

Replace all covers before power supplying this device is turned on.

Peligro

Tensión peligrosa.

Puede causar la muerte o lesiones graves.

Desenergice totalmente antes de instalar o darle servicio.

Reemplace todas las barreras y cubiertas antes de energizar el interruptor.

Danger

Tension dangereuse.


Danger de mort ou risque de blessures graves.

Couper l'alimentation de l'appareil et barrer avant de travailler.


Remplacez tous les couverts avant que l'alimentation de l'appareil soit alimentée.

4

Supplied by Customer .25 X 5.0
[Proveído por el Cliente 6 X 127]




Supplied by Customer
[Proveído por el Cliente]

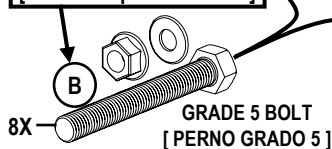


600 lb. in.
[67 Nm]

5

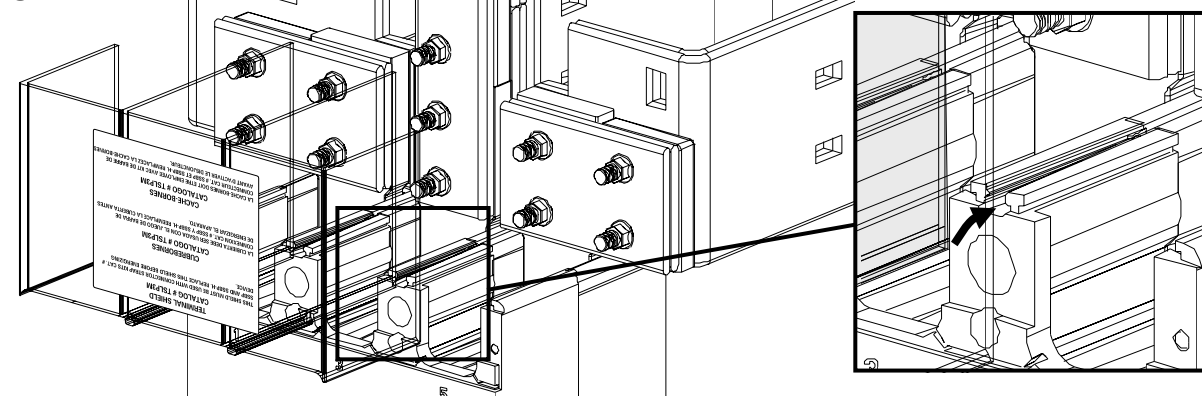

6

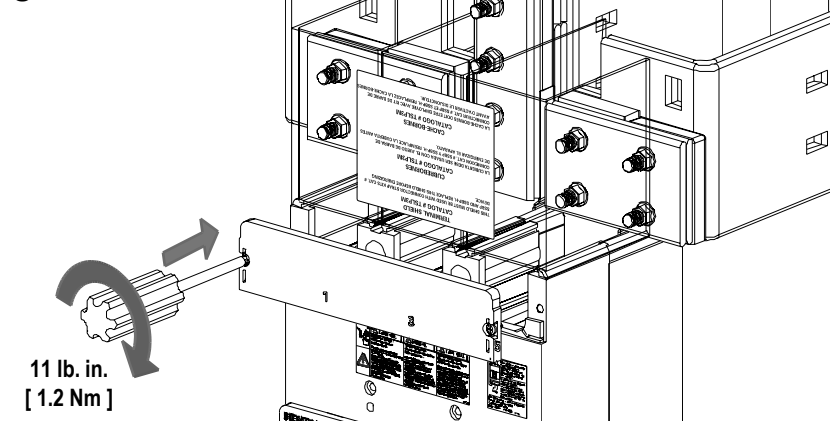

For Support in Europe refer to :

Bestell-Nr. / Order No.: 3ZX1012-0VL68-5AA2

Internet: www.siemens.de/lowvoltage/technical-assistance

GWA 4NEB 179 6872-10 DS 02

Technical Support:

Toll Free: 1-800-964-4114

Internet: www.sea.siemens.com

Subject to change without prior notice

Siemens Energy & Automation Inc. , Alpharetta, GA U.S.A.