


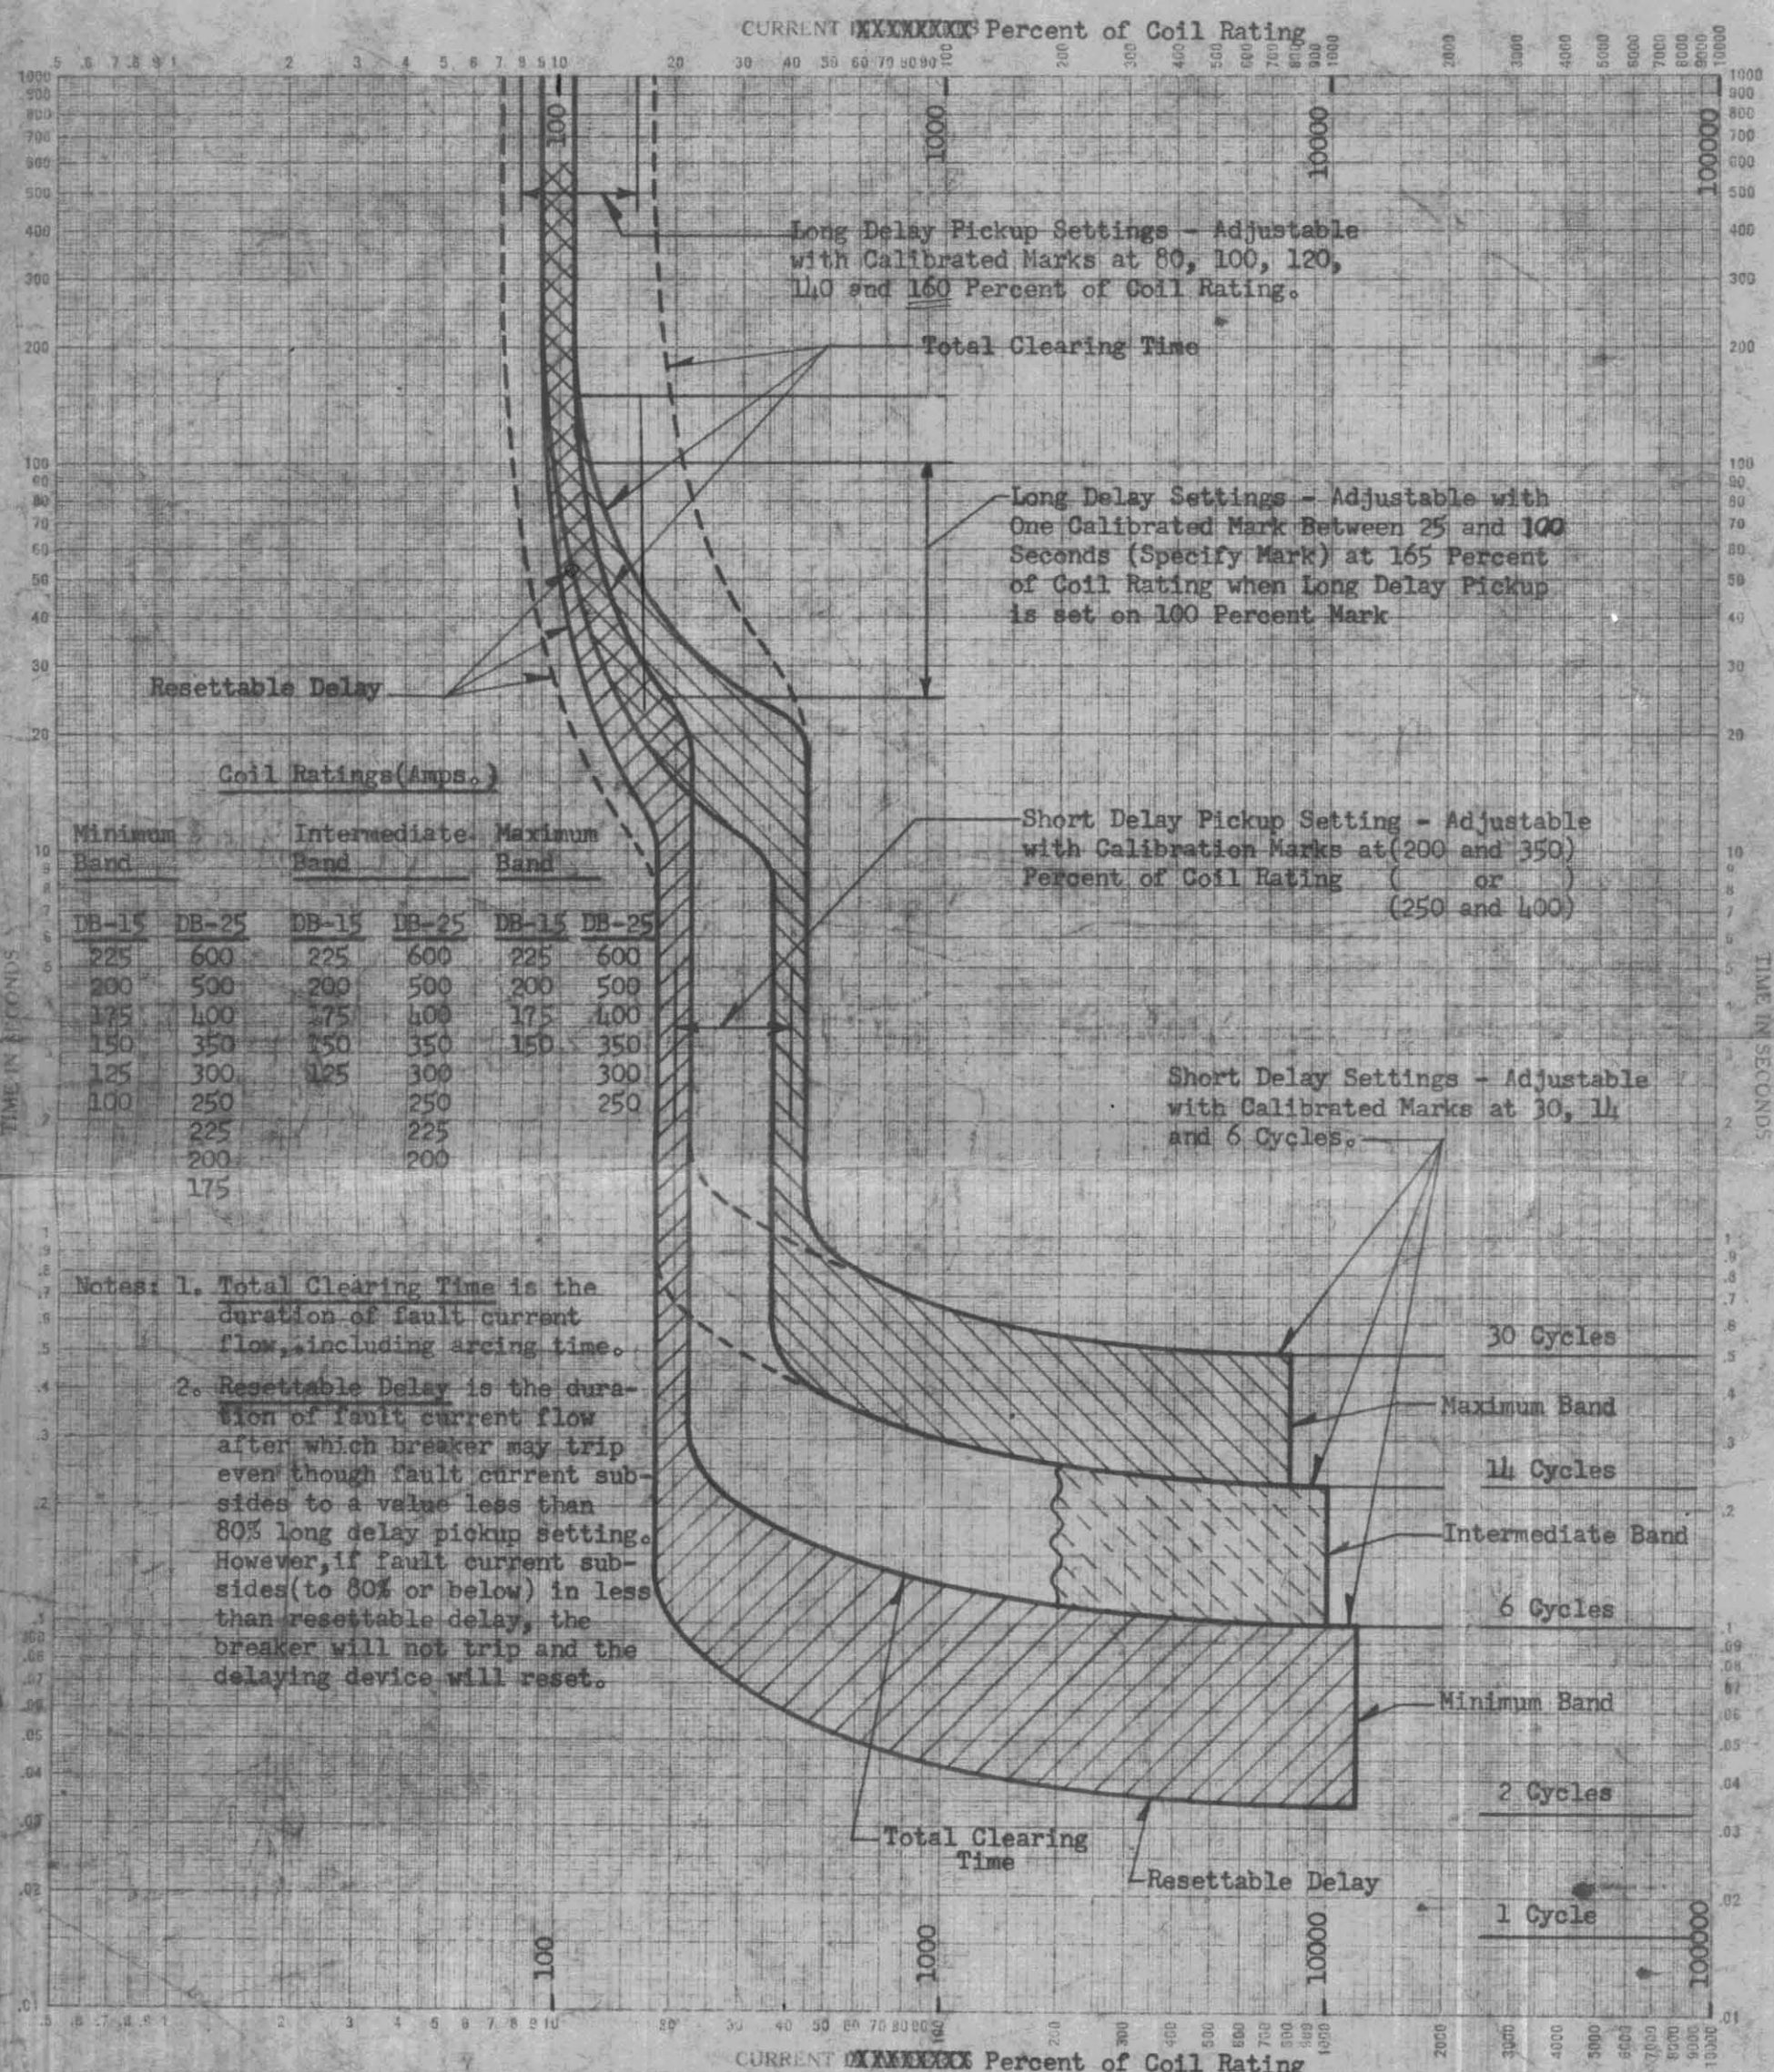

Coil Ratings (Amps.)

Minimum Band		Intermediate Band		Maximum Band	
DB-15	DB-25	DB-15	DB-25	DB-15	DB-25
225	600	225	600	225	600
200	500	200	500	200	500
175	400	175	400	175	400
150	350	150	350	150	350
125	300	125	300	125	300
100	250		250		250
	225		225		
	200		200		
	175				

Notes: 1. Total Clearing Time is the duration of fault current flow, including arcing time.

2. Resettable Delay is the duration of fault current flow after which breaker may trip even though fault current subsides to a value less than 80% long delay pickup setting. However, if fault current subsides (to 80% or below) in less than resettable delay, the breaker will not trip and the delaying device will reset.

**TRIPPING CHARACTERISTICS DB-15 & DB-25
DUAL SELECTIVE OVERCURRENT TRIPPING DEVICE
FOR GROUP OR TIE BREAKERS**

BASIS FOR DATA Standards

1. Tests made at _____ Volts a-c at _____ p.f. Starting at 25°C with no initial load

2. Curves are plotted to _____ Test points so variations should be _____

TIME-CURRENT CHARACTERISTIC CURVES
Fuse Links In

Westinghouse Elec. Corp.
East Pittsburgh, Pa.

No. ~~XXXXX~~ 351054
Date G.D. Gamel 3-23-56

LD 100 "was 150"
Gamel 10/24/63