


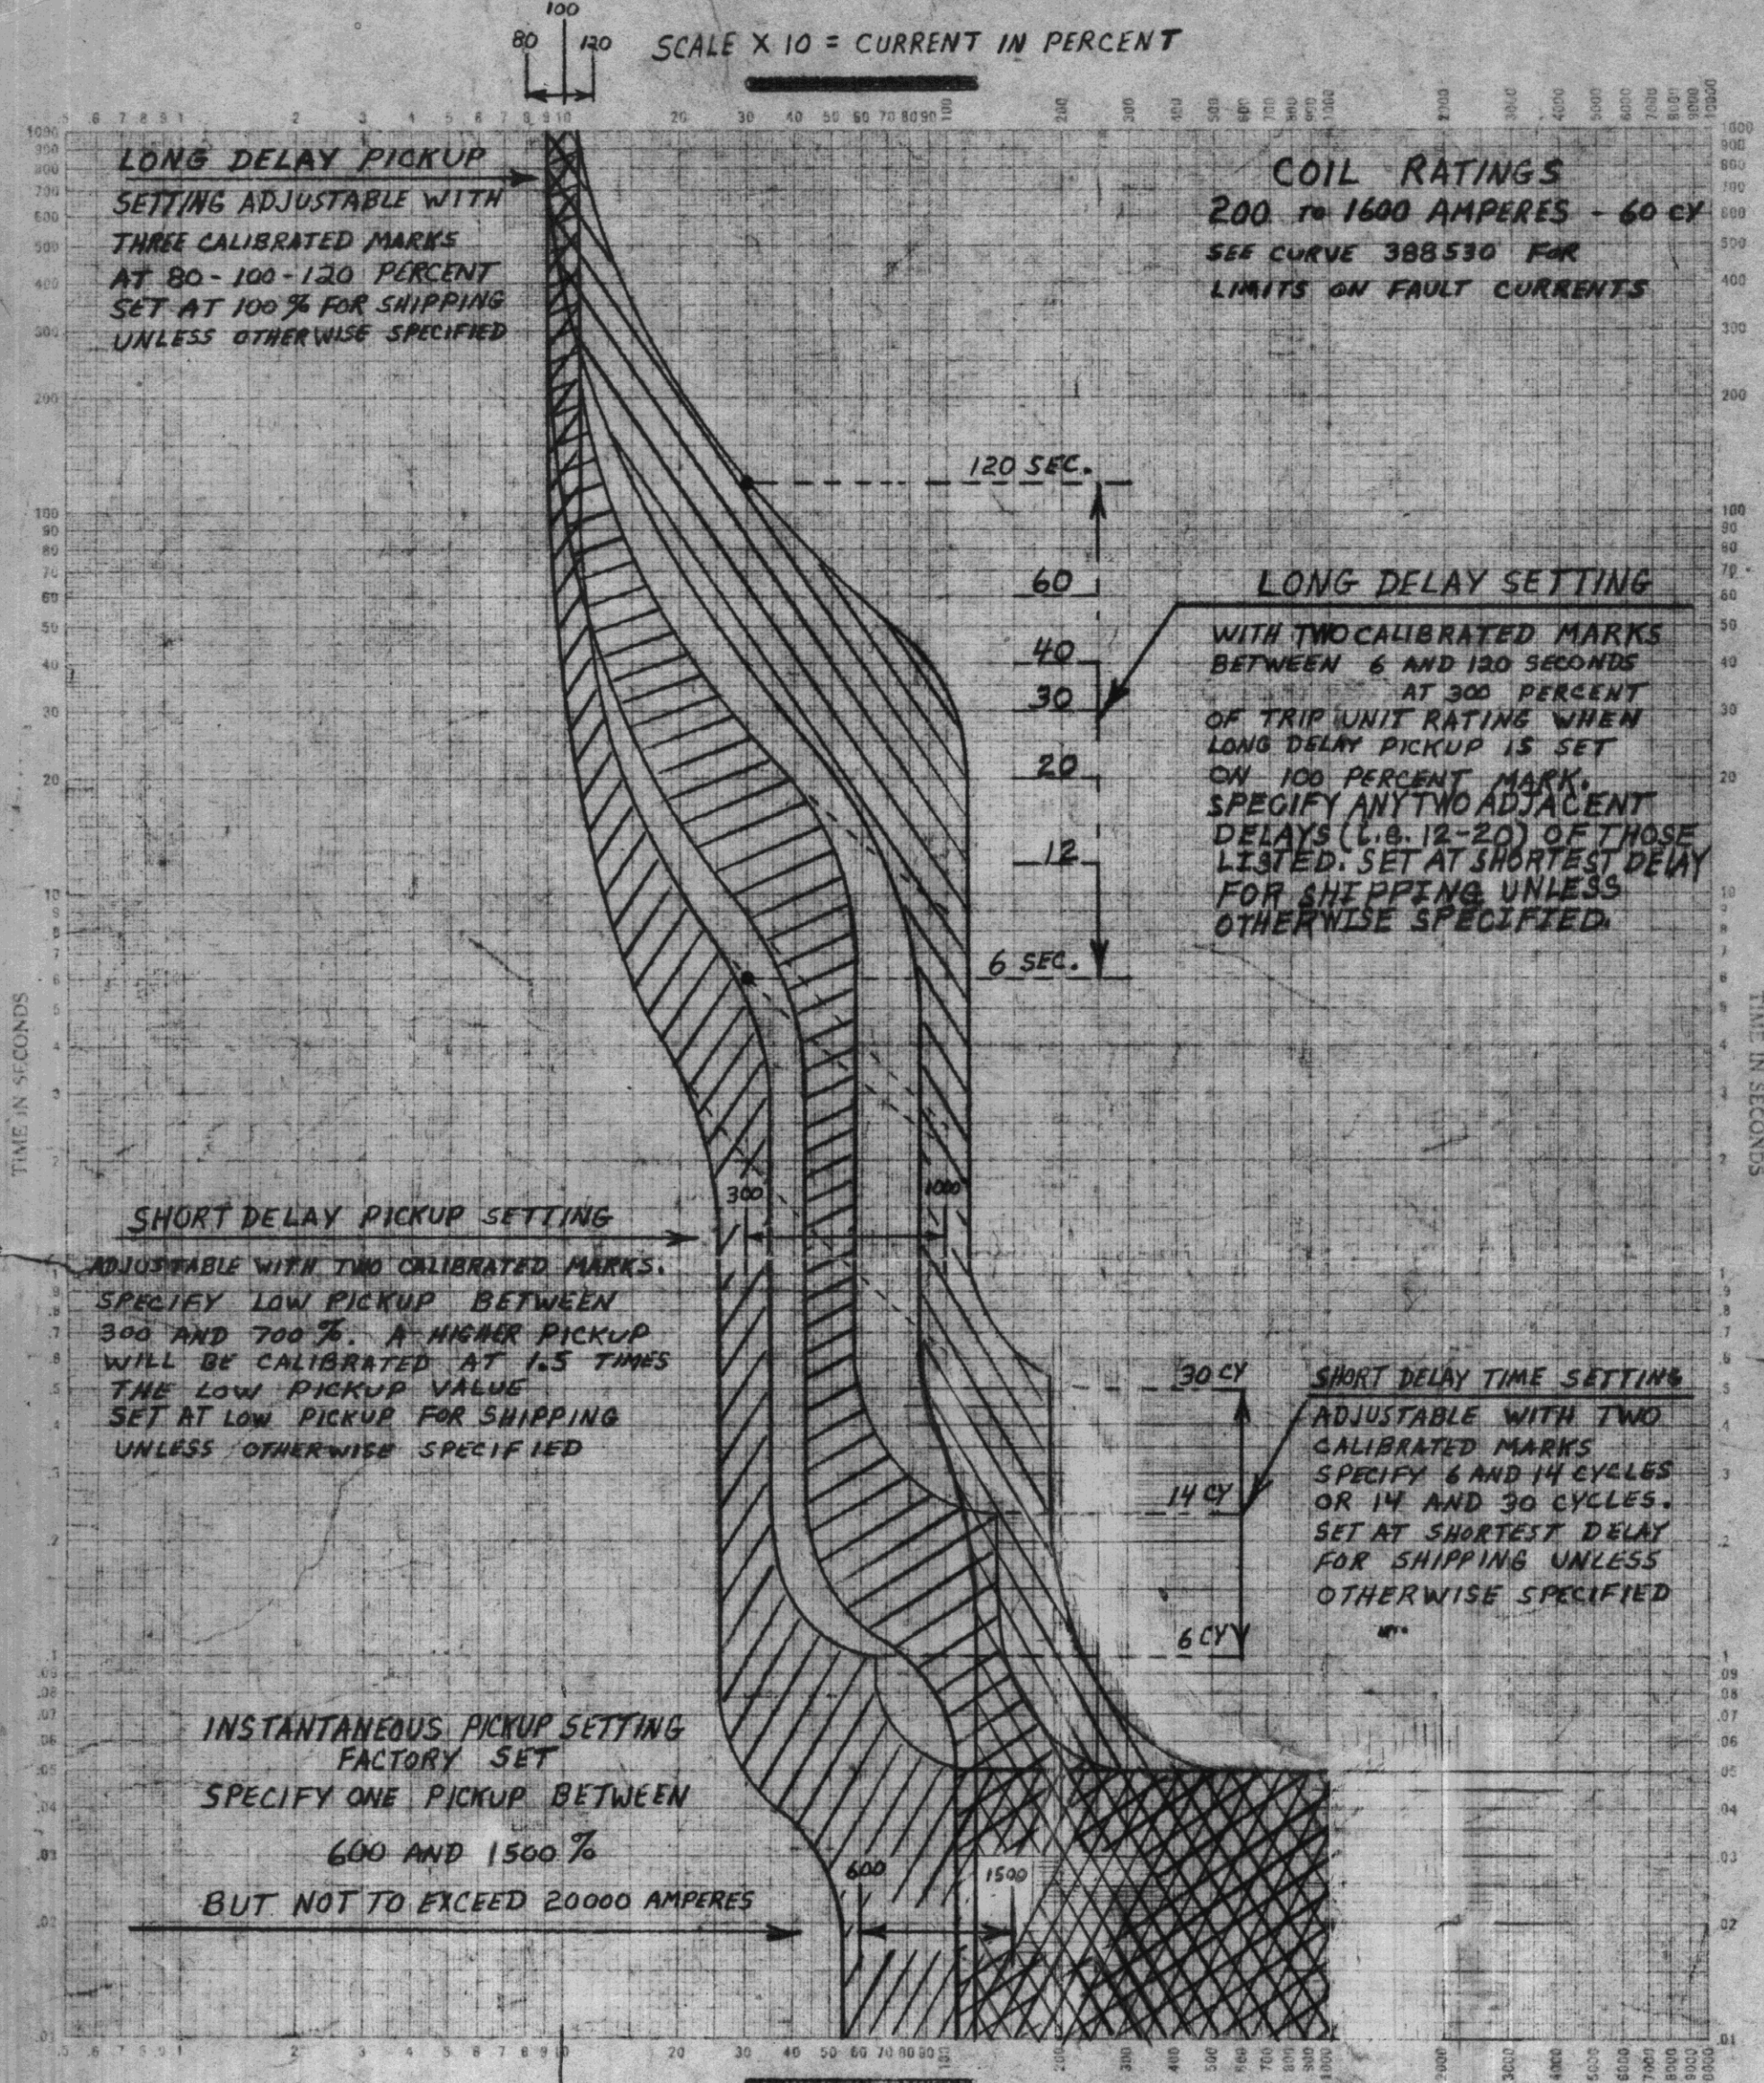

For **DB 50 LONG DELAY - SHORT DELAY - INSTANTANEOUS O.C.T.** TIME-CURRENT CHARACTERISTIC CURVES
 BASIS FOR DATA Standards Fuse Links. In **SUB. C**
 Dated _____
 1. Tests made at _____ Volts a-c at _____ p.f., Starting at 25C with no initial load
 2. Curves are plotted to _____ Test points so variations should be _____

No. **536912** ✓
 Date **JAN. 2, 1963**

WESTINGHOUSE ELECTRIC CORPORATION

TIME CURRENT CHARACTERISTIC 336E
 KEUFFEL & ESSER CO. MADE IN U.S.A.

INDEXED

2 L.P. SETTING
 MARK ONE CALIB.
 GANIEL
 EP15158
 MAX INST.
 PU WAS 2500%
 TAB 1-22-68

536912-8151513