
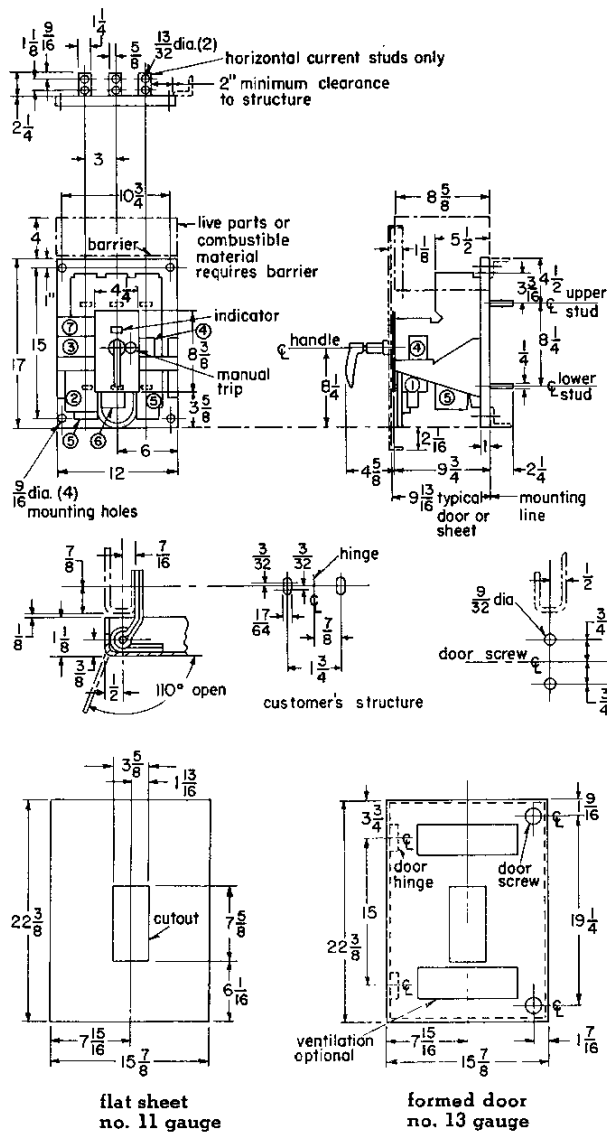


manually or electrically operated • 2 or 3 pole
15,000 to 100,000 amp interrupting capacity

standard electrically operated breakers

type DB-15

type DB-25

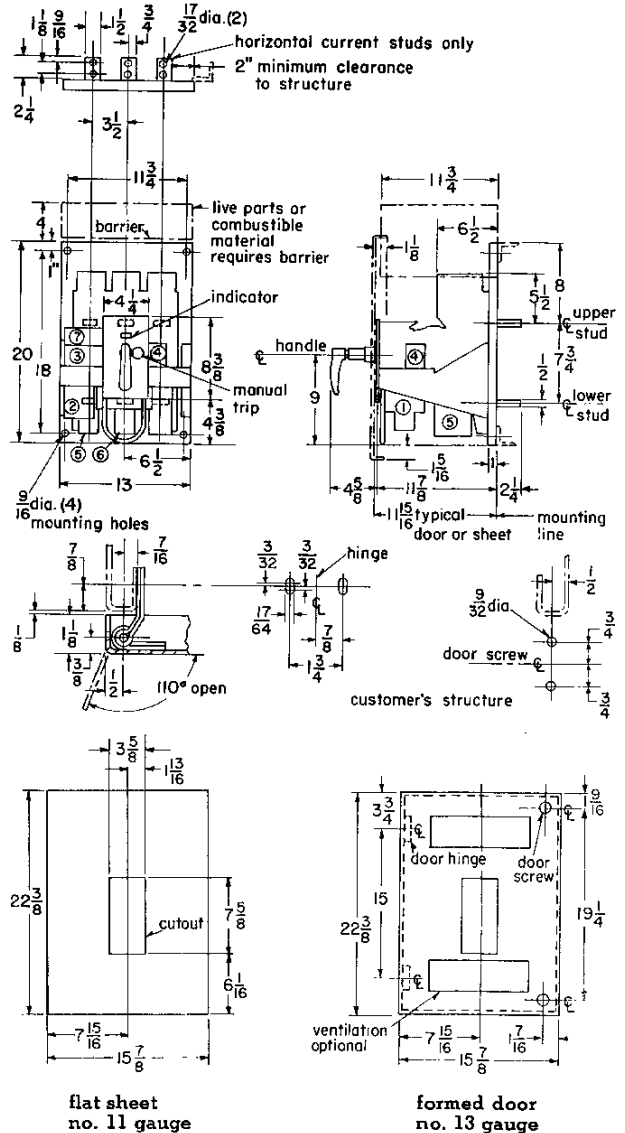

breaker includes:

- ① closing solenoid ⑤ overcurrent trip
② control relay ⑥ reverse current trip
③ auxiliary switch ⑦ terminal block
④ shunt trip

provision for padlocking breaker in tripped position





pole arrangement: three pole, as shown; two pole, center pole omitted
operating handle: electric close, manual trip

April, 1961

new information

mailed to: E/283/DS; D/812/DB; C/336/DB

type DB-50



Breaker includes:

- ① closing solenoid
- ② control relay
- ③ auxiliary switch
- ④ shunt trip

- ⑤ overcurrent trip
- ⑥ reverse current trip
- ⑦ terminal lock

provision for padlocking breaker in tripped position
pole arrangement: three pole, as shown; two pole, center pole omitted
operating handle: electric close, manual trip

DB De-ion circuit breakers
15-4000 amperes, a-c or d-c

dimension
 section


33-870

manually or electrically operated • 2 or 3 pole
 15,000 to 100,000 amp interrupting capacity




page 3

standard electrically operated breakers • continued


type DB-75

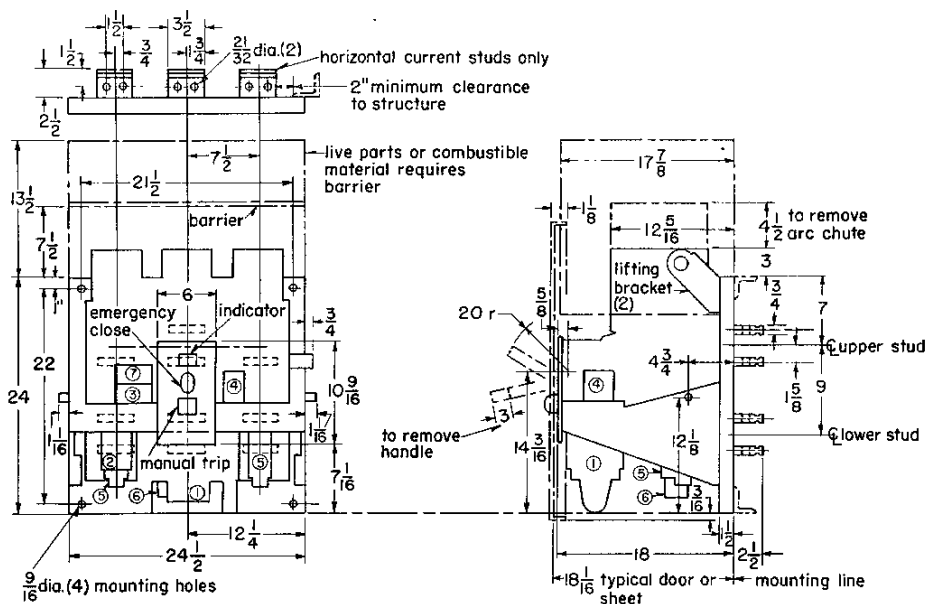

customer's structure

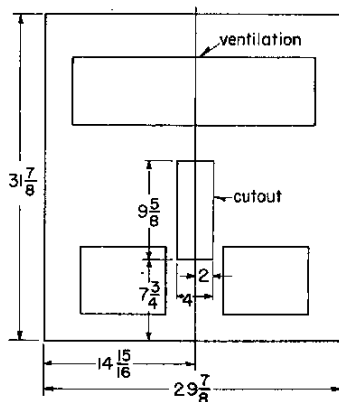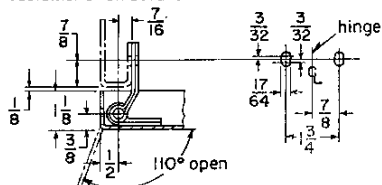

flat sheet no. 11 gauge

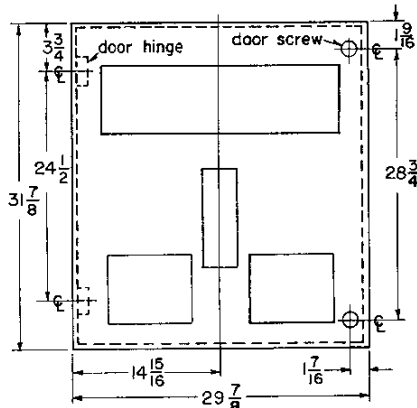

formed door no. 13 gauge

breaker includes:

- | | |
|--------------------|------------------------|
| ① closing solenoid | ⑤ overcurrent trip |
| ② control relay | ⑥ reverse current trip |
| ③ auxiliary switch | ⑦ terminal block |
| ④ shunt trip | |

provision for padlocking breaker in tripped position





pole arrangement: three pole, as shown; two pole, center pole omitted

operating handle: electric close, manual trip




standard electrically operated breakers • continued

type DB-100

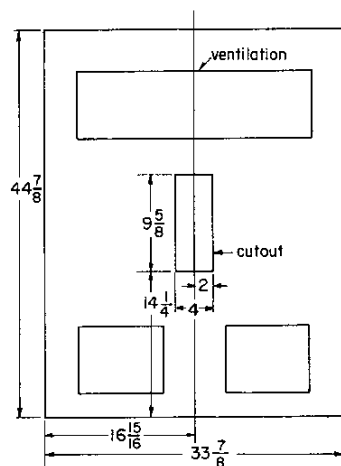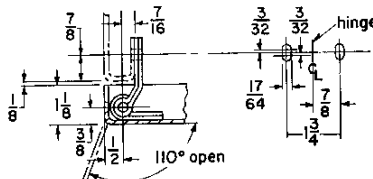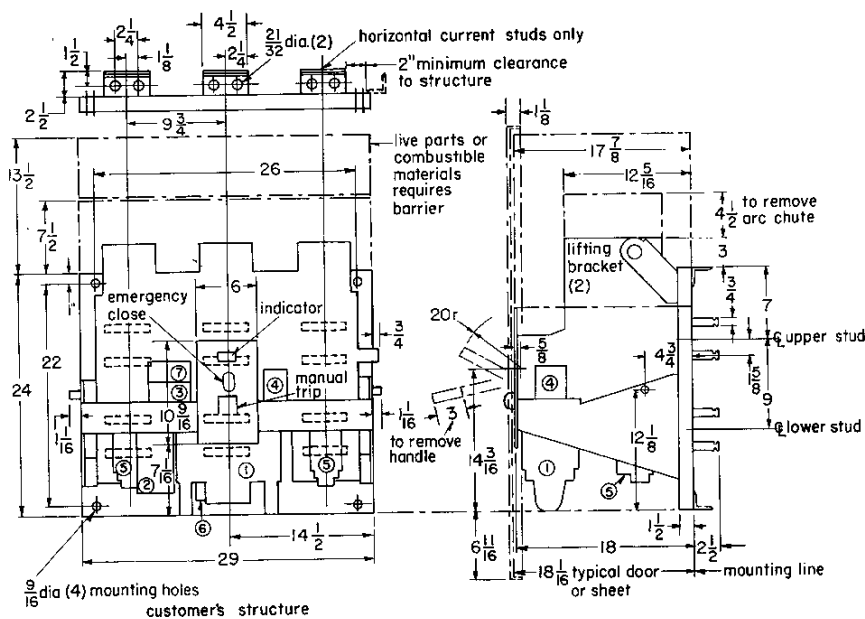

flat sheet no. 11 gauge

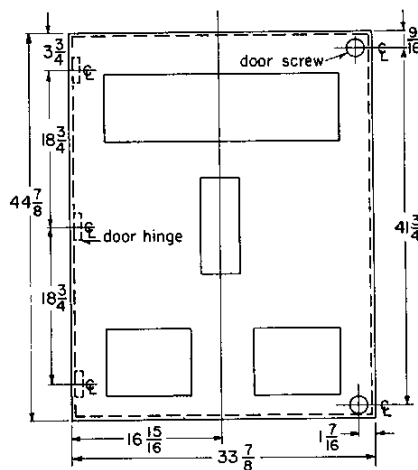

formed door no. 13 gauge

breaker includes:

- ① closing solenoid
- ② control relay
- ③ auxiliary switch
- ④ shunt trip
- ⑤ overcurrent trip
- ⑥ reverse current trip
- ⑦ terminal block

provision for padlocking breaker in tripped position

pole arrangement: three pole, as shown; two pole, center pole omitted

operating handle: electric close, manual trip

DB De-ion circuit breakers

15-4000 amperes, a-c or d-c

manually or electrically operated • 2 or 3 pole
15,000 to 100,000 amp interrupting capacity


dimension
section

33-870


page 5

standard individual, or stack-up unit for 3 position, drawout breakers

type DB-15

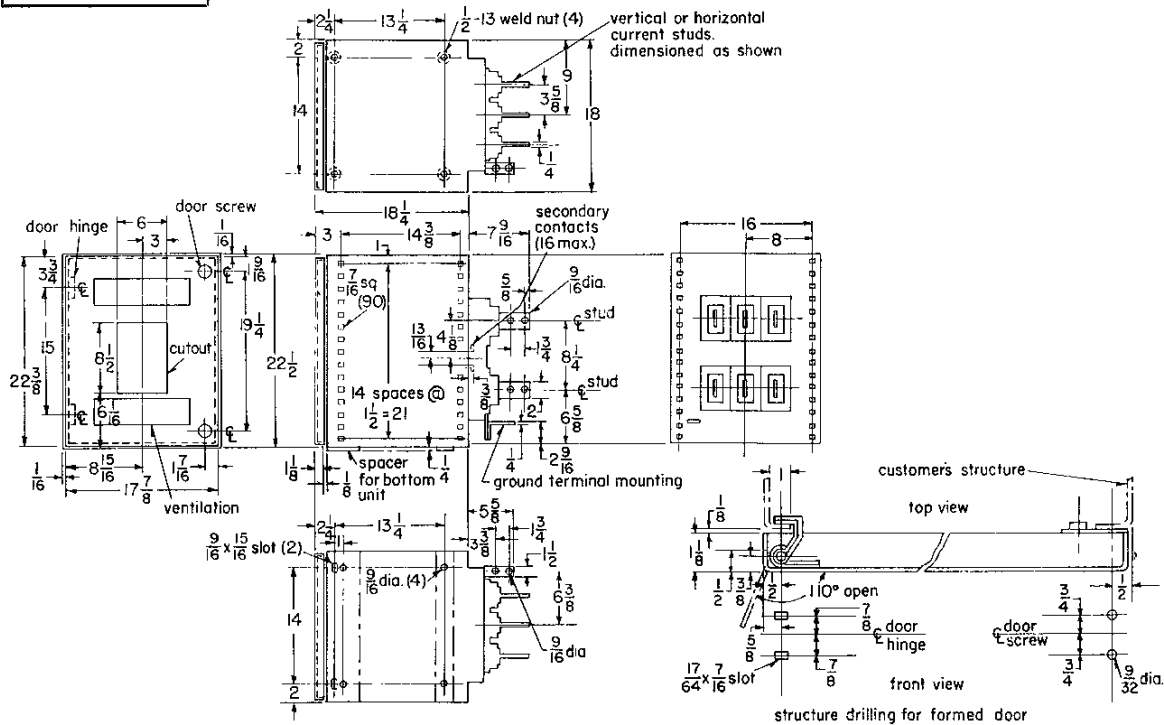


type DB-25

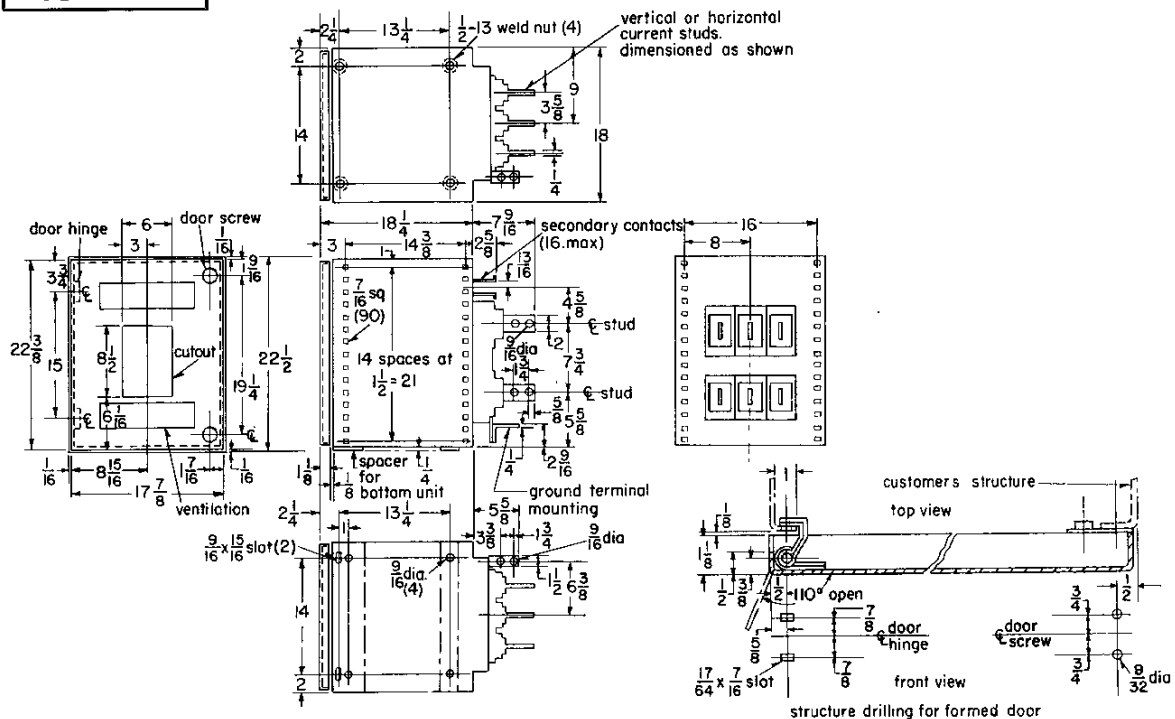



type DB-50

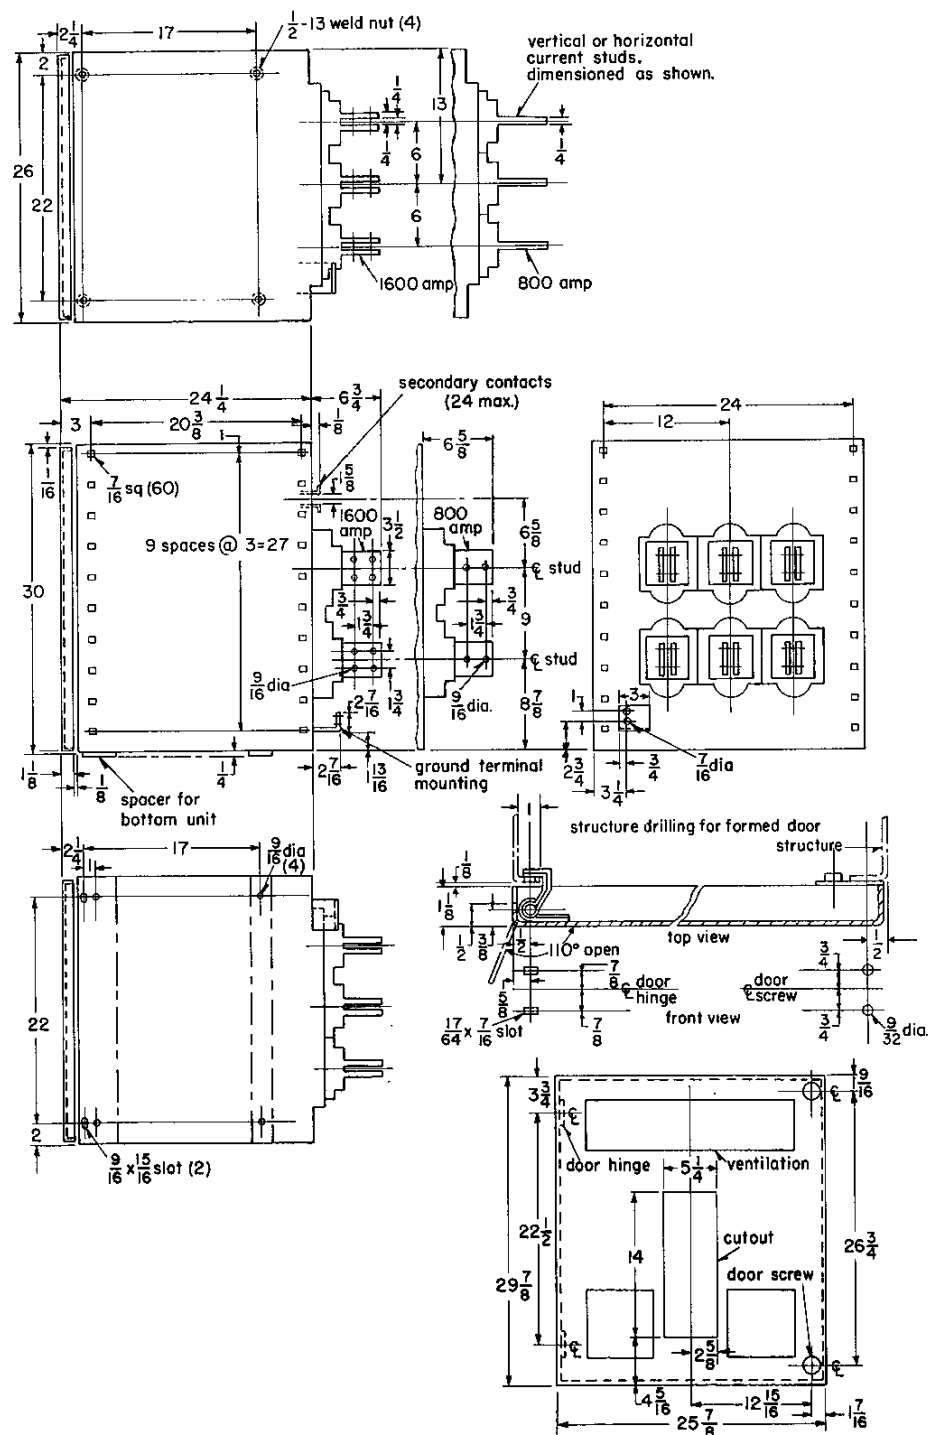


dimension
section

33-870

page 7

type DB-75

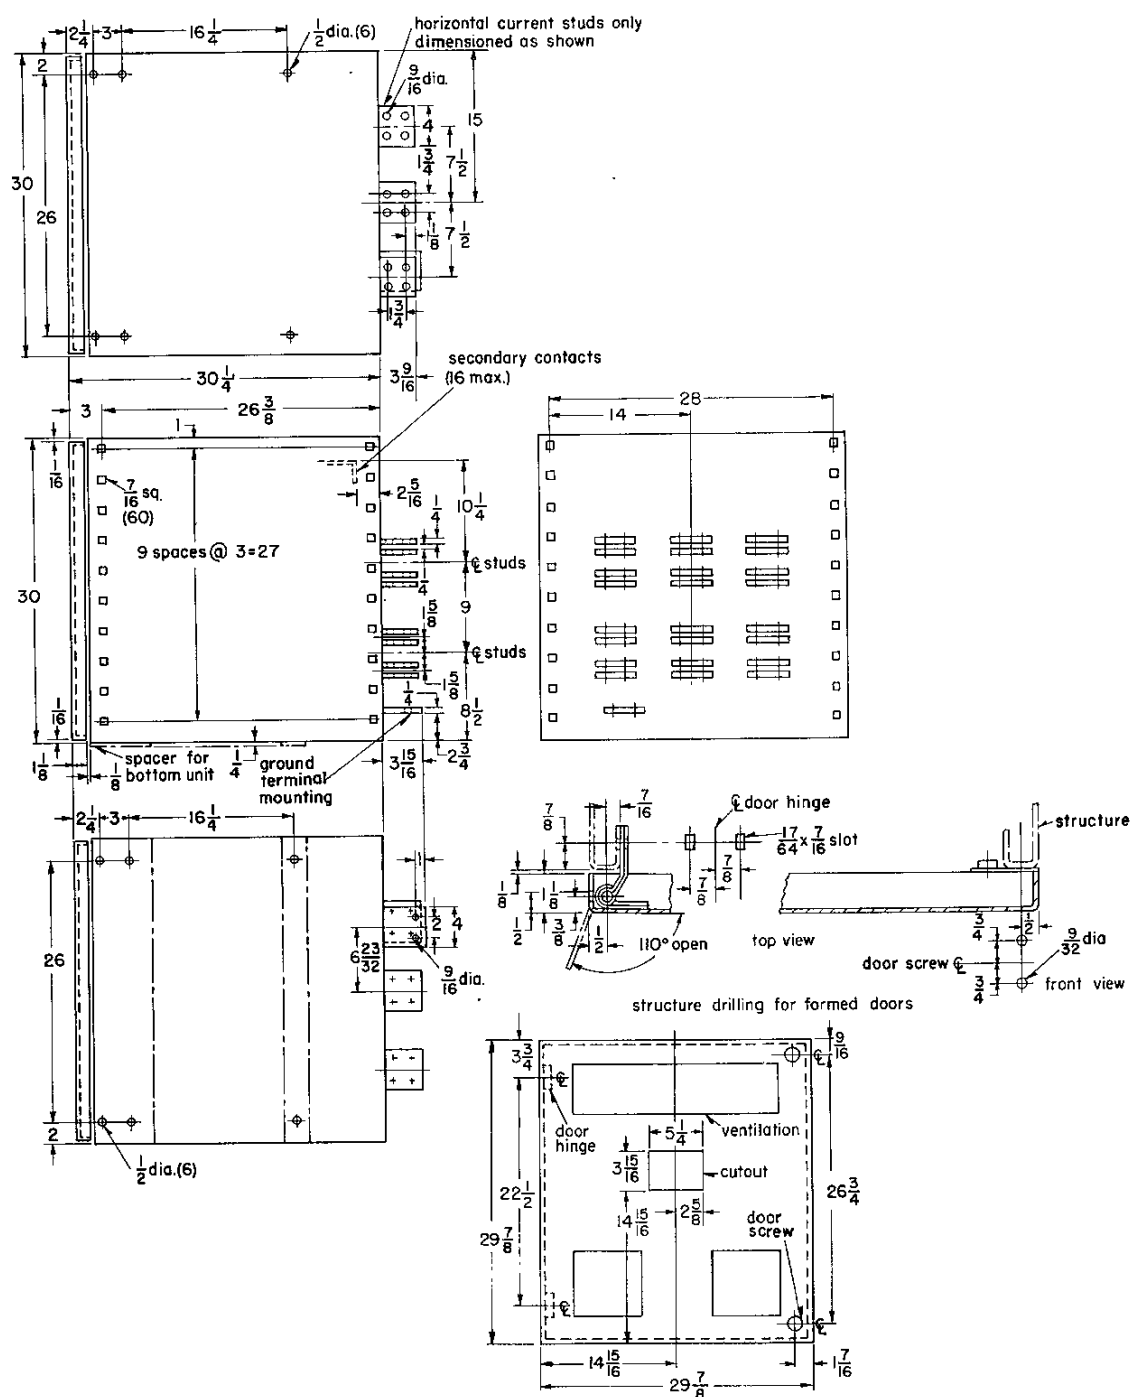




DB De-ion circuit breakers
15-4000 amperes, a-c or d-c

standard individual, or stack-up unit for 3 position, drawout breakers • continued

type DB-100

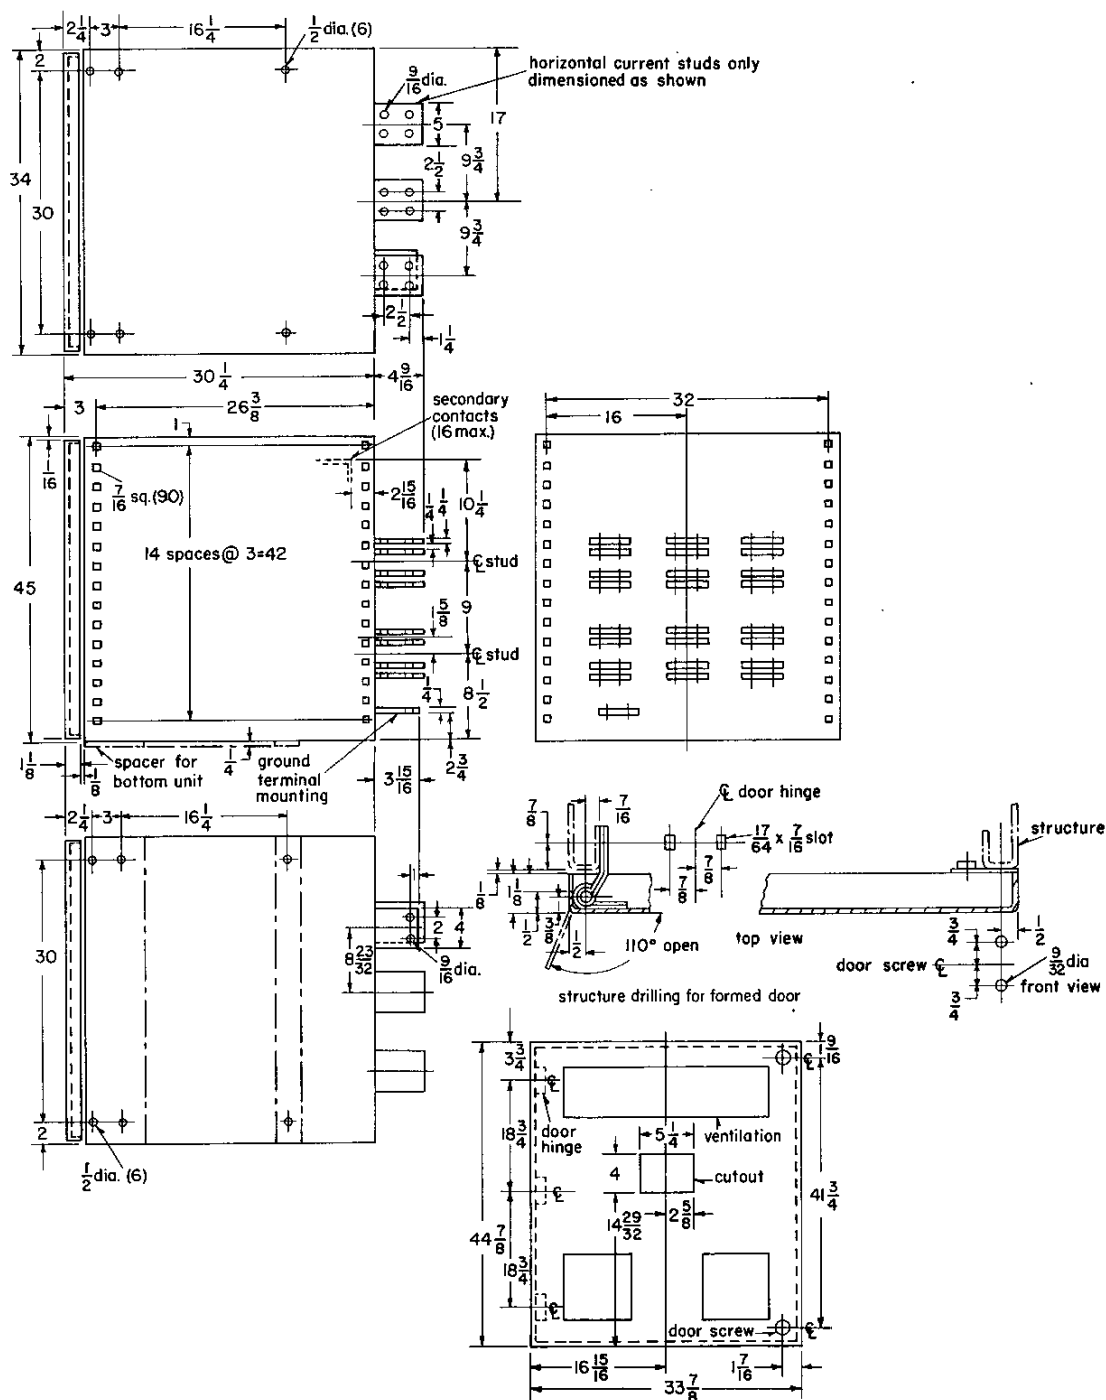

Westinghouse Electric Corporation

Assembled Switchgear and Devices Dept.: East Pittsburgh Divisions • East Pittsburgh, Pa.

printed in U.S.A.