


DECEMBER, 1949

WESTINGHOUSE INDUSTRIAL CONTROL

CLASSES 11-200-A3 & A6 "DE-ION" LINESTARTERS

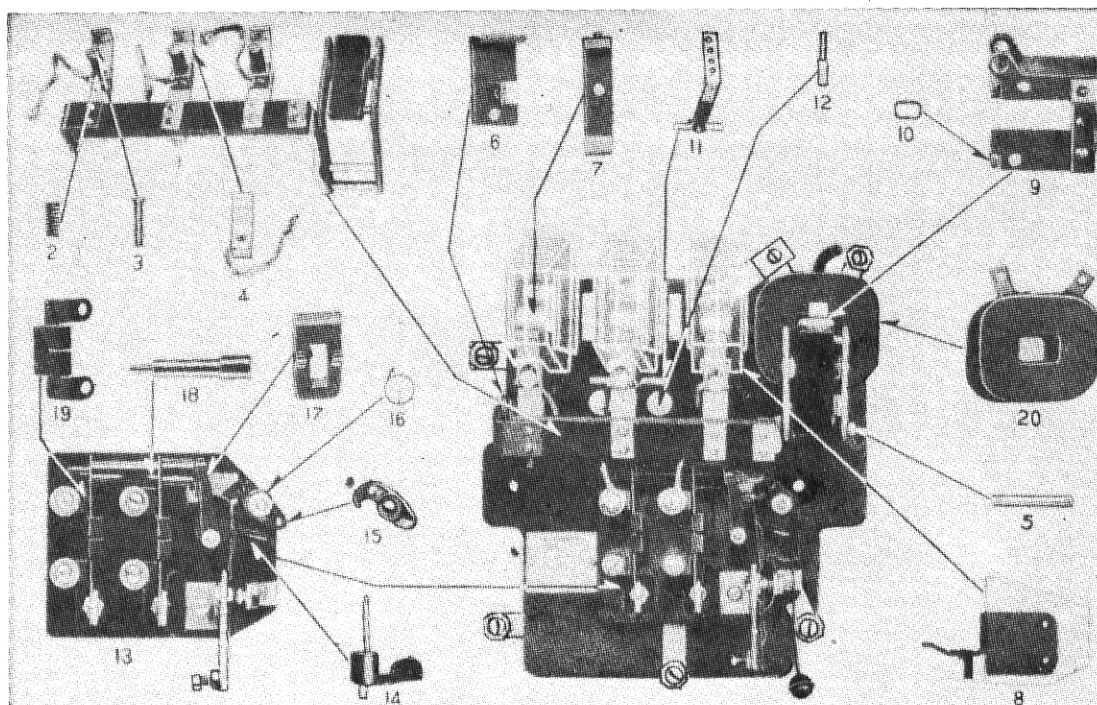

REF. No.	ØDescription of Part	Style No. of Part	No. PER LINE- STARTER	OPERATING COIL TABLE							
				CLASS 11-200-A-6		CLASS 11-200-A-3		Volts	Cycles	Operating Coil Style No.	
				COMPLETE STARTER STYLE No.							
				With Standard Cabinet Style No.	Without Cabinet Style No.	With Dust-Tite Cabinet Style No.					
1	Armature Complete.....	855863	1								
2	Moving Contact Spring.....	478769	3								
3	Moving Contact Spring Pin.....	486757	3								
4	Moving Contact with Shunt.....	807858	3								
5	Armature Shaft.....	662212	1								
6	Bearing Bracket.....	514331	1								
7 Δ	Stationary Contact.....	844132	3								
8 Δ	De-ion Arc Quencher.....	844131	3								
9	Mounting Spring.....	667531	3								
10	Rivet for Mounting Spring.....	667532	3								
11	Stationary Core.....	512795	1	594299	594310	674115	110	60	585570		
12	Shading Coil.....	204950	2	594300	594311	674116	220	60	585571		
13	Type L-33 Electric Interlock.....	507438	1	594301	594312	674117	440	60	585572		
14	Moving Contact.....	478761	1								
15	Spring.....	472204	1	676196			480	60	585581		
16	Stationary Contact.....	516544	2	594302	594313	674118	550	60	585573		
17	Type TA-2 Overload Relay.....	576184	1	594303		674119	600	60	585583		
18	Moving Contact.....	↑	1								
19	Stationary Contact and Holder.....	↑	1	594304		674120	110	50	585574		
20	Calibrating Lever.....	597584	1	594307		674123	550	50	585577		
1	Latch.....	597585	1	594308		674124	440	25	585578		
2	Latch Spring.....	597590	1								
3	Operating Lever.....	597586	1	594309		674125	550	25	585579		
4	Push Rod.....	597587	1	594305	594314	674121	110/220	25-50	585575		
5	Heater for Relay.....	↑	2	594306	594315	674122	220/440	25-50	585576		
6	Operating Coil for Contactor.....	See Table	1								

* Not listed on illustration.

Δ Parts indented are included in the part under which they are indented.

† When ordering Heaters, specify style number obtained from table of Heater ratings.

‡ When Moving Contact, Stationary Contact and Holder or Thermal Strips must be renewed, the complete Relay should be sent to our works or nearest service shop, as accurate recalibration is necessary when any change in contacts is made. These contacts and thermal strips may be renewed by the customer, but at the risk of a possible change in relay calibration.

Δ S#844132 and S#844131 supersede S#575168 and S#667533 respectively. When renewing either the Arc Box or Stationary Contact for the first time both the improved type De-ion Arc Box S#844131 and Stationary Contact S#844132 must be ordered.

ORDERING INSTRUCTIONS

Name the part and give its style number. Give the complete name plate reading. State whether shipment is desired by express, freight or by parcel post. Send all orders or correspondence to nearest sales office of the company. Small orders should be combined so as to amount to a value of at least \$1.00 net. Where the total of the sale is less than this, the material will be invoiced at \$1.00.

E-41-6E
D-61-6E
C-21-6X

WESTINGHOUSE ELECTRIC CORPORATION

BUFFALO PLANT

BUFFALO, N. Y.