

SQUARE D COMPANY SMYRNA, TN		ENGINEERING STANDARD				A46011- 014	
SUBJECT		15KV FVBA BREAKER ADJUSTMENTS				PAGE 1 OF 8	
These instructions define the adjustments to be made on 15KV FVB breakers at final assembly, after the breaker has been cycled 50 close-open cycles. Adjustments should be made in the following sequence. Some steps may have to be repeated to obtain correct settings. 1. <u>OPEN PLUNGER FREE PLAY</u> (SEE FIGURE 1) Open plunger free play is the gap between the opening plunger and the trip arm roller. With the breaker open and the drive springs charged, set open plunger free play to 1/8" + 1/32" -0. To adjust, rotate the eccentric stop. This setting effects both mechanical trip sensitivity and minimum tripping voltage, and may require readjustment during the electrical operations test to meet minimum tripping voltage requirements. (Over adjustment may allow sufficient open plunger free play; however there is a possibility of the trip cam becoming overly sensitive and causing nuisance tripping). 2. <u>LATCH CHECK SWITCH</u> (SEE FIGURE 2) The latch check switches prevents the closing solenoid from operating unless the trip cam is in the normal operating position. With the trip cam in the normal operating position, set the clearance between the latch check pushrod and the contact block to 1/32" + 1/32" - 0. To confirm proper operation, lift the trip lever and apply an electrical close command. The breaker should not close. While maintaining an electrical close command, release the trip lever. The breaker should close. 3. <u>TOGGLE BEARING CLEARANCE</u> (SEE FIGURE 3) With the breaker in the open position and the drive springs charged, set the clearance between the toggle bearing and the opening cam to 1/32" + 1/32" - 0". If necessary adjust by rotating the toggle sub-assembly retainer nut. 4. <u>BIAS SPRING OVERTRAVEL ADJUSTMENT</u> (SEE FIGURE 4) With the breaker closed and the drive springs fully charged, set the bias spring overtravel to 3/16" ± 1/32". The bias spring overtravel is adjusted by means of the 1/2 - 13 nuts on the top of the pushrods. 5. <u>PRIMARY CONTACT GAP</u> (SEE FIGURE 5) Set the primary contact gap to .400" ± .03" inches with the breaker in the open position. Primary contact gap is the difference of the measurements between the front interrupter support and the bottle flex block with the breaker in the closed and open positions. Adjustment is performed by loosening the 5/8" hex nut at the top of each return spring shaft, and rotating the return spring stops evenly; clockwise to decrease primary contact gap and counter clockwise to increase primary contact gap. Tighten the 5/8" hex nuts after adjustment. Adjustment is made with the breaker in the closed position. Do <u>not</u> put fingers under return spring stops.							
A	51636 11/16/93	DLD					PREPARED BY DATE APPROVED
							DYKES 9/2/92

SQUARE D COMPANY SMYRNA, TN			ENGINEERING STANDARD					A46011-014			
SUBJECT			15KV FVBA BREAKER ADJUSTMENTS					PAGE 2 OF 5			
6. <u>AUXILIARY SWITCH LINKAGE</u> (SEE FIGURE 6) Set the auxiliary switch linkage such that the travel from an imaginary horizontal centerline through the auxiliary switch shaft is equal in both the open and closed positions of the breaker. Adjustment is performed by loosening the locknuts on the linkage and rotating the linkage shaft to obtain the desired travel. Tighten the locknuts after adjustment. Both the lower and the upper auxiliary switch, when it is called for, are adjusted the same way. 7. <u>SHOCK ABSORBER SETTING</u> The FVBA circuit breaker incorporates an adjustable oraficed hydraulic shock absorber. The shock absorber is required to dissipate some operating mechanism energy before the mechanical stops impact during the opening operation. Dissipating this energy helps control the vacuum interrupter total travel. The correct preliminary setting is #2.											
A	51636 11/18/93	DLD							PREPARED BY	DATE	APPROVED
									DYKES	9/2/92	

SQUARE D COMPANY SMYRNA, TN		ENGINEERING STANDARD				A 46011-014	
SUBJECT 15KV FVBA BREAKER ADJUSTMENTS		PAGE 3 OF 8					

ADJUSTING ECCENTRIC

TRIP SHAFT


$+ \frac{1}{32}$
 $\frac{1}{8} - 0$
FREE TRAVEL

TRIP SOLENOID

FIGURE 1

SETTING OPEN
PLUNGER FREE
PLAY

A	11/15/93	DLD							PREPARED		APPROVED
									BY	DATE	
									DLD	9/8/92	

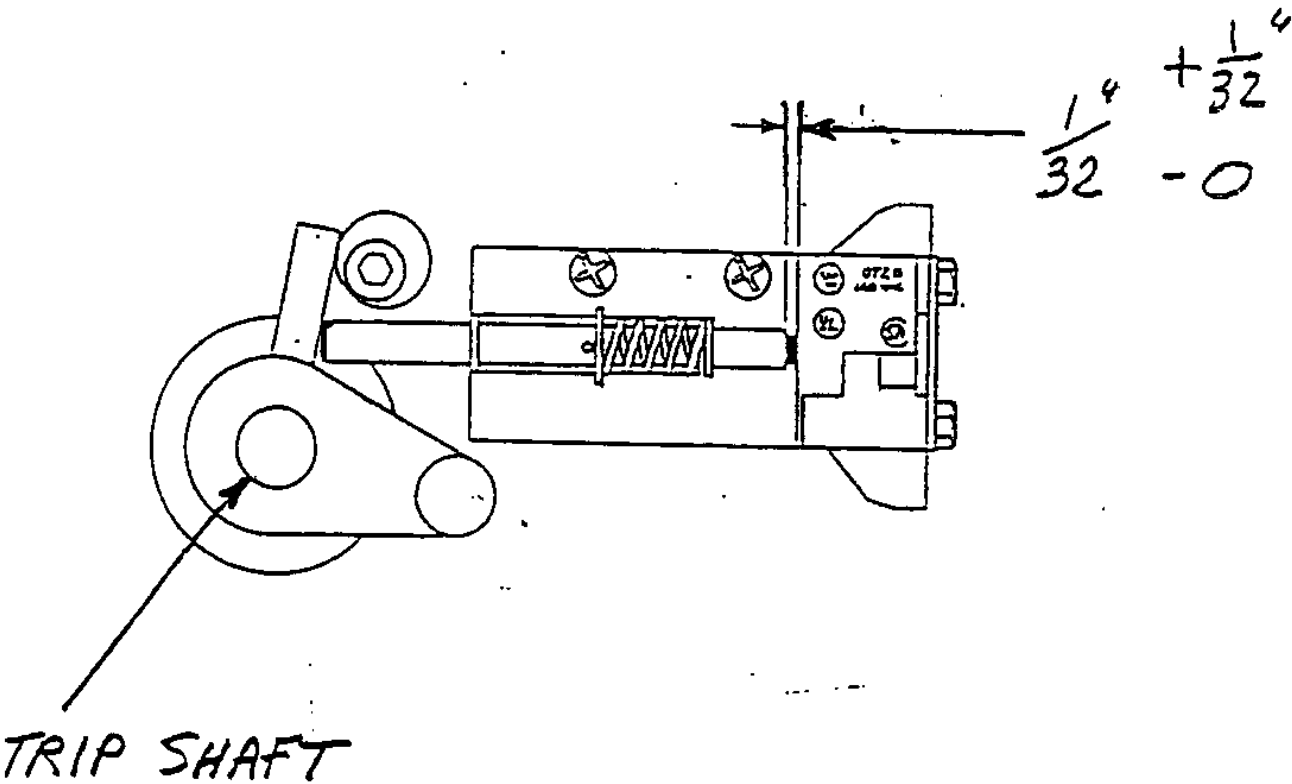


MAKE SETTING WITH
 BREAKER OPEN,
 CLOSING SPRINGS CHARGED

FIGURE 2
 SETTING LATCH
 CHECK SWITCH
 PLUNGER HEIGHT

A	5/6/96 11/18/93	DLD							PREPARED		APPROVED
									BY	DATE	
									DLD	9/8/92	


SQUARE D COMPANY SMYRNA, TN		ENGINEERING STANDARD	A46011-014
SUBJECT 15KV FVBA BRKR ADJUSTMENTS		PAGE 5 OF 8	

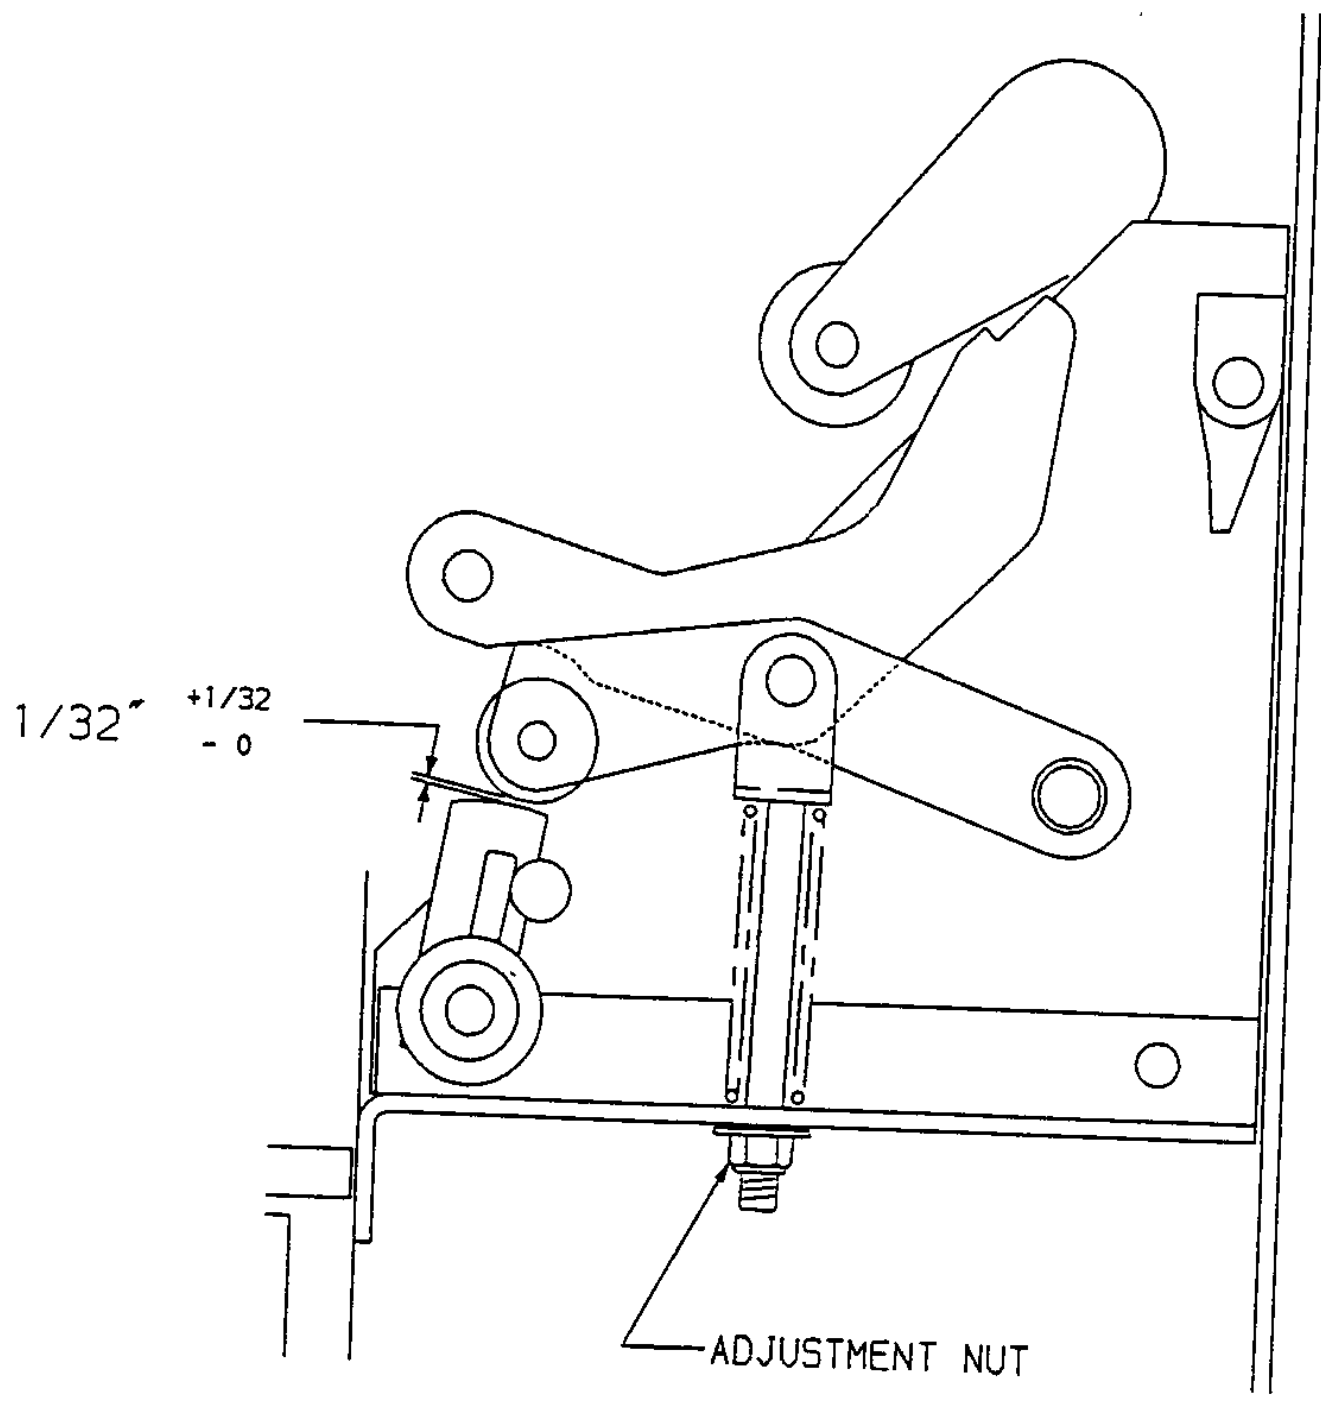

MAKE SETTING WITH
 BREAKER OPEN,
 CLOSING SPRINGS
 CHARGED

FIGURE 3
 SETTING TOGGLE
 BEARING CLEARANCE


A	5/1656 11/13/93	DLD							PREPARED		APPROVED
									BY	DATE	
									DLD	3/8/92	

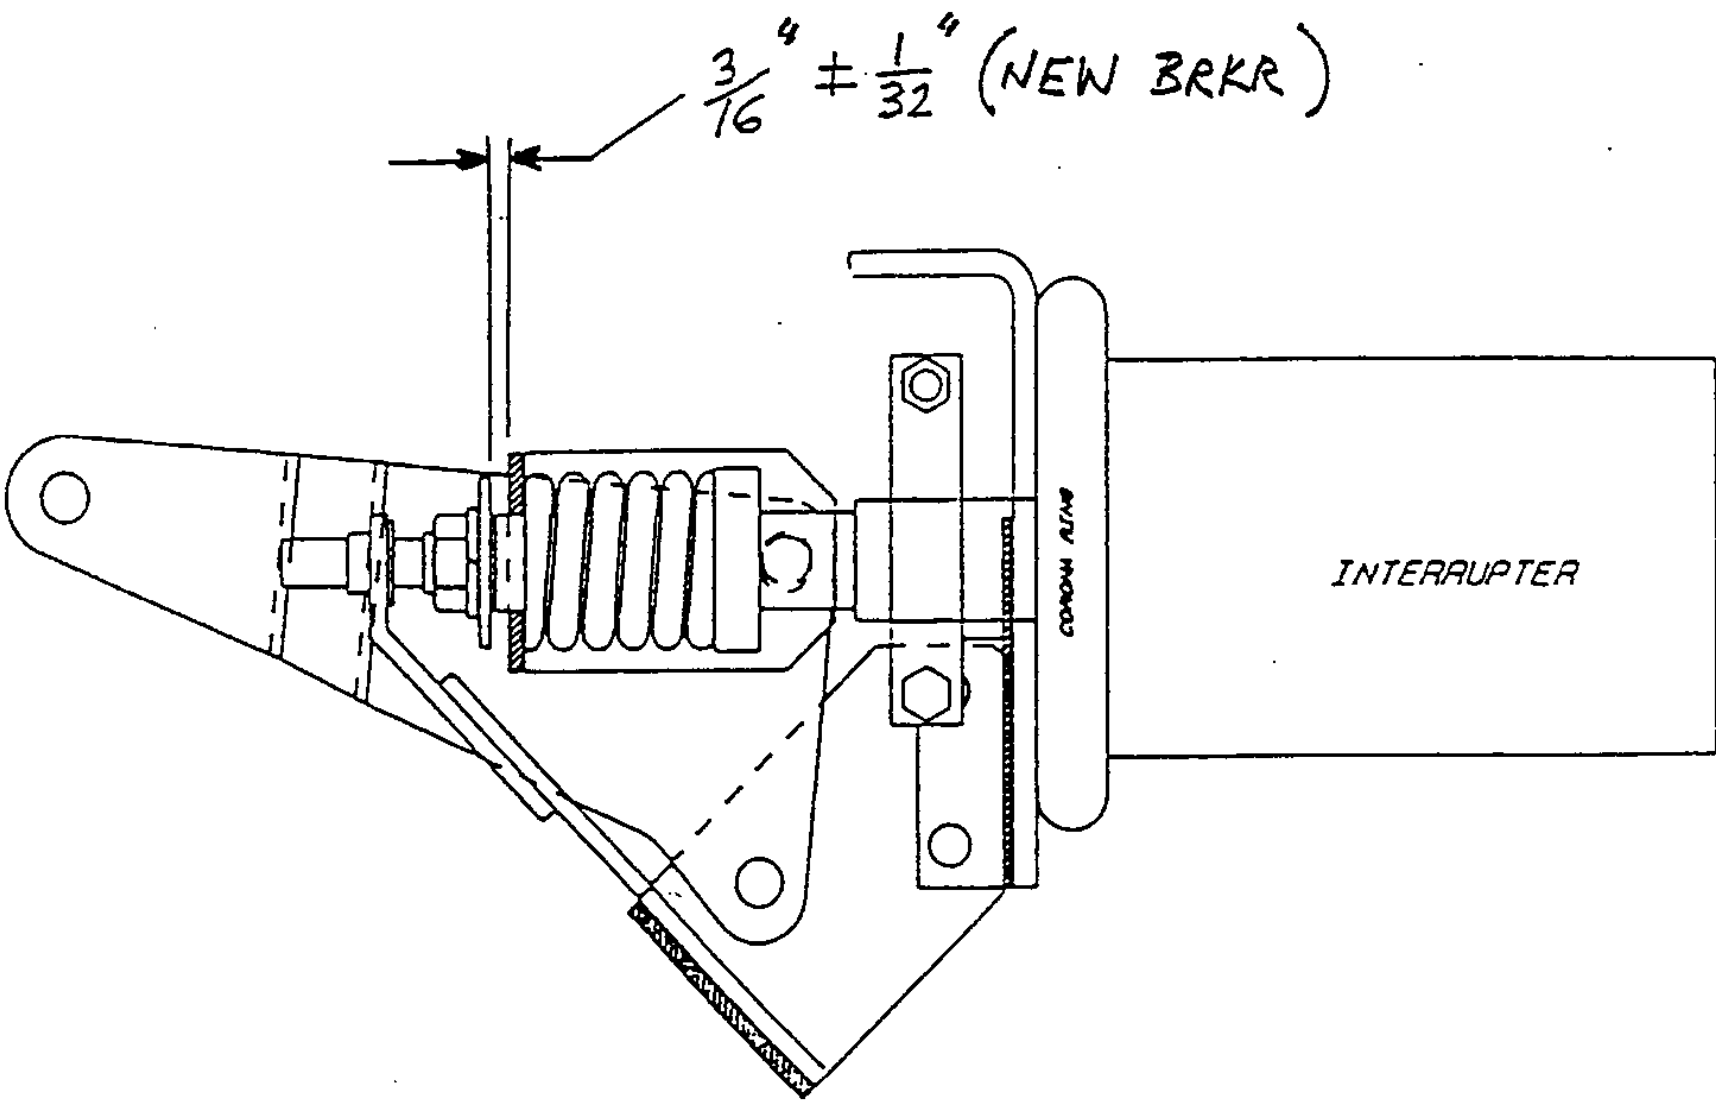

MAKE SETTING WITH
 BREAKER CLOSED,
 CLOSING SPRINGS
 CHARGED

FIGURE 4
 SETTING BIAS
 SPRING OVERTRAVEL
 ADJUSTMENT

A	11/18/93	DL D							PREPARED		APPROVED
									BY	DATE	
									DL D	9/8/92	

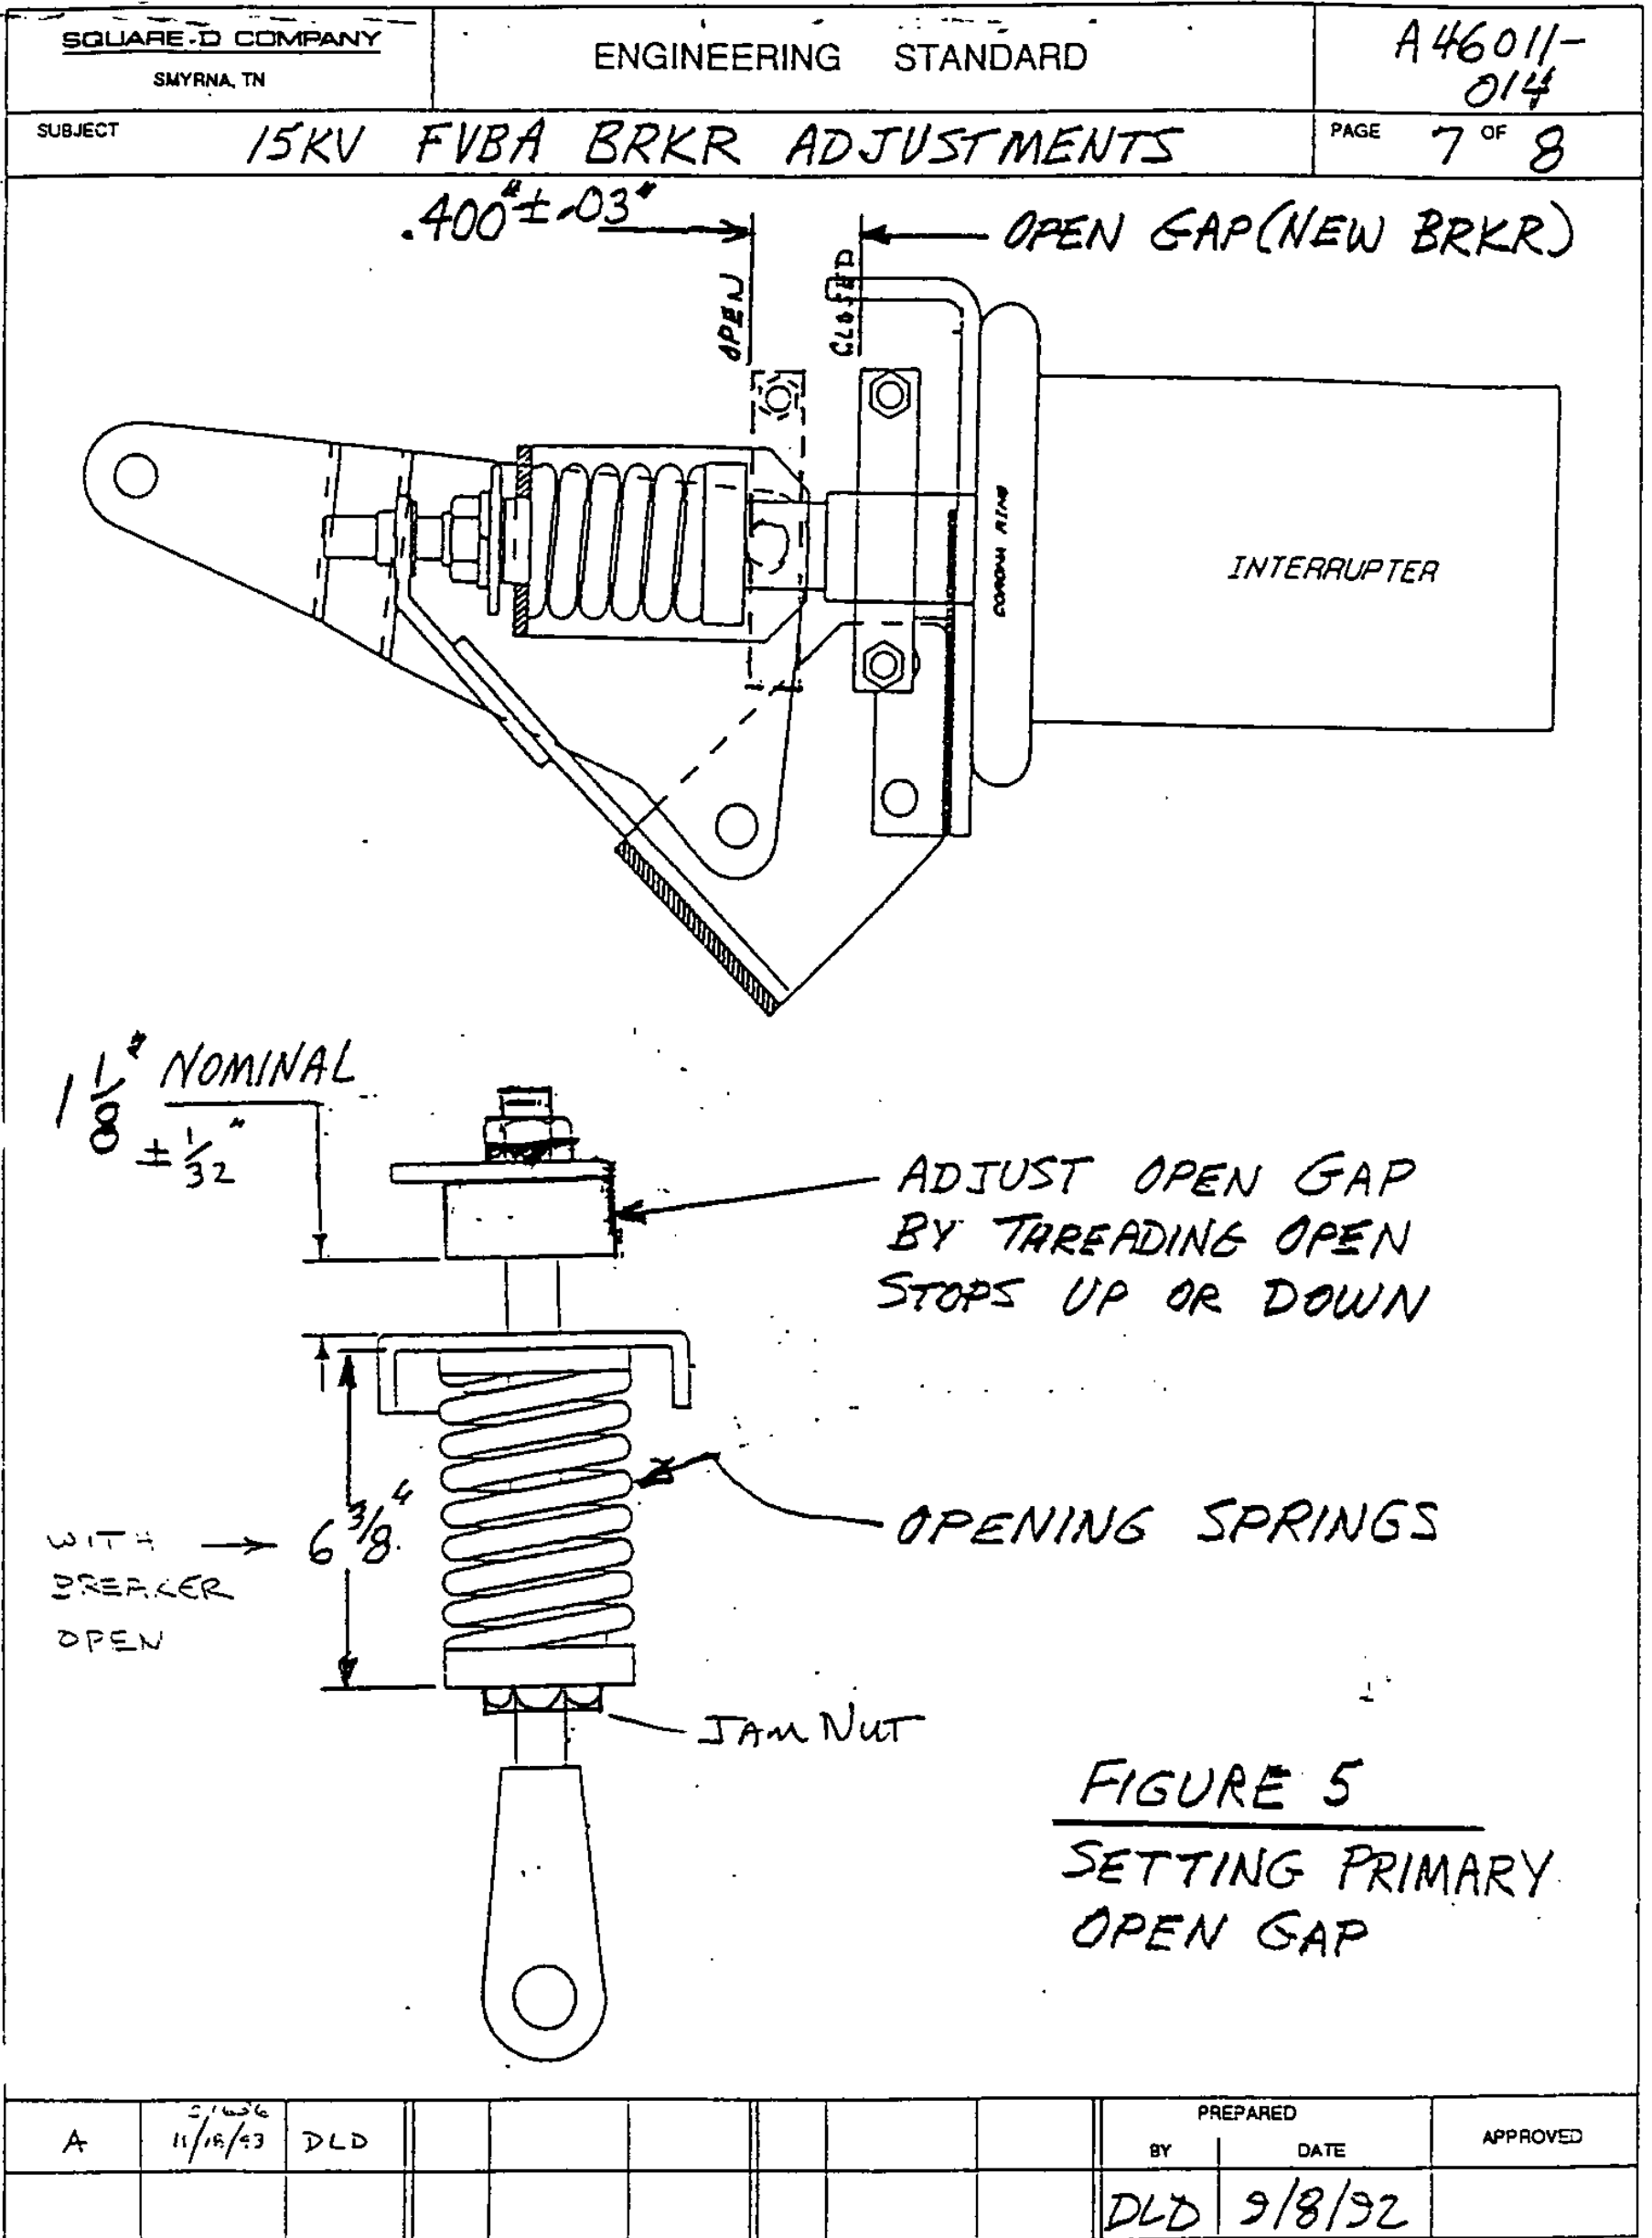

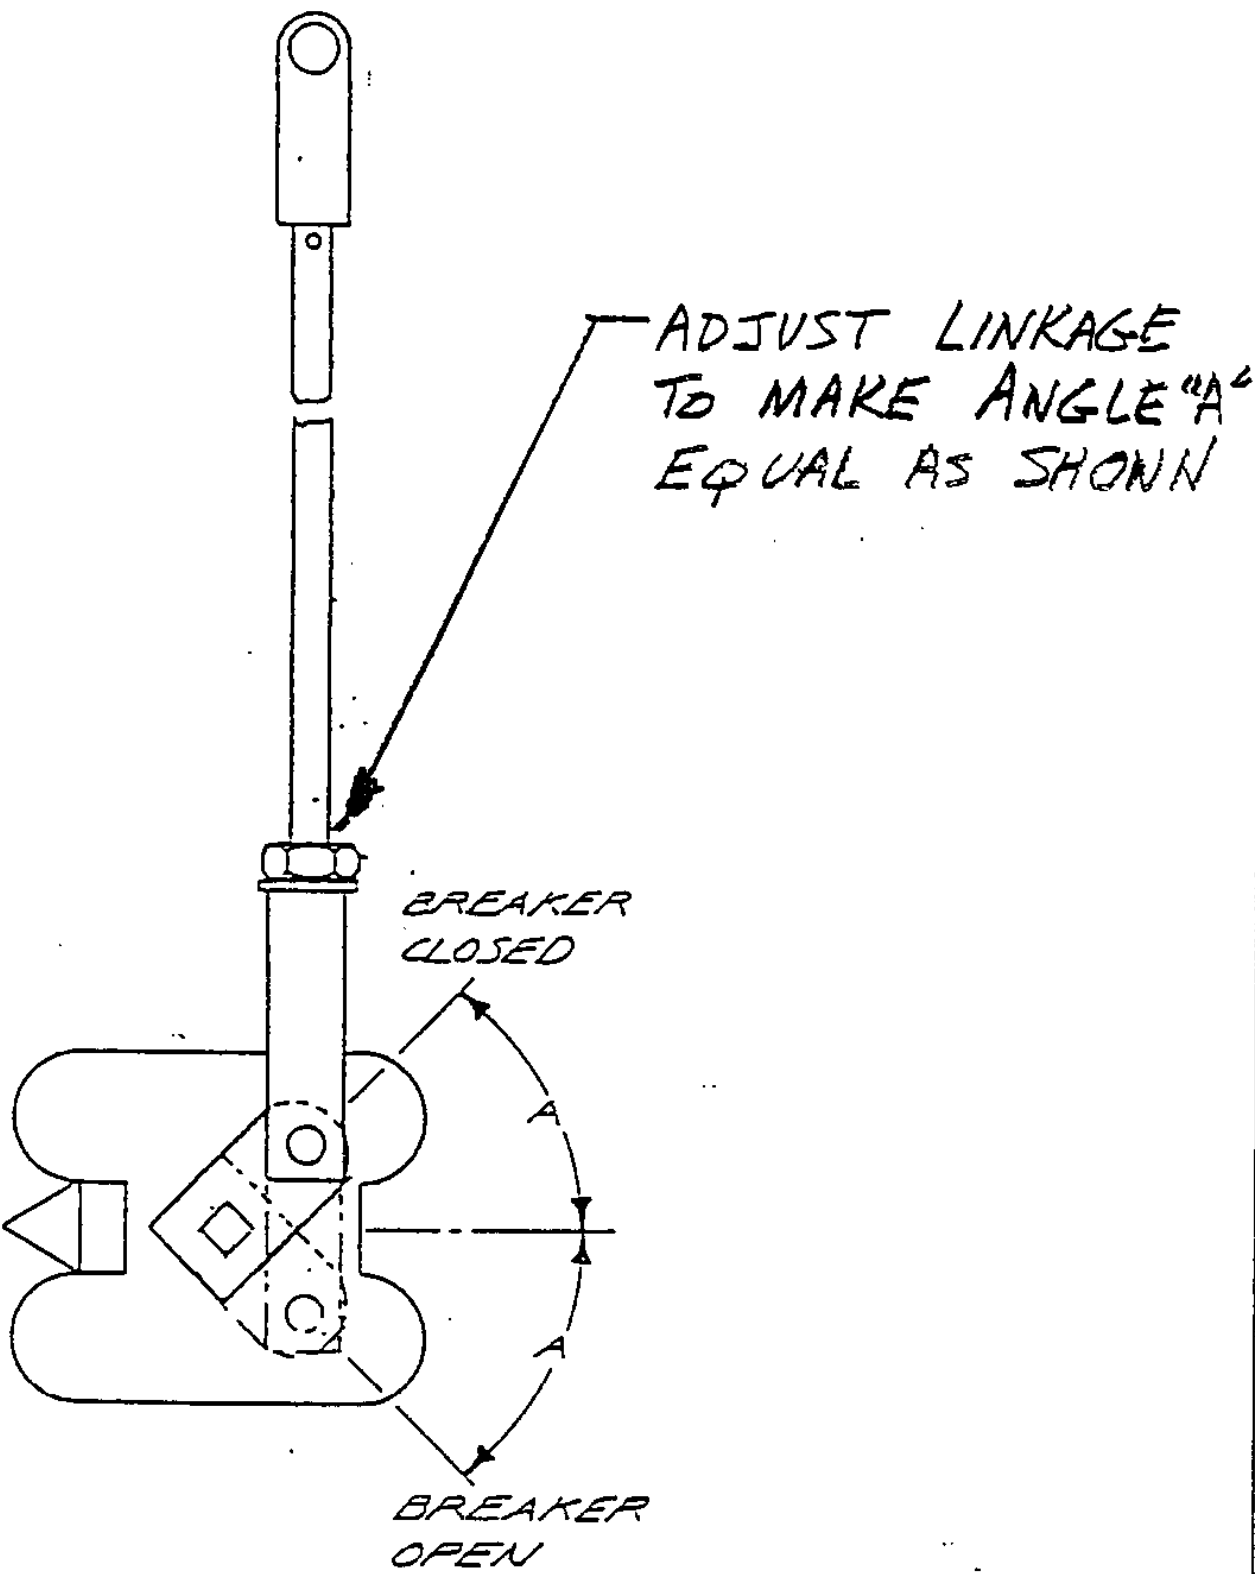


FIGURE 6
 SETTING AUXILIARY
 SWITCH TRAVEL

A	57036 11/15/93	DLD							PREPARED		APPROVED
									BY	DATE	
									DLD	9/8/92	