

RESERVED FOR NOTES

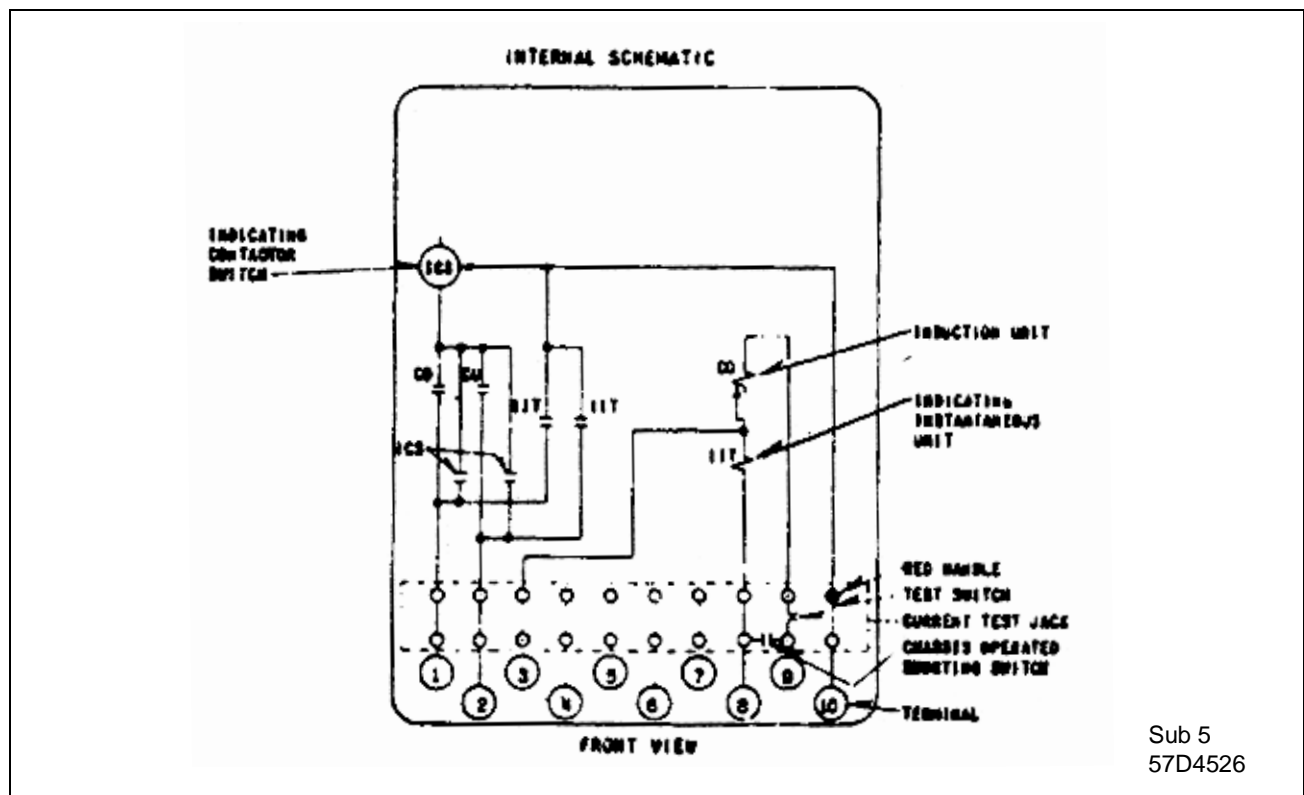


Figure 20: Internal Schematic of the Double Trip Circuit Closing Relay with Indicating Instantaneous Trip Unit.

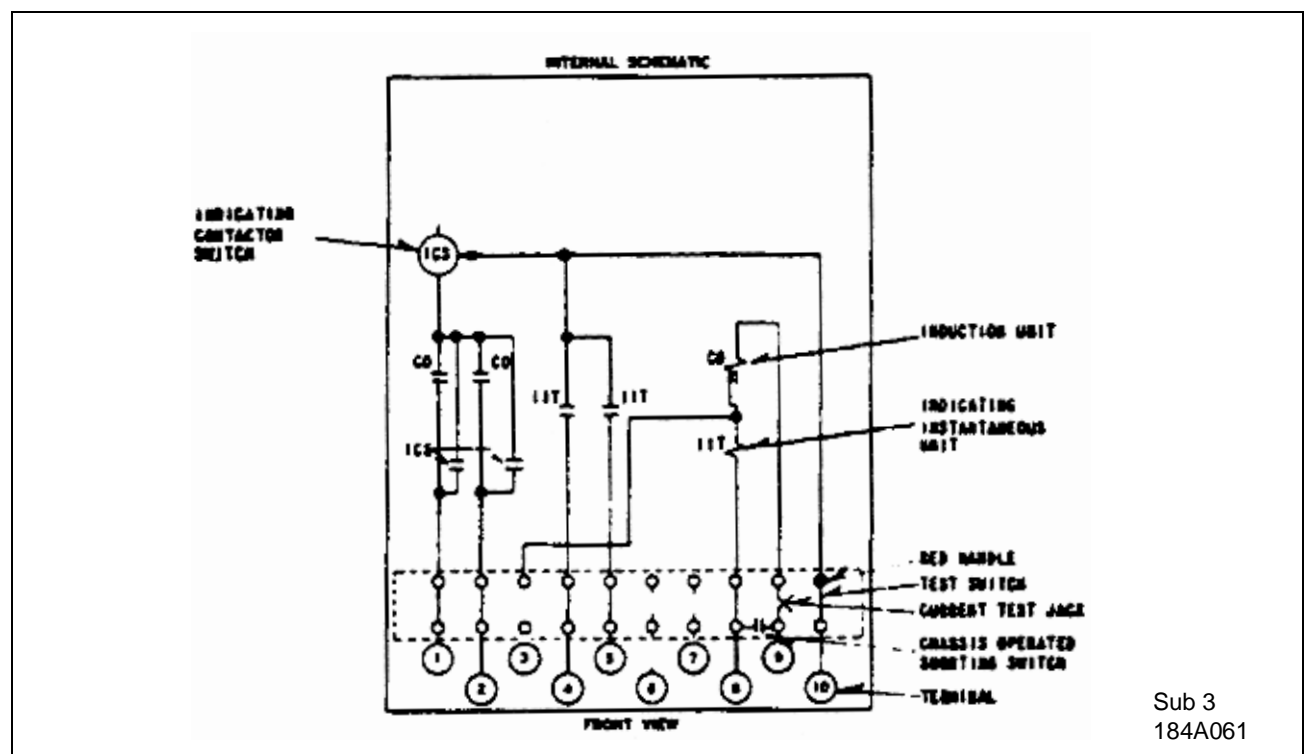


Figure 21: Internal Schematic of the Double Trip Circuit Closing Relay with Indicating Instantaneous Trip Unit to Separate Terminals.



Printed in U.S.A.

visit our website at www.abbus.com/papd

ABB Automation Inc.
4300 Coral Ridge Drive
Coral Springs Florida 33065
TEL: 954-752-6700
FAX: 954-345-5329