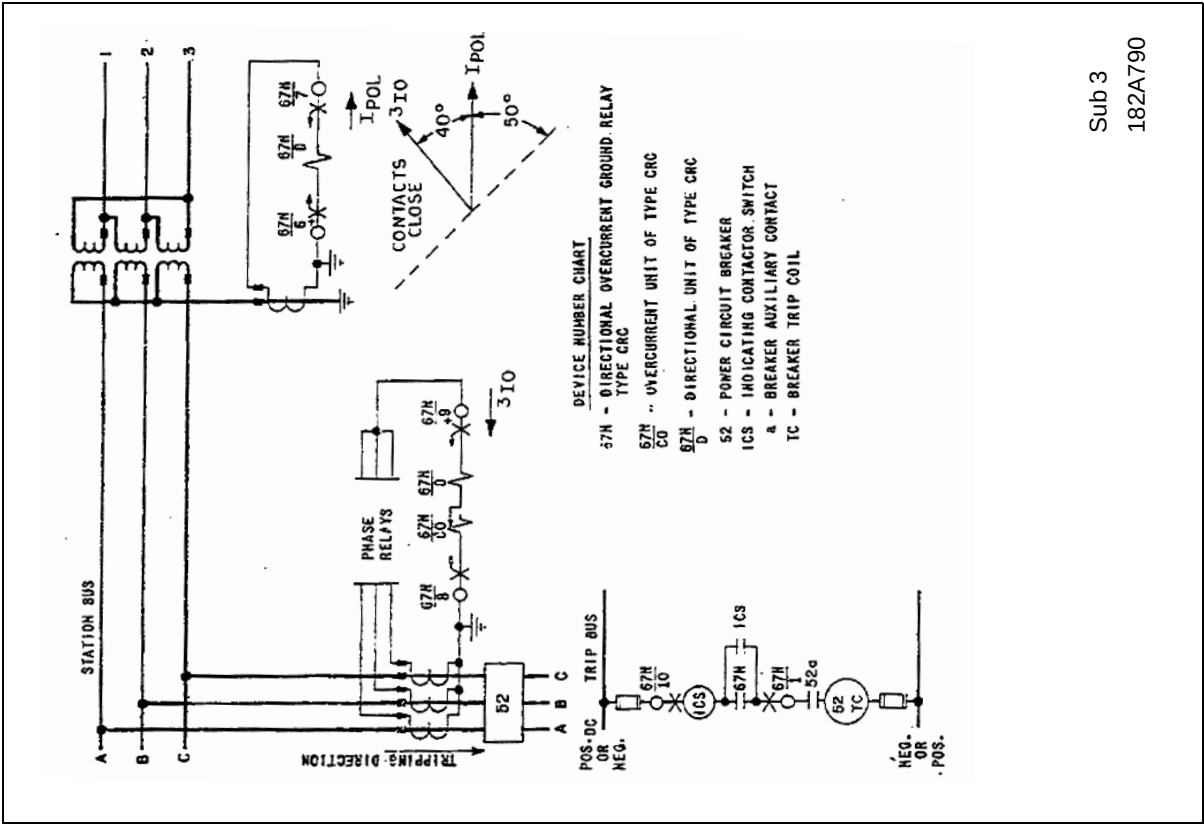


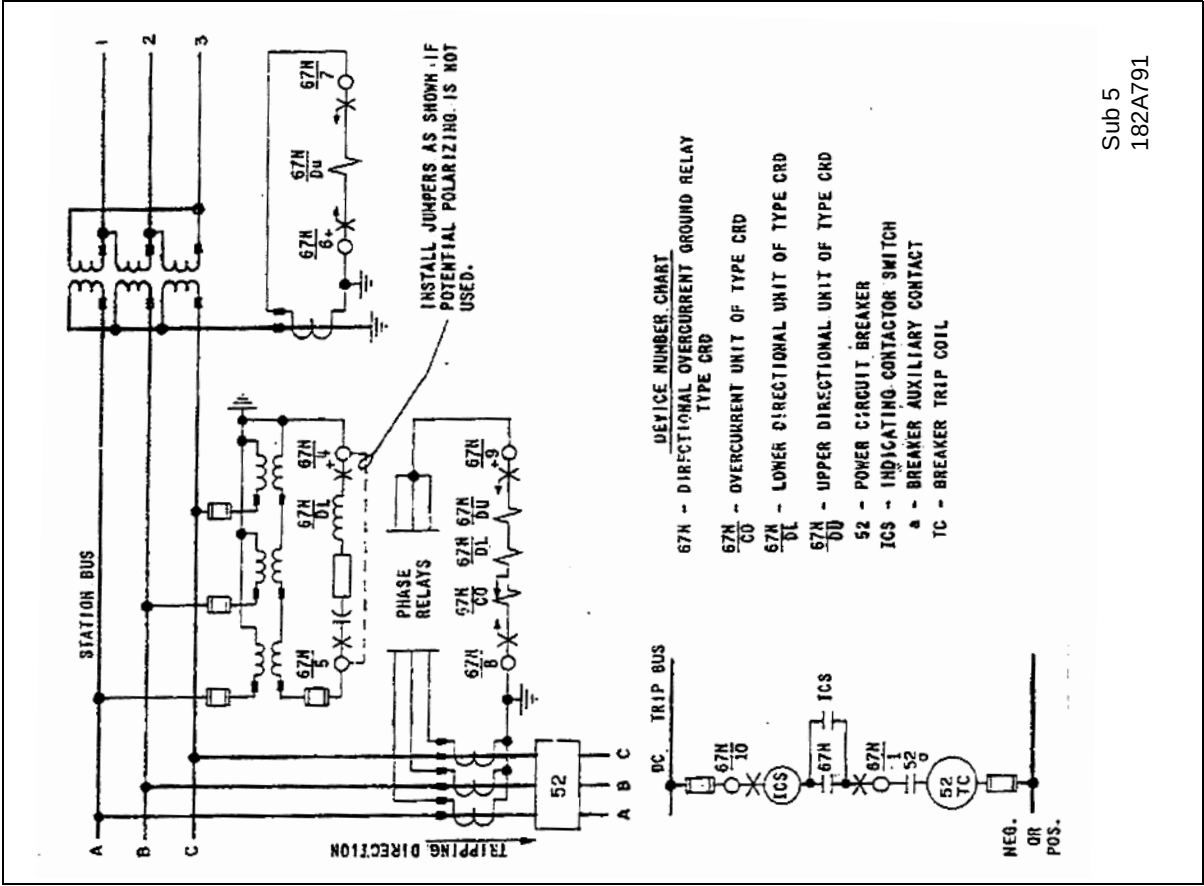


Figure 13: External schematic of the type CR relay for phase fault protection



Sub 3
182A790

Figure 15: External schematic of the type CRC relay for ground fault protection



Sub 5
182A791

Figure 16: External schematic of the type CRD relay for ground fault protection

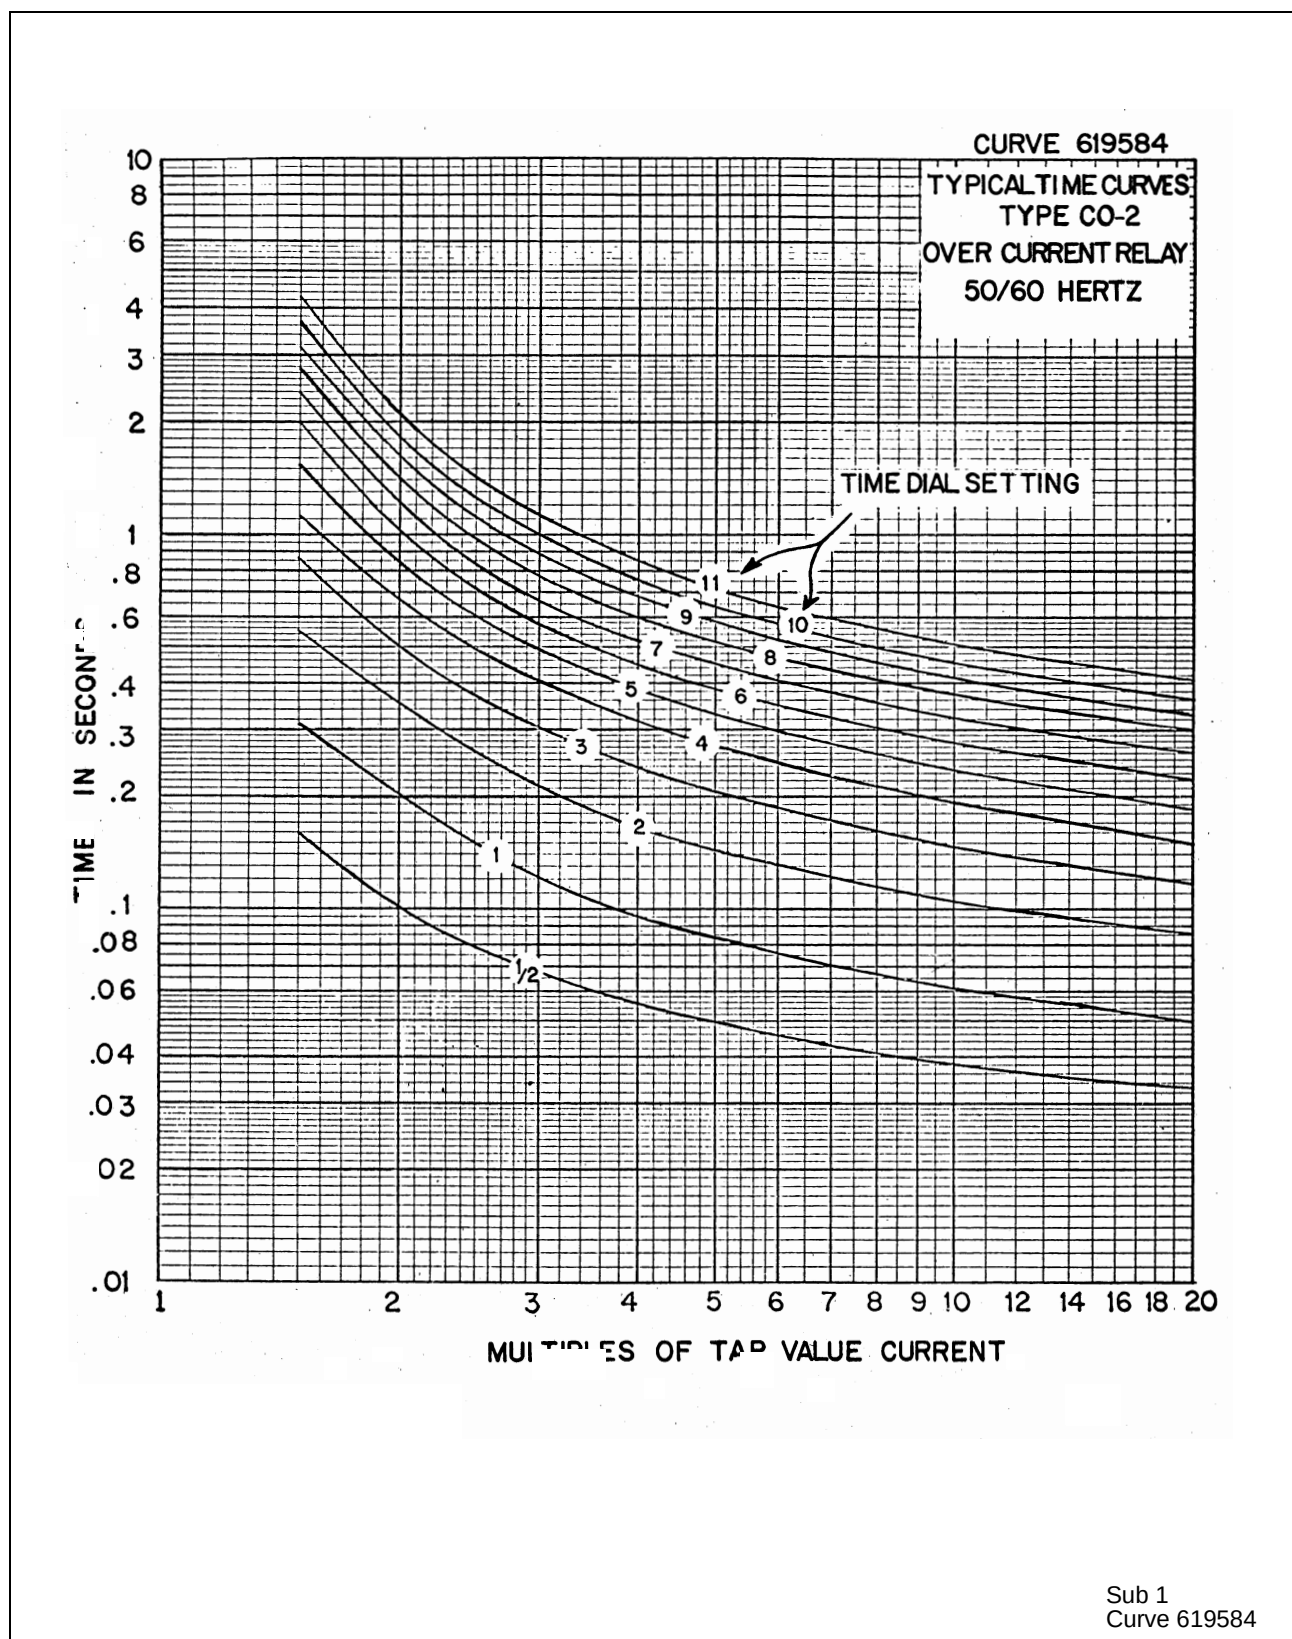


Figure 17: Typical time curves for relays with CO-2 units

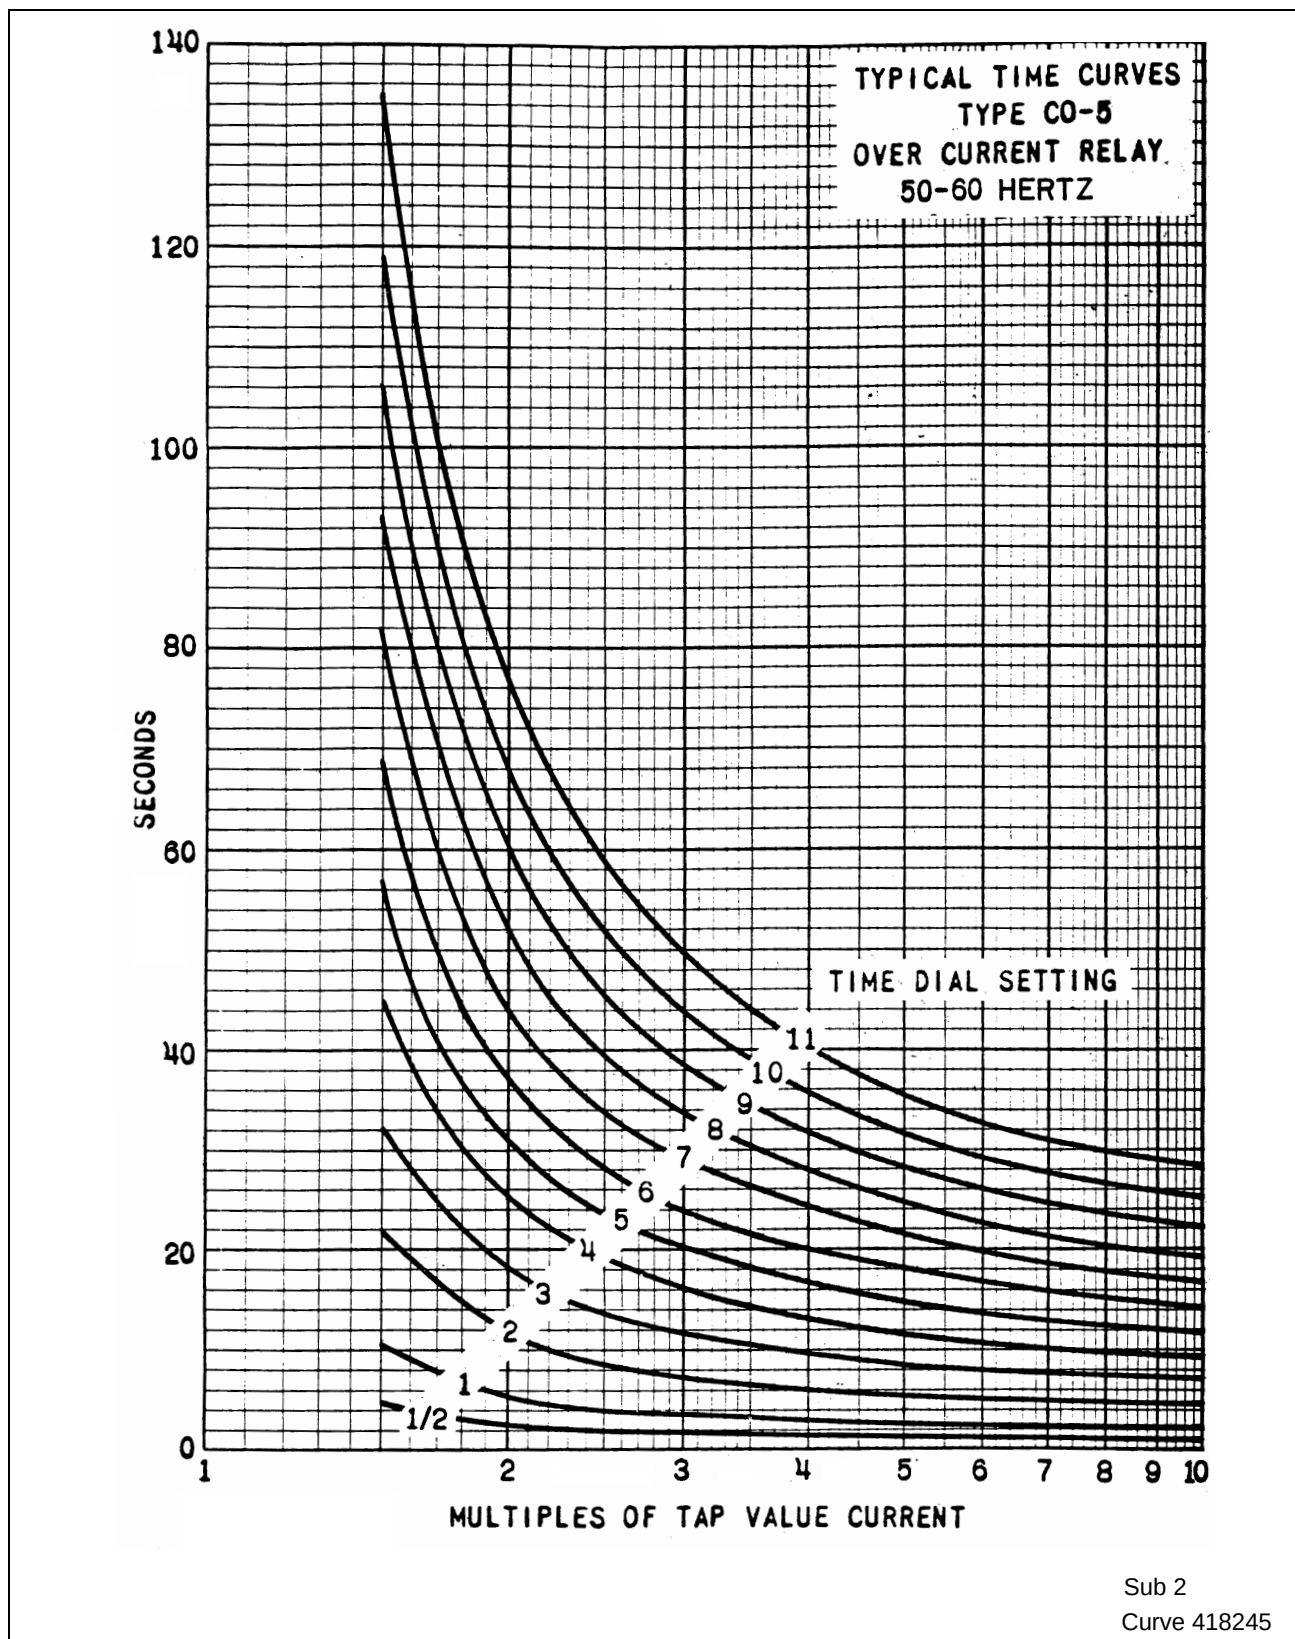


Figure 18: Typical time curves for relays with CO-5 units



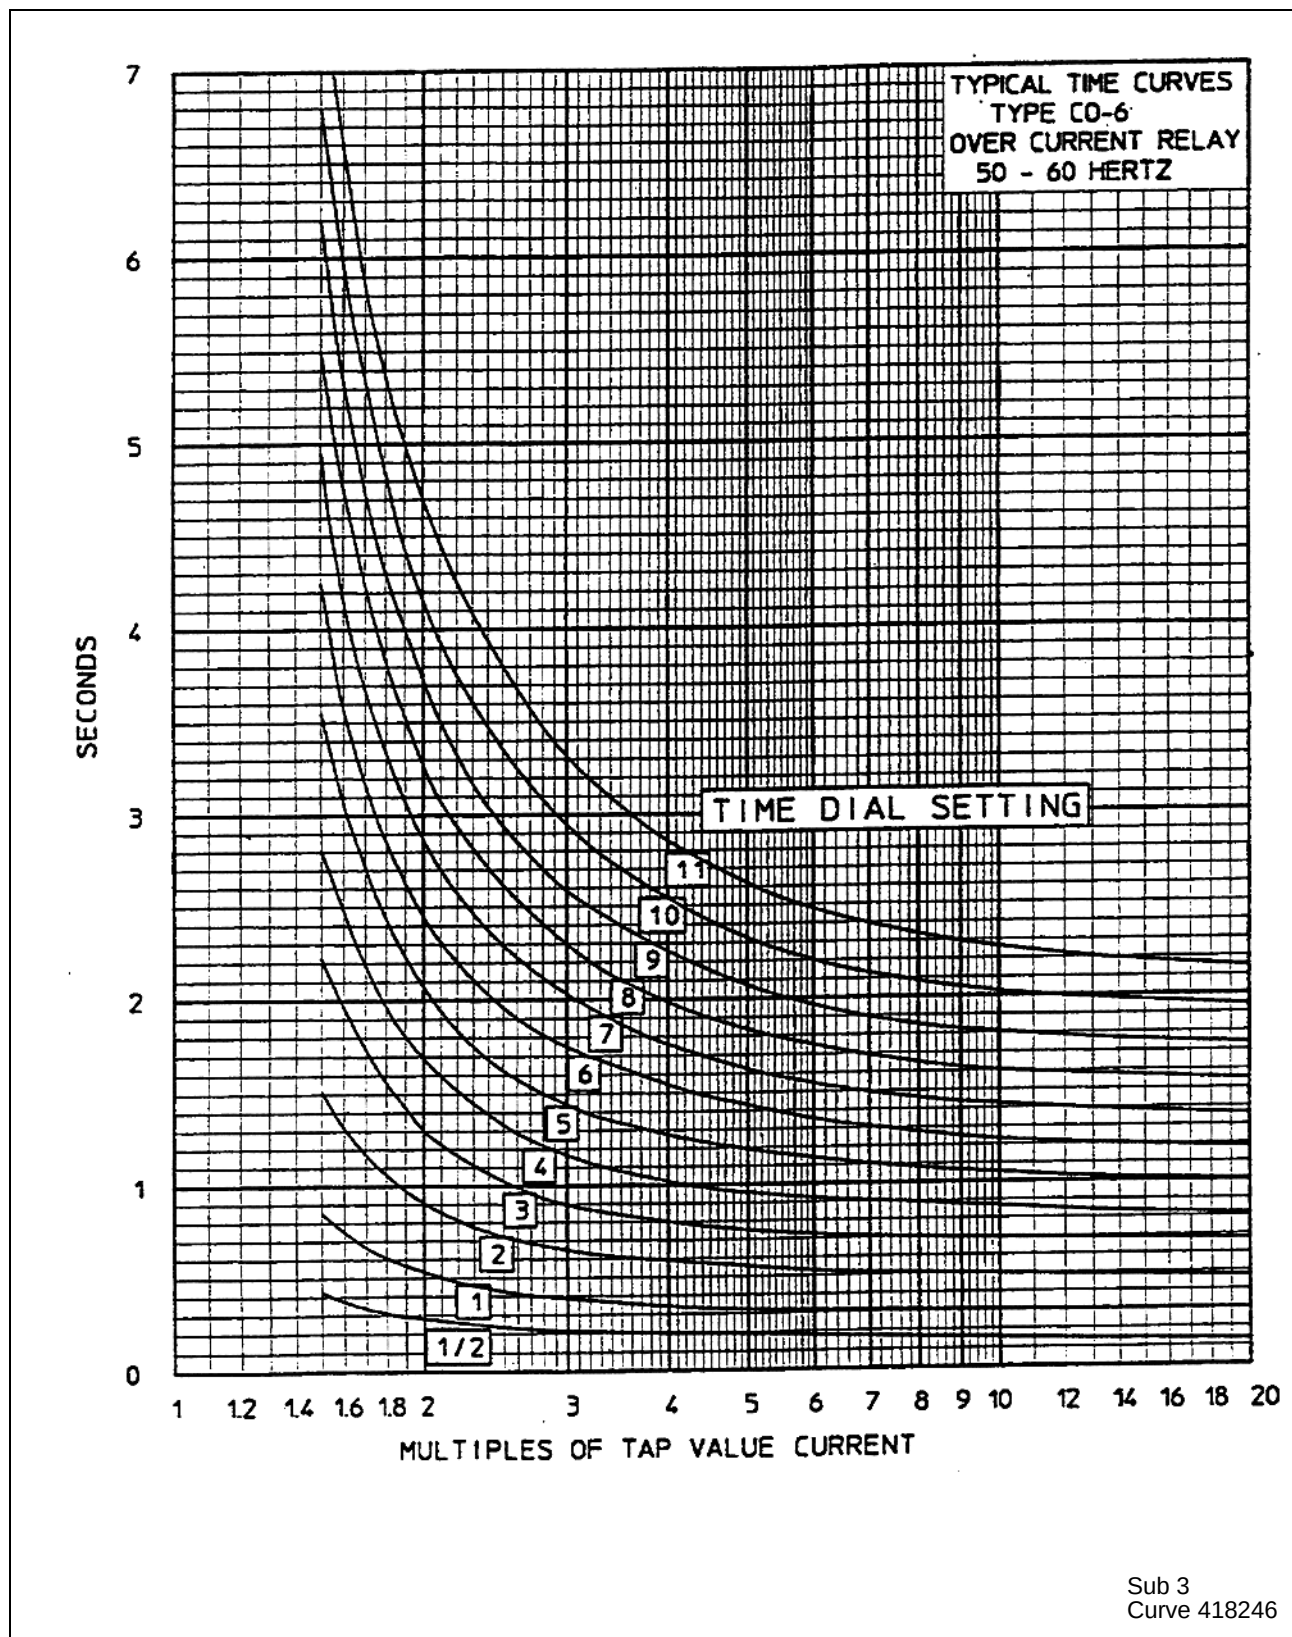


Figure 19: Typical time curves for relays with CO-6 units

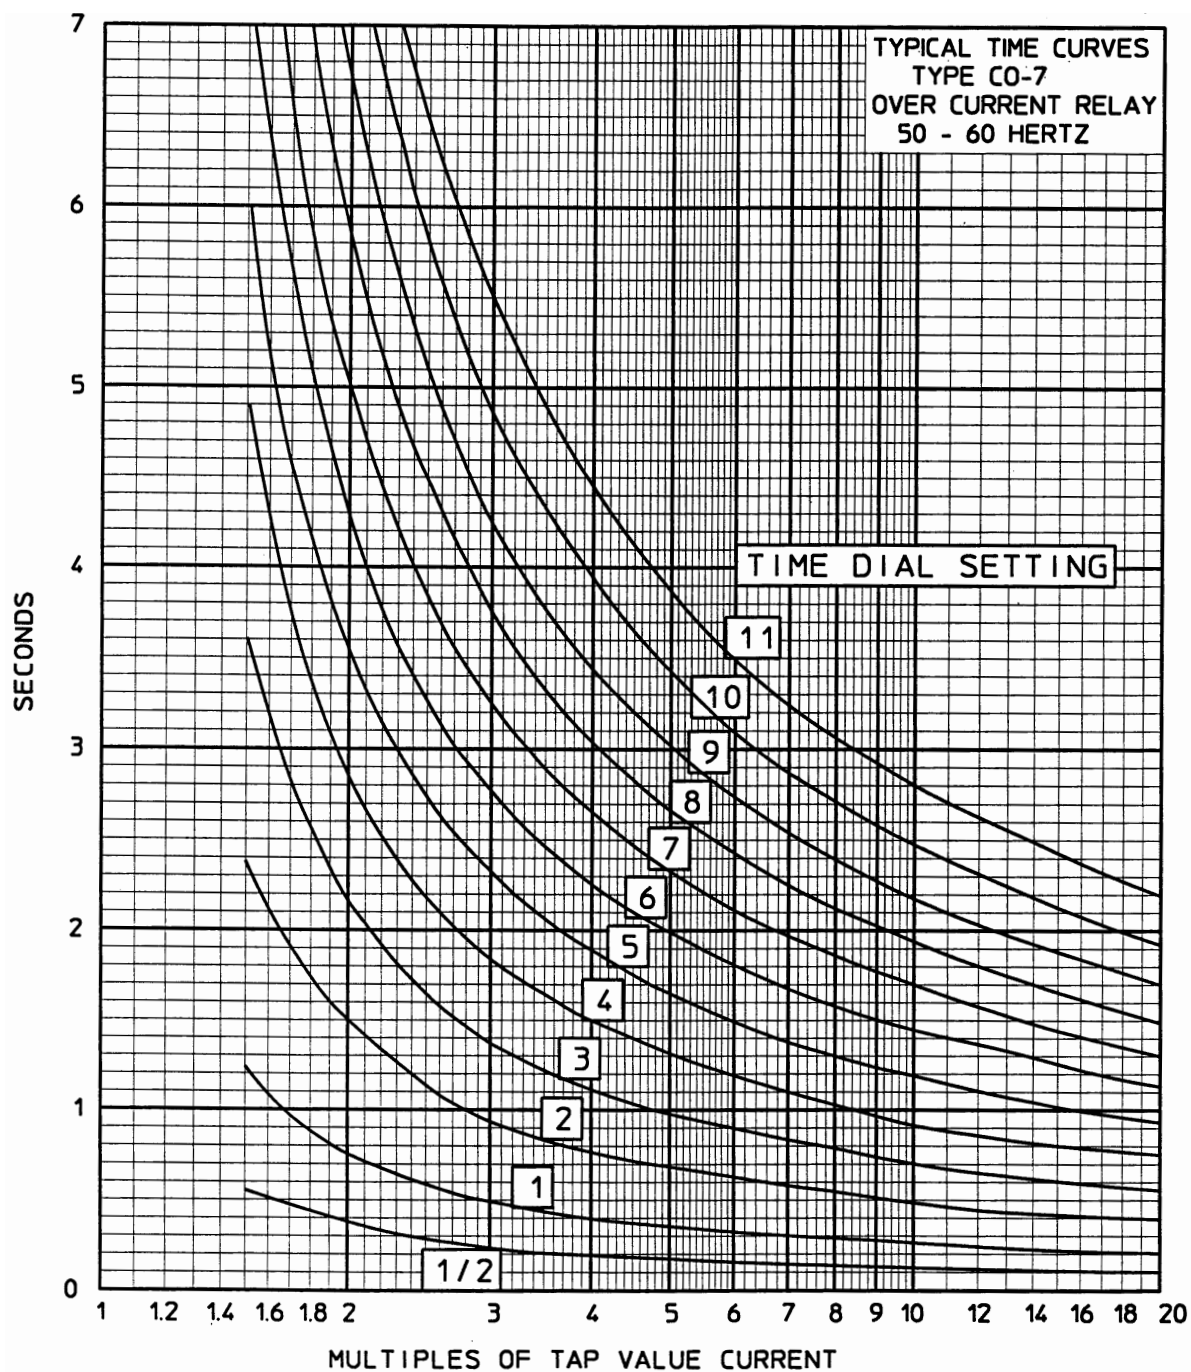

Sub 3
Curve 418247

Figure 20: Typical time curves for relays with CO-7 units

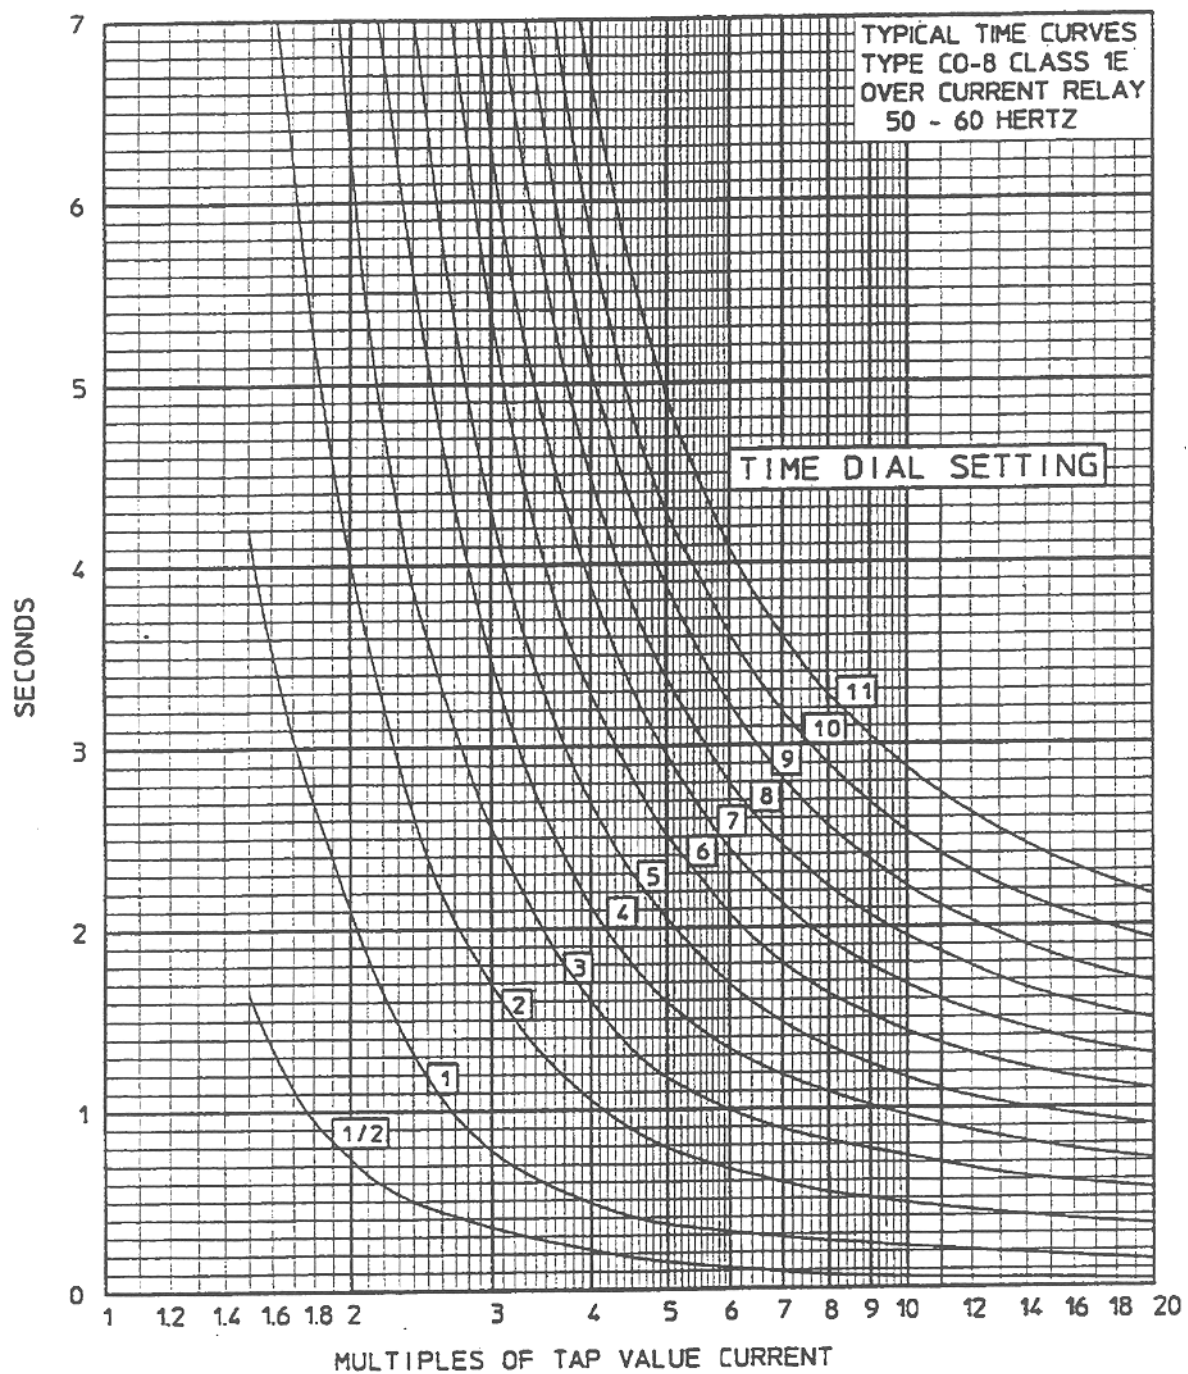

Sub 3
Curve 418248

Figure 21: Typical time curves for relays with CO-8 units

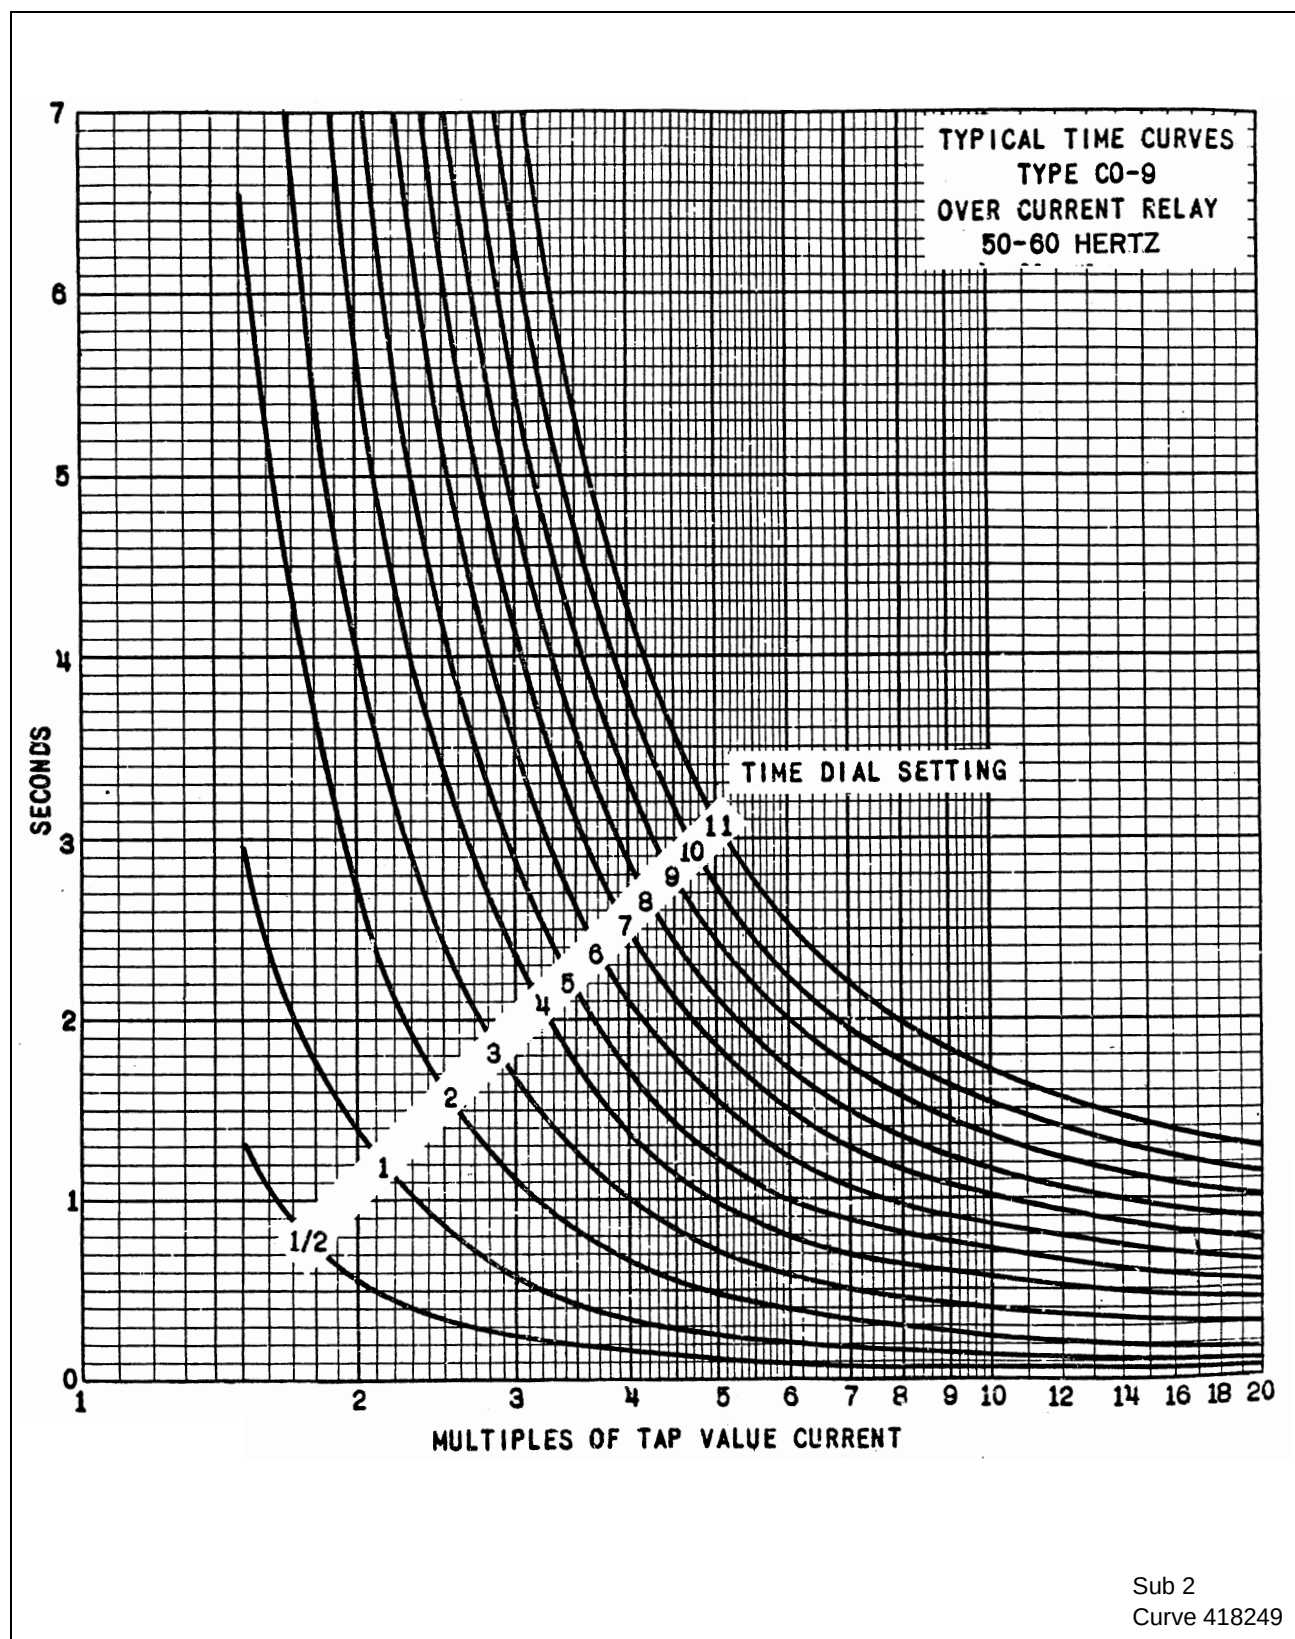


Figure 22: Typical time curves for relays with CO-9 units

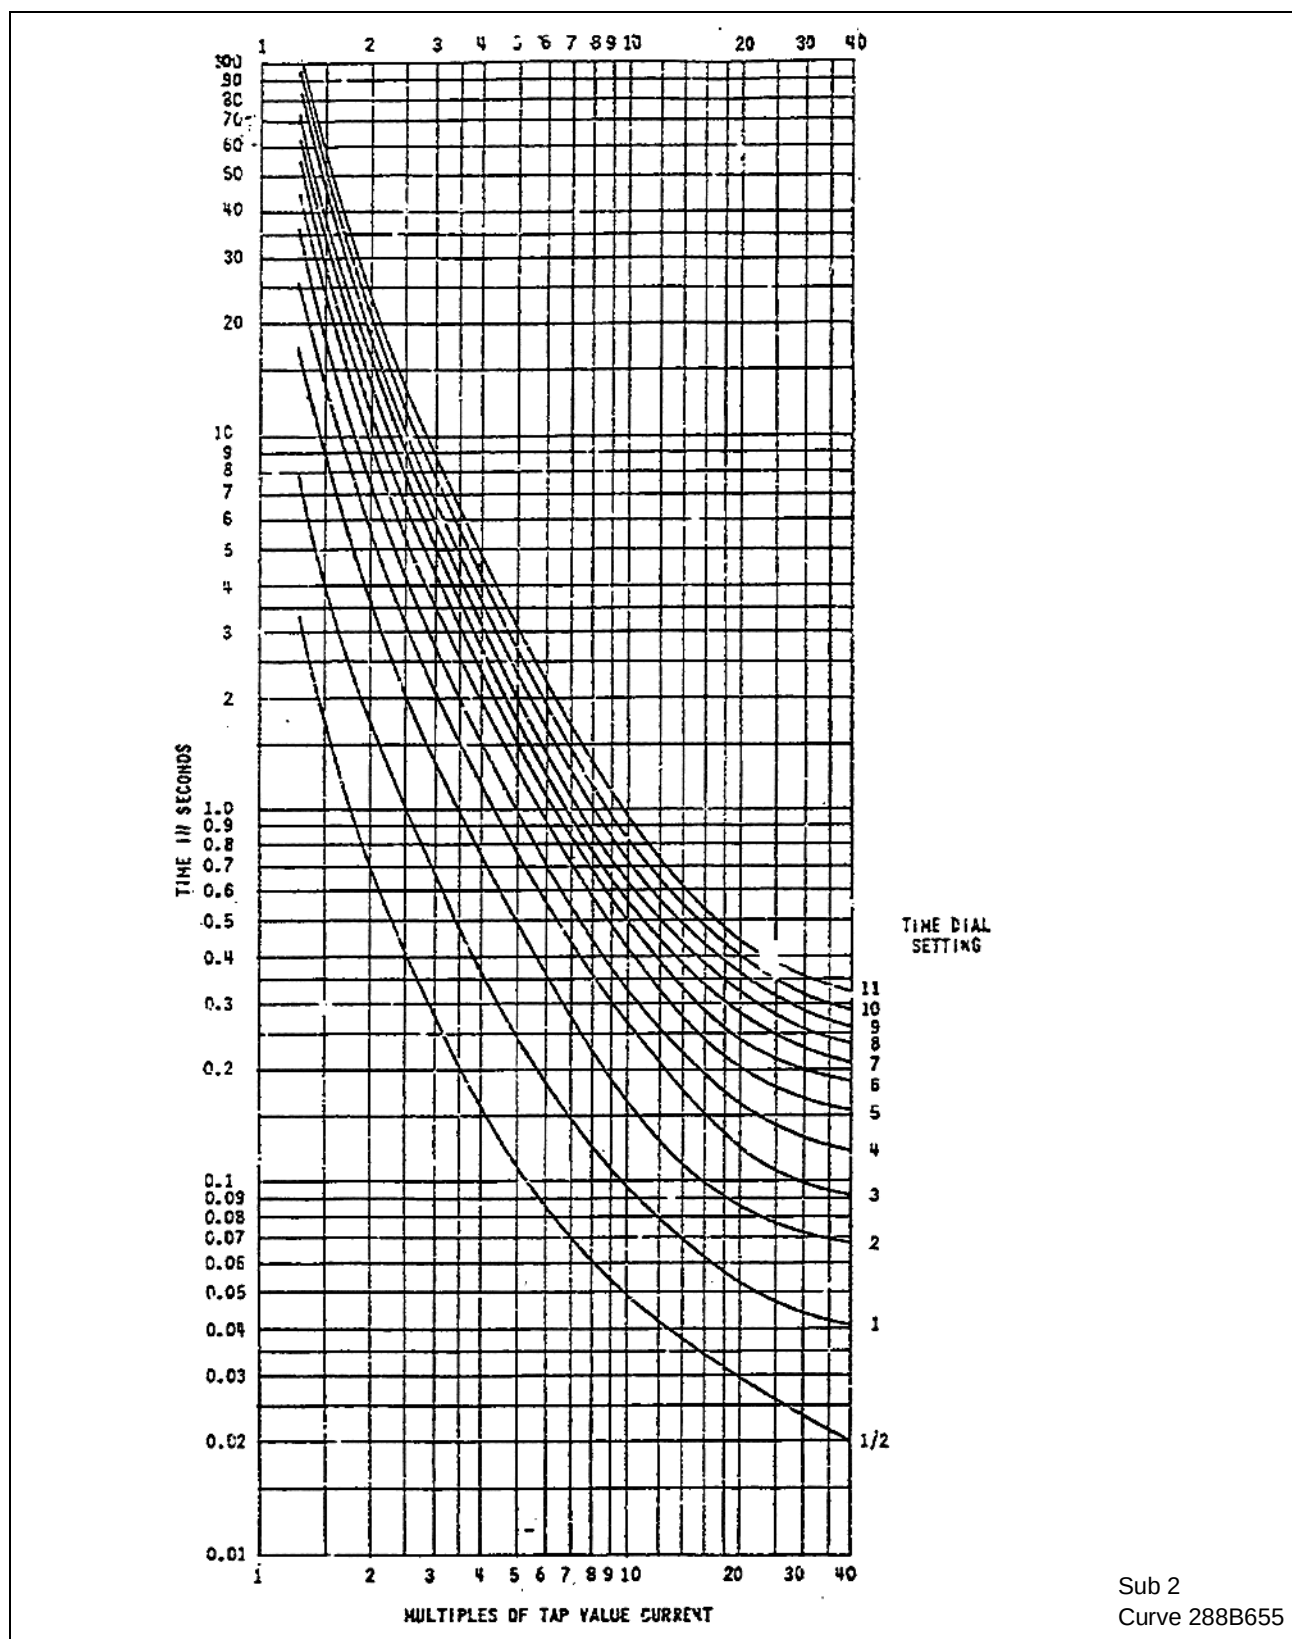


Figure 23: Typical time curves for relays with CO-11 units

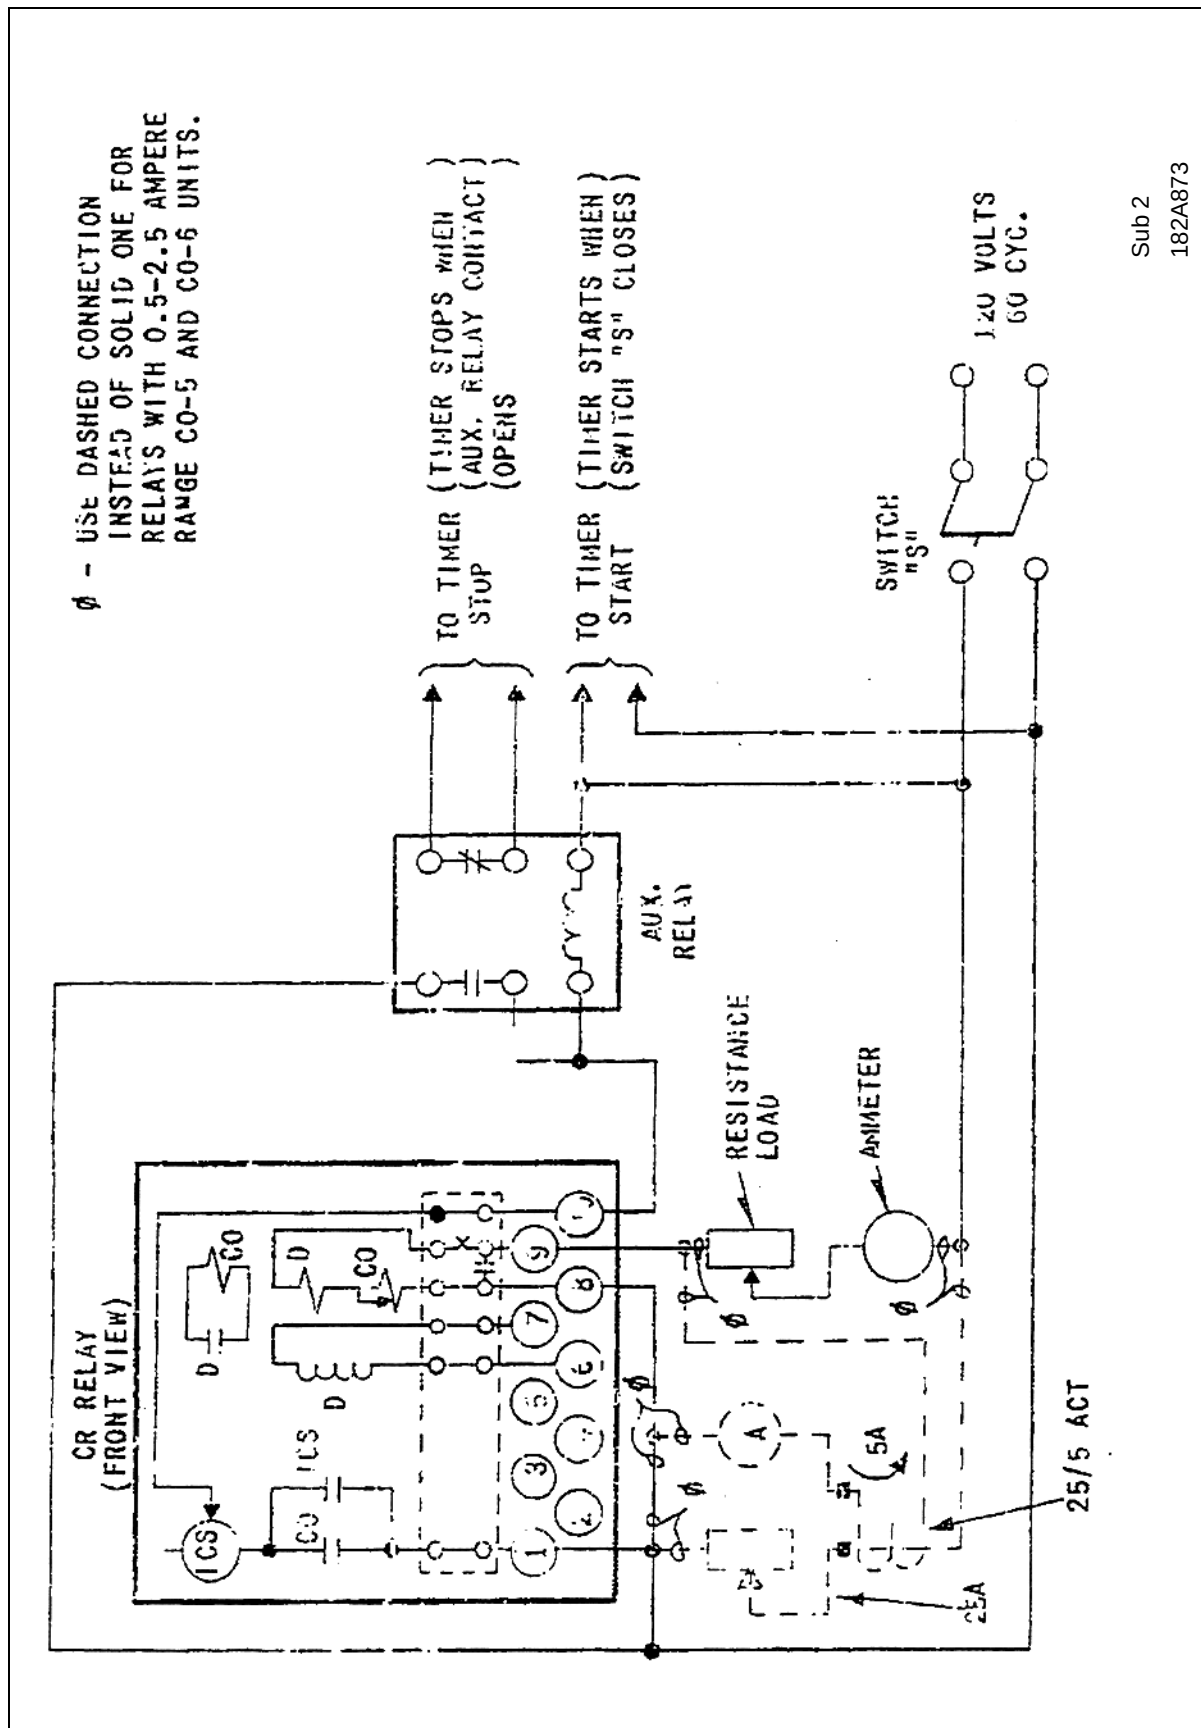


Figure 24: Diagram of test connections of the overcurrent units