

Instructions for test Kit Adapter, Style No. 8779C02G01 or 8779C02G03



DO NOT ATTEMPT TO INSTALL OR PERFORM MAINTENANCE ON EQUIPMENT WHILE IT IS ENERGIZED. DEATH OR SEVERE PERSONAL INJURY CAN RESULT FROM CONTACT WITH ENERGIZED EQUIPMENT. ALWAYS VERIFY THAT NO VOLTAGE IS PRESENT BEFORE PROCEEDING WITH THE TASK AND ALWAYS FOLLOW GENERALLY ACCEPTED SAFETY PROCEDURES.

CUTLER-HAMMER IS NOT LIABLE FOR THE MISAPPLICATION OR MISINSTALLATION OF ITS PRODUCTS.

The user is cautioned to observe all recommendations, warnings and cautions relating to the safety of personnel and equipment, as well as all general and local health and safety laws, codes, and procedures.

The recommendations and information contained herein are based on Cutler-Hammer's experience and judgment, but should not be considered to be all-inclusive or covering every application or circumstance which may arise. If any questions arise, contact Cutler-Hammer for further information or instructions.

1.0 SUPPLEMENTARY INFORMATION

The instructions contained in this pamphlet supplement the instruction contained in I.L. 32-691.

2.0 GENERAL INTRODUCTION

In May 1993, the test port on DS Air Circuit Breakers using Digitrip RMS trip units was changed. The test kit adaptor will enable those who have test kit 140D481G03, or upgraded versions of 140D481G01 or 140D481G02, to test DS breakers with Digitrip trip units manufactured after May 1993. DSII Air Circuit Breakers are equipped with the new test port and can be tested using this adaptor and above mentioned test kits.

3.0 INFORMATION

The test port was moved from the front cover of the DS breaker to the upper left side as you face the front of the breaker. The test port was also changed from an 11-pin banana plug to a 9-pin plug. Use of the adapter is as simple as plugging the 11-pin banana plug from the test kit into the test kit adapter, plugging the 9-pin plug from the test kit adapter into the Digitrip test port, and hanging the adapter on the breaker draw-out rail. You are then ready to start the testing procedure. See picture below. Refer to I.L. 32-691.


4.0 CAUTIONS FOR DIGITRIP RMS TESTING

DO NOT use tester style **140D481G01** or **140D481G02** that have not been upgraded to test a Digitrip RMS trip unit as damage to the trip unit will occur.

When using the auxiliary control power module, remove the AC supply to the module rather than disconnecting the module plug from the trip unit.

5.0 UPGRADES TO G01 AND G02 TEST KITS

Amptector test kits 140D481G01 and 140D481G02 which can **NOT** be used to test Digitrip RMS Trip units can be modified to do so. This can be done by contacting the Cutler-Hammer LVA Aftermarket Group in Asheville. You can contact the appropriate individuals at (704) 687-3220 or (704) 687-3235.

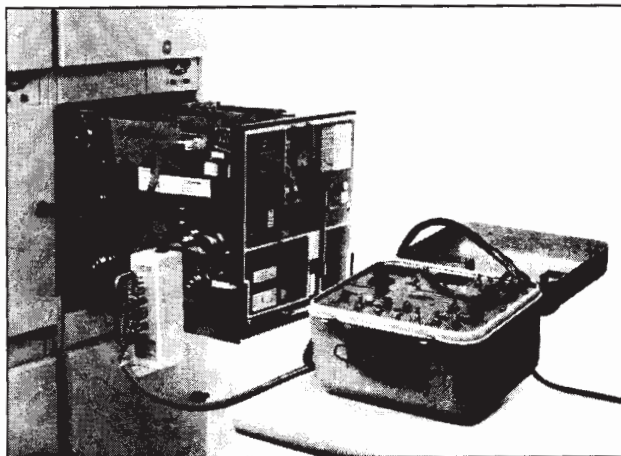

This instruction leaflet is published solely for information purposes and should not be considered all inclusive. If further information is required, you should consult Cutler-Hammer.

Sale of product shown in this literature is subject to terms and conditions outlined in appropriate Cutler-Hammer selling policies or other contractual agreement between the parties. This literature is not intended to and does not enlarge or add to any such contract. The sole source governing the rights and remedies of any purchaser of this equipment is the contract between the purchaser and Cutler-Hammer.

NO WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE OR MERCHANTABILITY, OR WARRANTIES ARISING FROM COURSE OF DEALING OR USAGE OF TRADE, ARE MADE REGARDING THE INFORMATION, RECOMMENDATIONS AND DESCRIPTIONS CONTAINED HEREIN. In no event will Cutler-Hammer be responsible to the purchaser or user in contract, in tort (including negligence), strict liability or otherwise for any special, indirect, incidental or consequential damage or loss whatsoever, including but not limited to damage or loss of use of equipment, plant or power systems, cost of capital, loss of power, additional expenses in the use of existing power facilities, or claims against the purchaser or user by its customers resulting from the use of the information, recommendations and descriptions contained herein.

**FOR RENEWAL PARTS INFORMATION CALL YOUR LOCAL AUTHORIZED
CUTLER-HAMMER DISTRIBUTOR.**

For the name of the nearest Cutler-Hammer distributor, call:

1-800-525-2000

**TO ASSURE SAFETY OF OPERATION AND CONTINUITY OF SERVICE, ALWAYS USE
GENUINE CUTLER-HAMMER AFTERMARKET PARTS AND PRODUCT UPGRADES.**

**SHOULD YOU NEED FACTORY ASSISTANCE ON THIS TEST KIT ADAPTER OR
OPTIONS FOR UPGRADING YOUR OTHER LOW VOLTAGE ASSEMBLIES PRODUCTS,
CALL:**

1-800-BKR-FAST

(1-800-257-3278)

Cutler-Hammer

221 Heywood Road
Arden, NC 28704

Effective February, 1998
Printed in U.S.A./CCI

