

02-03

ENGINEERING ORD.

SERIAL NUMBER



MITSUBISHI ELECTRIC CORPORATION

MITSUBISHI 2033C-B SERIES UPS

PURCHASER

SCHEMATIC DIAGRAM LIST

PROJECT 30kVA(208V) UPS

SITE

[illegible]

Win版

CAD

出 國 先

UPS校

控

計


		 MITSUBISHI ELECTRIC	SCHEMATIC DIAGRAM LIST	SHEET NO. A01
				DATE JUL. 15. '02
		作成・図面 DRAWN A. Kosaka	AZ22772	PAGE NO. 001 / 004
		設計・確認 APPROVED		

1 2 3 4 5 6 7 8 9

AC INPUT
3phase 4wires
208V 60HZ

30 kVA 24 KW UPS

AC OUTPUT
3phase 4wires
208V 60HZ

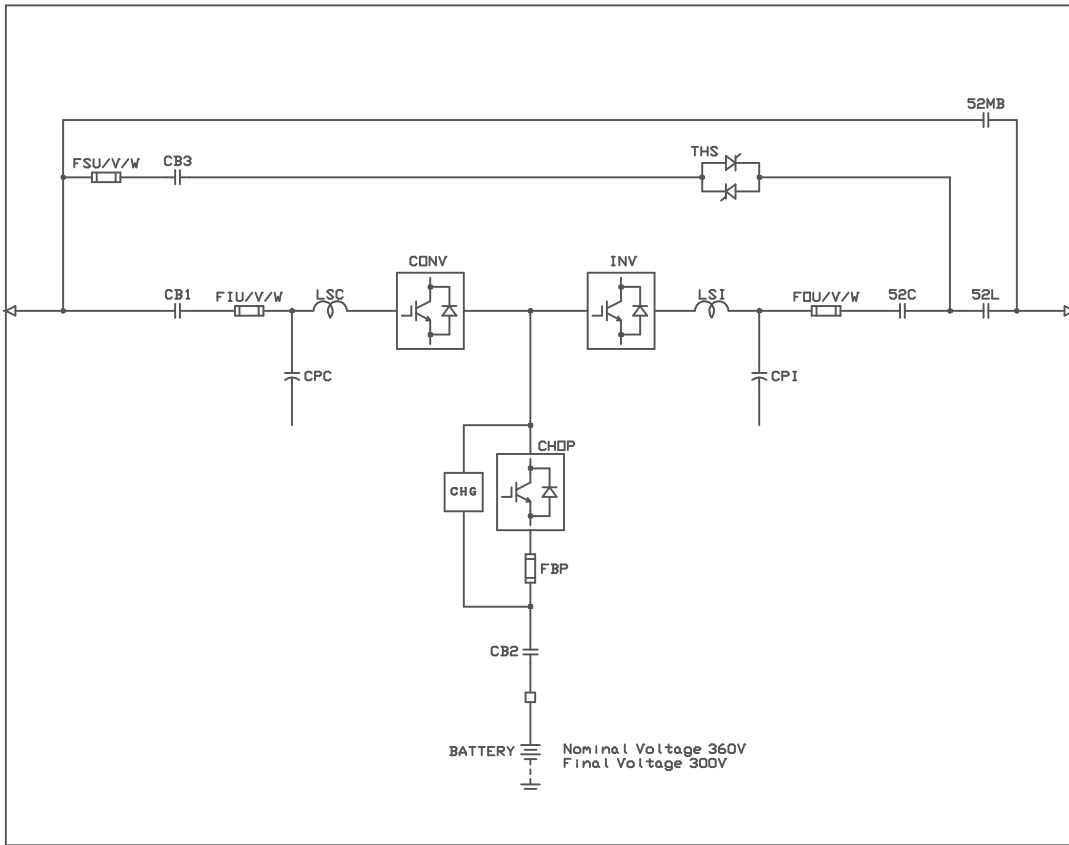

Win版

CAD

出図先

UPS棟

控
計

DEVICE No.	STANDARD	OPTION
FSU, FSV, FSW	BUS	FUSE



MITSUBISHI
ELECTRIC

日付
DATE

JUL. 15. '02

作成・図案
DRAWN

A. Kosaka

設計・検査
APPROVED

SYSTEM CONFIGURATION

AZ22772

SHEET NO.
E01

PAGE NO.
002

1 2 3 4 5 6 7 8 9

THIS PLATE PREVENTS THE CABINET FROM FALLING DURING TRANSPORTATION. REMOVE PLATE ONLY AFTER UPS HAS BEEN PROPERLY INSTALLED.

NOTES

1. DIMENSIONS ARE IN INCHES (MILLIMETERS)
2. OVERALL DIMENSIONS DO NOT INCLUDE SIDE AND REAR PANELS BOLT HEADS
3. CABINETS SHOULD BE MAINTAINED UPRIGHT WITHIN 15° DURING HANDLING
4. APPROXIMATE WEIGHT: 1235lbs(560kg) INCLUDE BATTERY

TOP VIEW

OPENING FOR BOTTOM WIRING ACCESS

SECTION B-B

AIR EXHAUST

CENTER OF GRAVITY

CONTROL PANEL

A-240-2-1 (KEY-No. 030)

CENTER OF GRAVITY

0.36" (9) DIA HOLE

0.28" (7) DIA HOLE

CASTER

LEFT SIDE ONLY

BACK SIDE VIEW

LEFT SIDE VIEW

FRONT VIEW

SECTION A-A

RJA
FG33CB
S1A22772
G=1

三角画法
尺度 SCALE
1:15

出図先

UP33CB

UPS機

控


計

		 MITSUBISHI ELECTRIC CORPORATION		TITLE		SHEET No.	
				2033C SERIES 30kVA		J01	
		作成日付 DATE		NOV. 20, '02			
		作成・照査 DRAWN		H. NAGANO		PAGE No.	
		設計・検査 APPROVED		DWG. No.		003	
A NOV.20.02 HANAGANO				AZ22772			


THIS PLATE PREVENTS THE CABINET FROM FALLING DURING TRANSPORTATION. REMOVE PLATE ONLY AFTER UPS HAS BEEN PROPERLY INSTALLED.

NOTES

1. DIMENSIONS ARE IN INCHES
(MILLIMETERS)
2. OVERALL DIMENSIONS DO NOT INCLUDE SIDE AND REAR PANELS BOLT HEADS
3. CABINETS SHOULD BE MAINTAINED UPRIGHT WITHIN 15° DURING HANDLING
4. APPROXIMATE WEIGHT: 823lbs(374kg)
NOT INCLUDE BATTERY



TOP VIEW

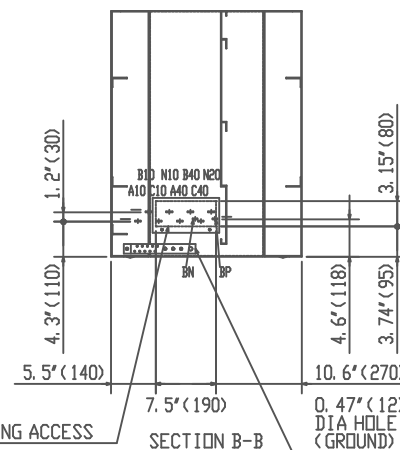

SECTION B-B

OPENING FOR BOTTOM WIRING ACCESS



CONTROL PANEL

A-240-2-1
(KEY-No. 030)

CENTER OF GRAVITY

AIR EXHAUST

CENTER OF GRAVITY

17.2' (438)

AIR INLET

LEFT SIDE ONLY


CASTER

0.4' (10)


31.5' (800)

BACK SIDE VIEW

LEFT SIDE VIEW

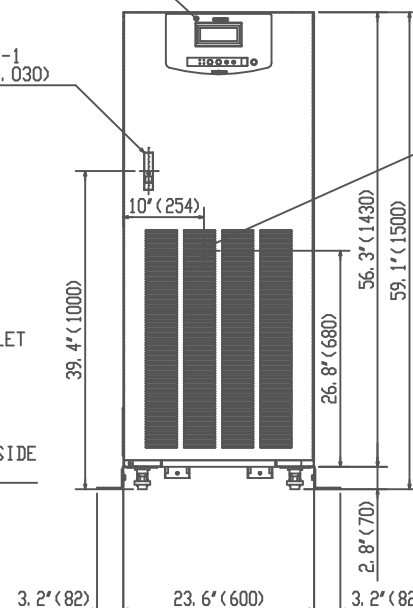

FRONT VIEW

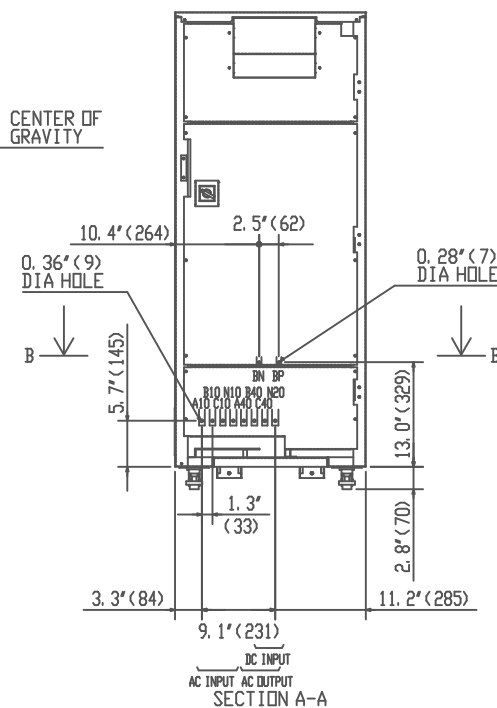

SECTION A-A

記号

UP33CB

30kVA

A

B

C

D

E

F

RJA

FG33CB

S1AZ22772

G=3

三菱電機

FOR SCALE

: NTS


出図先

UP

UPS技

控

計

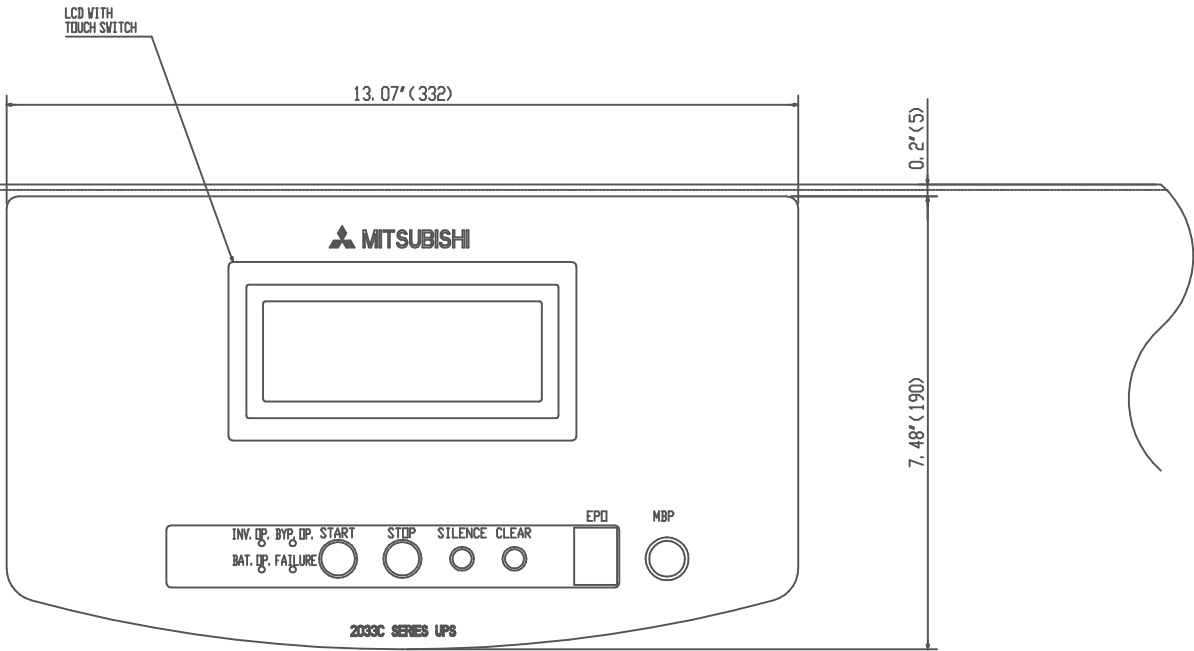

. .				TITLE	SHEET No.
. .					K01
. .		JUL. 15, '02		CONTROL PANEL	.
. .		A. Kosaka			
. .				FIG. No.	FIG. No.
. .					