
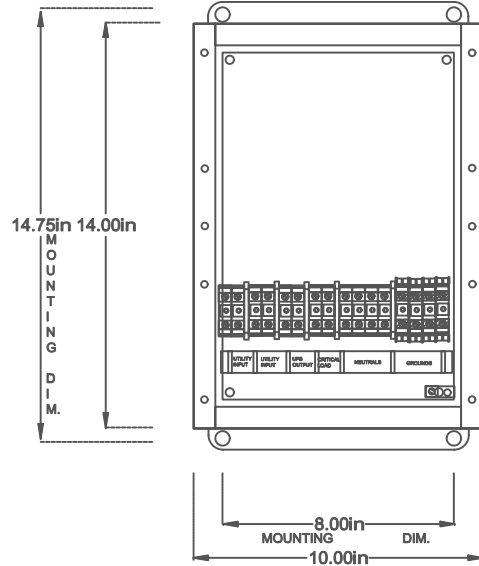
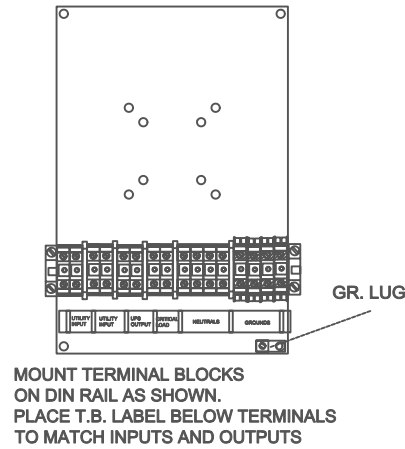


HSK INSERT PLACEMENT ON TERMINAL BLOCK DETAIL




L1 L2 L1 L2 L1 L2 L1 L2 N N N N G G G G

UTILITY INPUT UPS INPUT UPS OUTPUT CRITICAL LOAD NEUTRALS GROUNDS

BACKPANEL

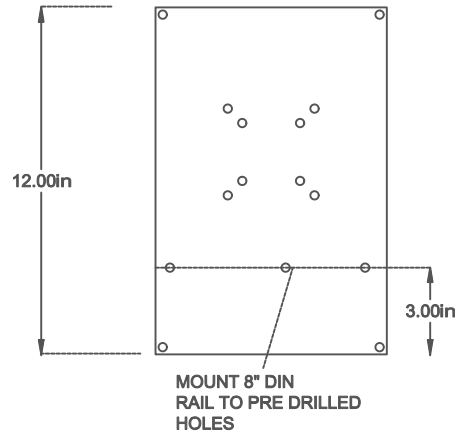

VIEW OF INSIDE OF ENCLOSURE. RAIL IS SLIGHTLY LONGER THAN BACKPANEL TO ACCOMMODATE TERMINALS.

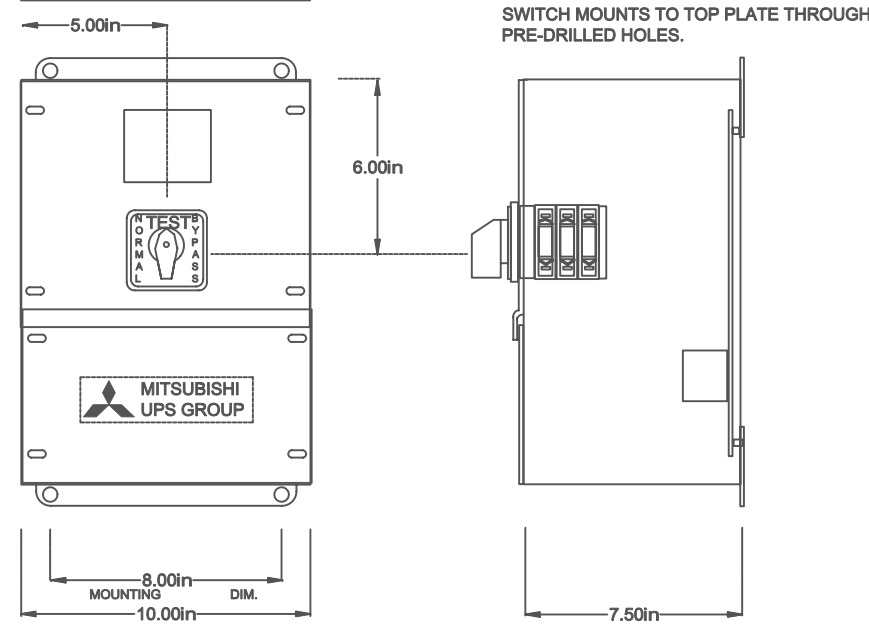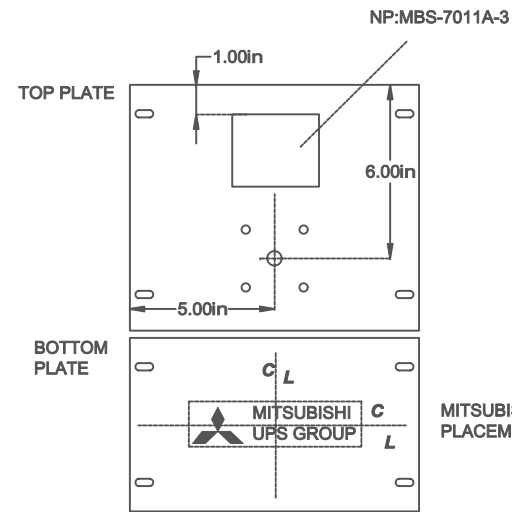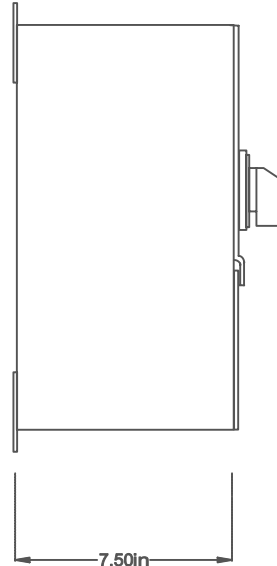

NOTES:

PART NUMBER MBS-7011A-3
BP432-2P-N1-01

CUSTOMER MITSUBISHI UPS GROUP

DESCRIPTION 50A, 2 pole MBC dimensional

DRAWN BY: MFN DATE: 07/30/02 APPROVAL : A.K. DATE: 07/30/02

This drawings replaces dwg. # dBP432-2-0701-00-00

REV.	DATE:	DESC.:	APPR :
REV. A:	8/01/02	For production.	A.K.
REV. B:			
REV. C:			
REV. D:			

DRAWING NO: BP432-2P-N1-01-D-0702



MITSUBISHI
UPS GROUP

2.



1.

2.

3.



mitsubishi
ups group

DRAWING NO:	BP432-2P-N1-S-0702
-------------	--------------------