

MITSUBISHI ELECTRIC CORPORATION

MITSUBISHI 9800A SERIES UPS

SCHEMATIC DIAGRAM LIST

PROJECT 300kVA(600V) UL LISTED UPS

TYPE: UP9833A-D304DU-6

出 圖 先

DF	
UPS棟	
控	
計	

			MITSUBISHI ELECTRIC		SCHEMATIC DIAGRAM LIST	SHEET NO. A01
			日付 DATE	FEB. 21, 2003		
		作成・検査 DRAWN	AZ22734			PAGE NO. 001
A	APR 04 03 T.K	設計・検認 DESIGNED BY T. KOUYA Y. KAWANISHI T. KOUYA M. KIRIYAMA				002

図番 AZ22734

記録

UP33BU

E01

97-03

A

B

C

D

E

F

Win版

CAD

出図先

DF

UPS機

控

計

1 2 3 4 5 6 7 8 9

A


B

C

D

E

F

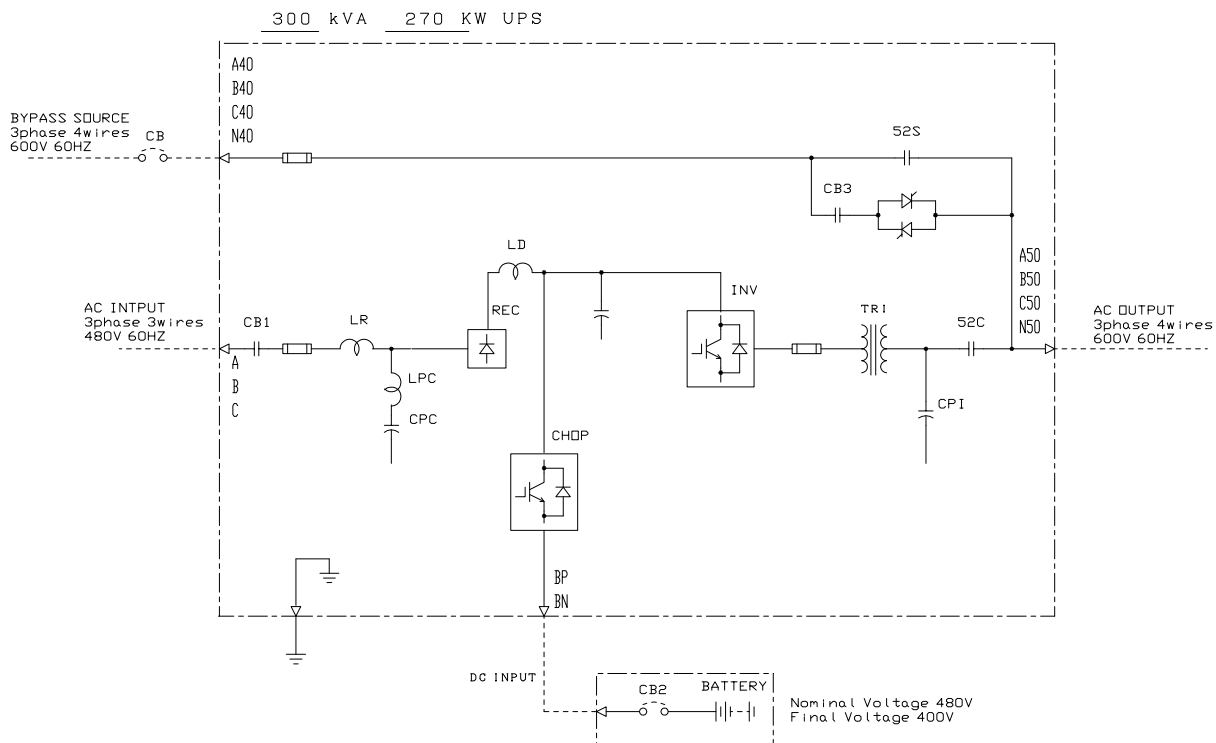

MITSUBISHI
ELECTRIC

日付

DATE

作成・描画

DRAWN

設計・検認

APPROVED

T. KUYA

T. KUYA

SYSTEM CONFIGURATION(1)

AZ22734

SHEET NO.
E01

PAGE NO.
002

1 2 3 4 5 6 7 8 9

A

B

C

D

E

F

A




B

C

D

E

F

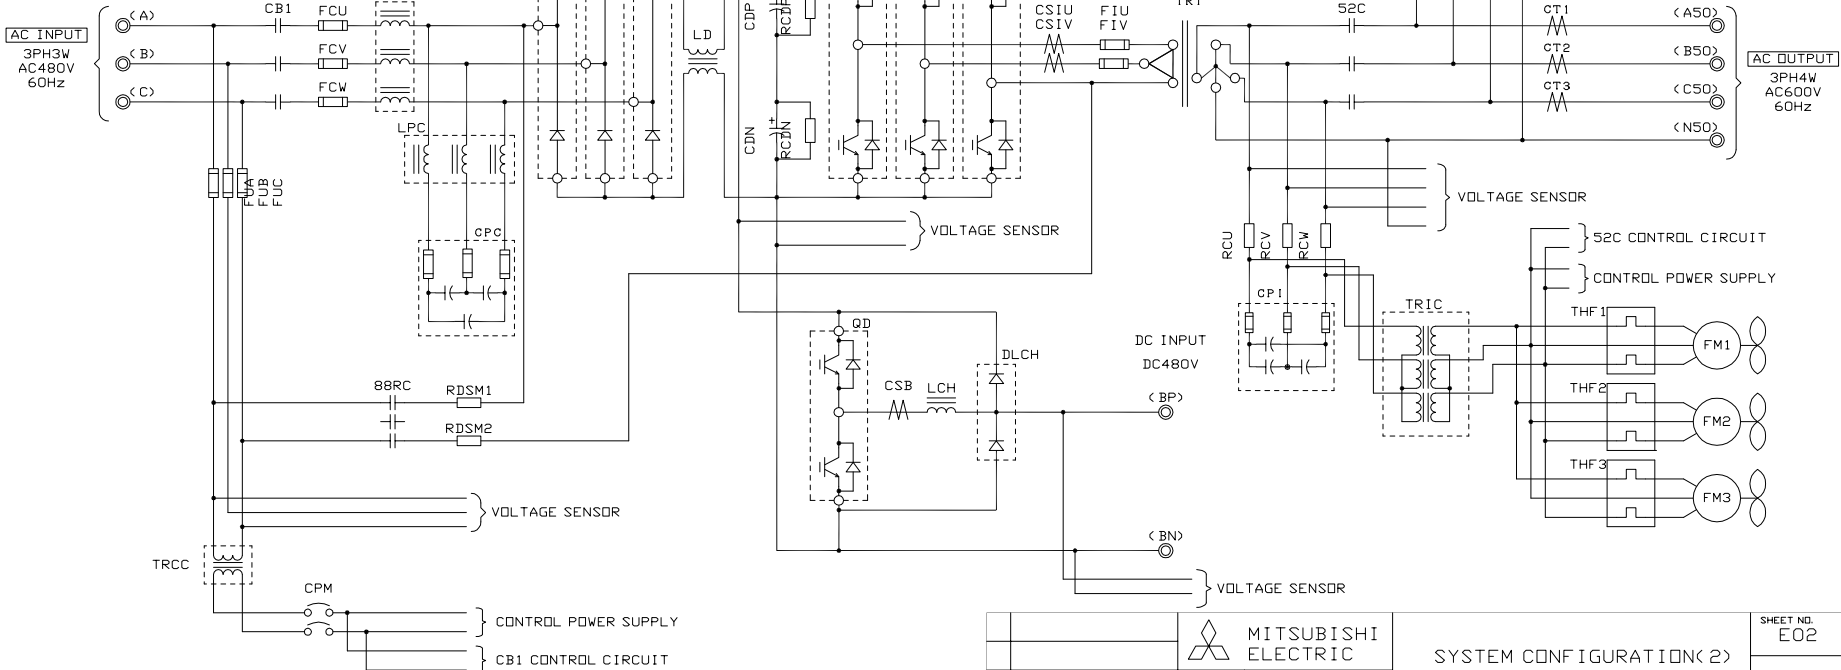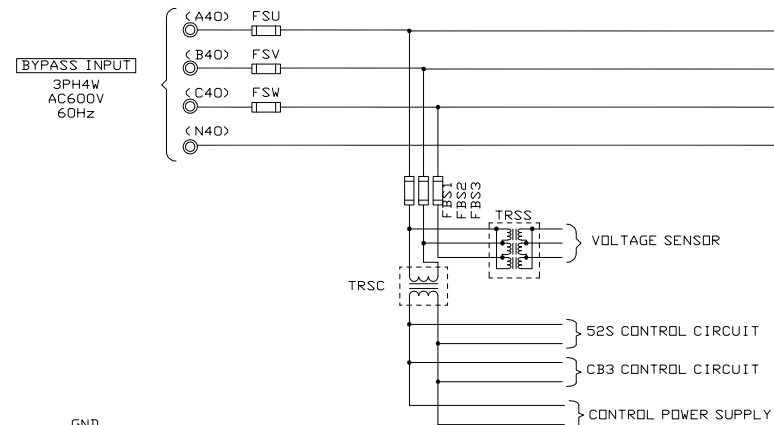

Win版

CAD

出図先

DF

UPS機

控

計

DEVICE No.	STANDARD	OPTION
FSU, FSV, FSW	BUS	FUSE

MITSUBISHI ELECTRIC		SYSTEM CONFIGURATION(2)		SHEET NO. E02
日付 DATE	FEB. 21. 2003	作成・監査 DRAWN	T. KOUTA Y. KAWANISHI	PAGE NO. 003 /
設計・検認 APPROVED	T. KOUTA N. KIRIYAMA	AZ22734		

A APR. 04. 03 T. K

1

2

3

4

5

6

7

8

9

控	
---	--



1. DIMENSIONS ARE SHOWN IN INCHES<MILLIMETERS>.
2. OVERALL DIMENSIONS INCLUDE SIDE AND REAR PANELS AND BOLT HEADS.
3. EACH CABINET SHOULD BE MAINTAINED UPRIGHT WITHIN ±15° DURING HANDLING.
4. EXTERNAL WIRING MATERIALS FOR AC INPUT, DC INPUT, BYPASS INPUT AND AC OUTPUT SHOULD BE SUPPLIED BY CUSTOMER <OUT OF SCOPE OF SUPPLY FROM MITSUBISHI>.
5. APPROXIMATE WEIGHTS
300KVA : 4980 lbs<2260kg>

		MITSUBISHI ELECTRIC CORPORATION		TITLE		SHEET No.	
				300KVA UPS		J01	
		作成日付 DATE FEB. 21. 2003		OUTLINE-1			
		作成・照査 DRAWN T. KOUYA		DWG. No.		PAGE No.	
		設計・検認 T. KOUYA		AZ22734		004	

