

01-02	SERIAL NUMBER
-------	---------------



SCHEMATIC DIAGRAM LIST

PROJECT 375kVA(480V) UL LISTED UPS

TYPE: UP9833A-D384DU-4

UPST 技9

図番 AZ22846

記録

UP33BU

E01

97-03

1

2

3

4

5

6

7

8

9

A

B

C

D

E

F

A

B

C

D

E

F

375 kVA 337.5 KW UPS

BYPASS SOURCE
3phase 4wires
480V 60HZ

CB

AC INPUT
3phase 3wires
480V 60HZ

A40
B40
C40
N40

A
B
C

BP
BN

DC INPUT

CB2

BATTERY

Nominal Voltage 480V
Final Voltage 400V

AC OUTPUT
3phase 4wires
480V 60HZ

Win版

CAD

出図先

DF

UPS棟

控

計



mitsubishi
ELECTRIC

日付
DATE

FEB. 14, 2003

作成・図査
DRAWN

T.KOYA M.KIRIYAMA

設計・検認
APPROVED

T.KOYA M.KIRIYAMA

A APR. 04, 03 T. K

SYSTEM CONFIGURATION<1>

AZ22846

SHEET NO.
E01

PAGE NO.
002

A

B

C

D

E

F

A




B

C

D

E

F

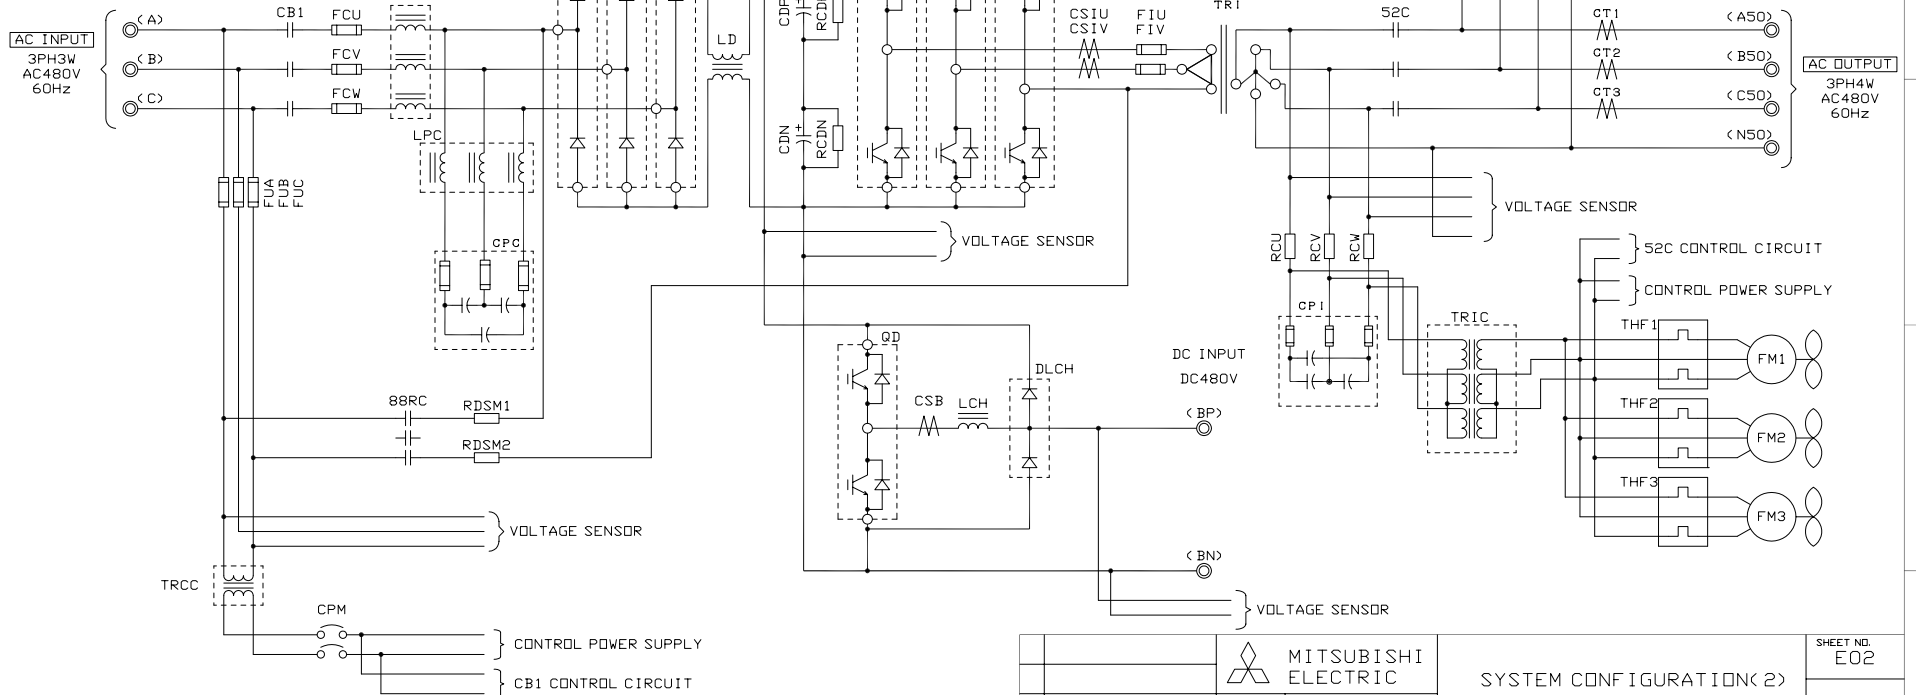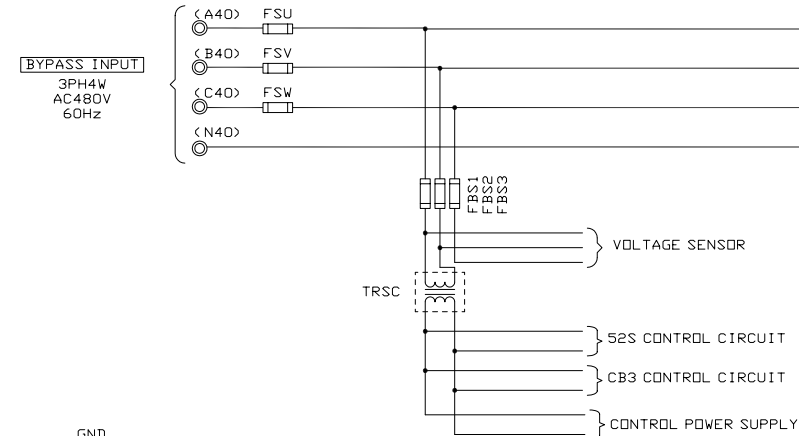

Win版

CAD

出図先

DF



UPS機

控

計


DEVICE No.	STANDARD	OPTION
FSU, FSV, FSW	BUS	FUSE

			MITSUBISHI ELECTRIC		SYSTEM CONFIGURATION(2)		SHEET NO. E02	
		日付 DATE	FEB. 14. 2003		AZ22846		PAGE NO. 003	
		作成・図査 DRAWN	T.KUOYA M.KIRIYAMA					
		設計・校核 APPROVED	T.KUOYA M.KIRIYAMA					
A	APR. 04. 03 T. K							

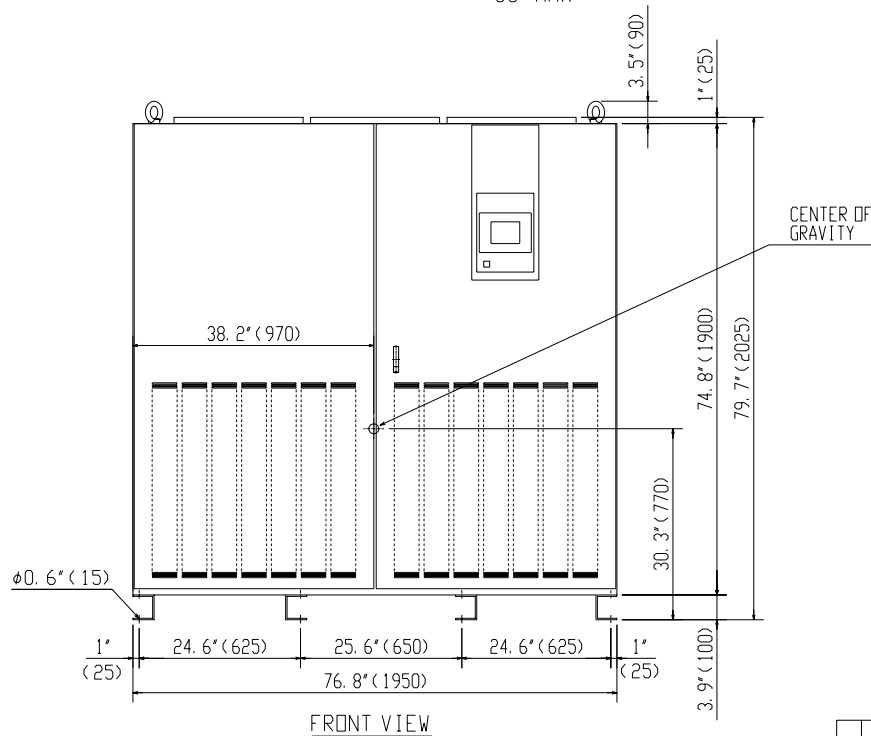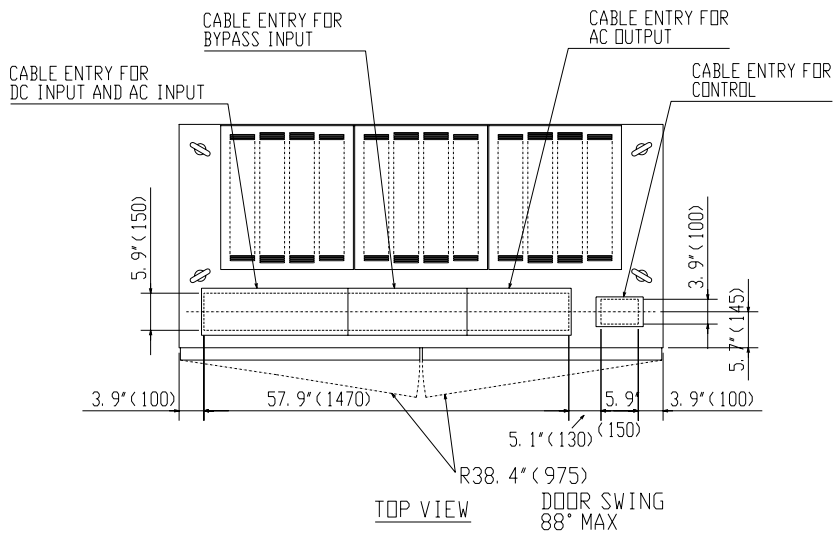

NOTES

1. DIMENSIONS ARE SHOWN IN INCHES (MILLIMETERS).
2. OVERALL DIMENSIONS INCLUDE SIDE AND REAR PANELS AND BOLT HEADS.
3. EACH CABINET SHOULD BE MAINTAINED UPRIGHT WITHIN $\pm 15^\circ$ DURING HANDLING.
4. EXTERNAL WIRING MATERIALS FOR AC INPUT, DC INPUT, BYPASS INPUT AND AC OUTPUT SHOULD BE SUPPLIED BY CUSTOMER (OUT OF SCOPE OF SUPPLY FROM MITSUBISHI).
5. APPROXIMATE WEIGHTS
375KVA ; 5250 lbs (2380 kg)

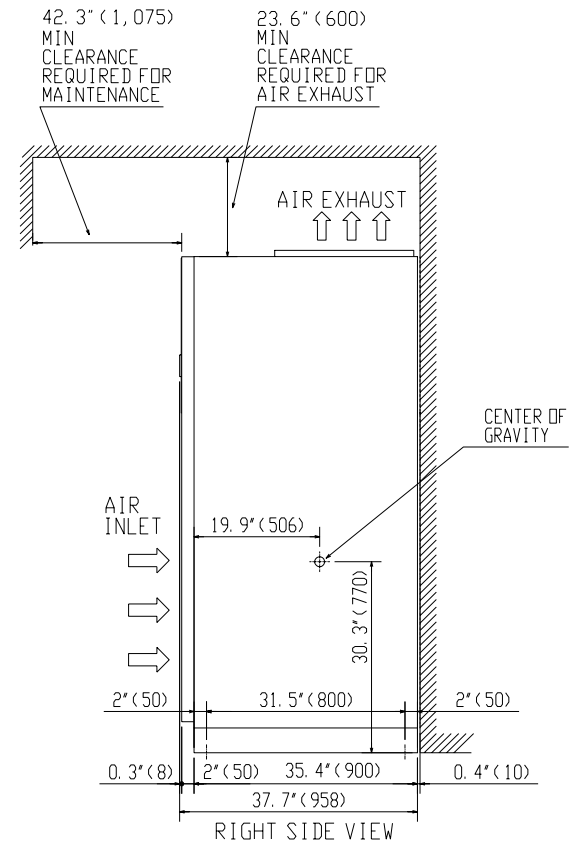

RJA
FGA97
S1AZ22846A
G=1

三角画法
尺度 SCALE
1: 20

出図先

ME

DF

UPS技



荷造 1

F

控

計

	MITSUBISHI ELECTRIC CORPORATION	TITLE 375KVA UPS OUTLINE-1	SHEET No. J01
	作成日付 DATE FEB. 14. 2003	DWG. No. AZ22846	PAGE No. 004
	作成・照査 DRAWN T. KOUYA M. KIRIYAMA		
	設計・検認 APPROVED T. KOUYA M. KIRIYAMA		
A	APR. 04. 03 T. K		

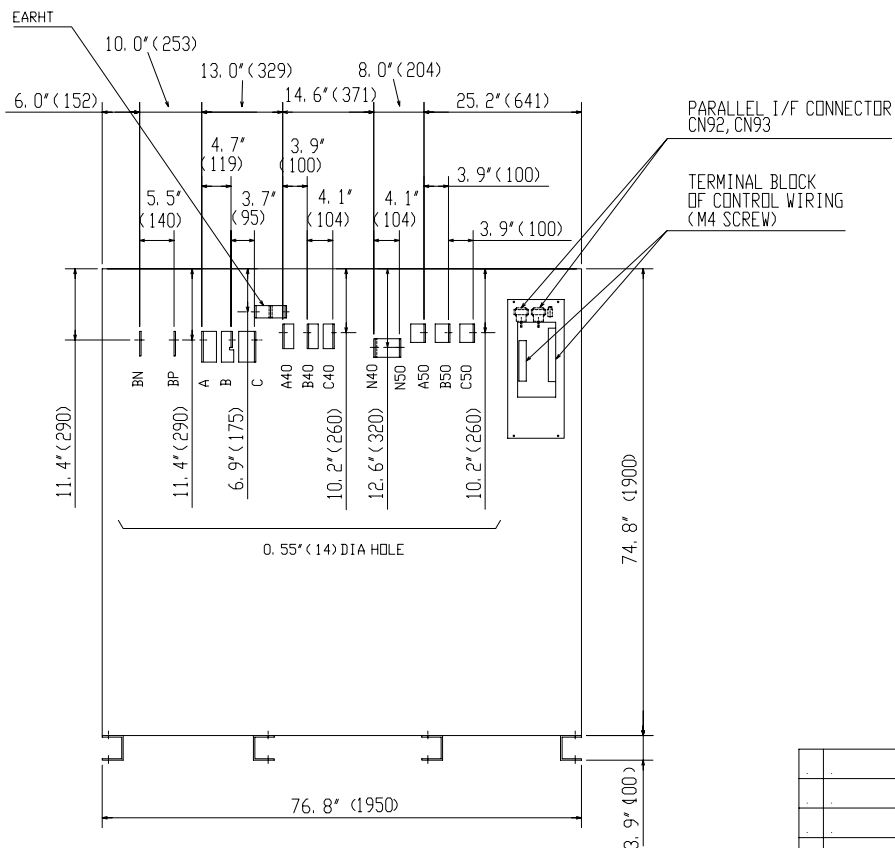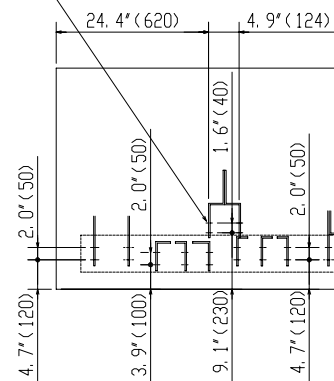0.39" (10) DIA HOLE
FOR EARHTRJA
FGA97
S1AZ22846A
G=3三角画法
尺度 SCALE
1: 20

出図先

MF

DF

UPS技

荷造 1

控

計

MITSUBISHI ELECTRIC CORPORATION		TITLE	SHEET No.
作成日付 DATE		375KVA UPS OUTLINE-2	J02
作成・照査 DRAWN		DWG. No.	PAGE No.
設計・検認 APPROVED		AZ22846	005
A APR. 04. 03 T. K			

A

B

C

D

E

F

A

B

C

D

E



F

EXTERNAL COMMUNICATION
CONNECTOR


PCB IOAU-04

CN1
(DSUB-9P)

TN1 OUT

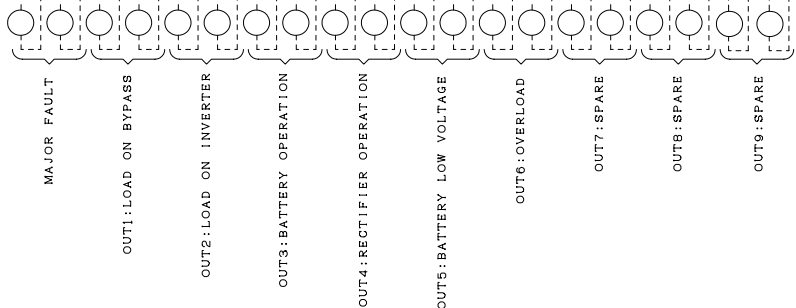

TN2 IN

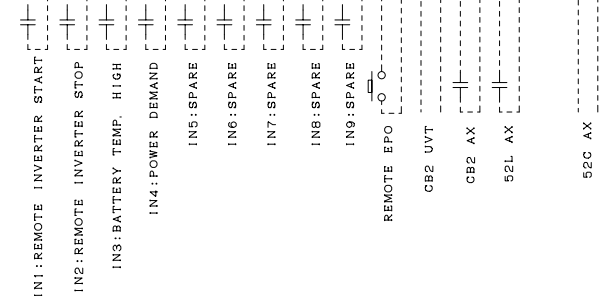

Win版

CAD

出図先

DF

UPS機

控

計



MITSUBISHI
ELECTRIC

日付
DATE

APR. 04, 2003

作成・図査
DRAWN

T. KUYA

設計・検認
APPROVED

T. KUYA

EXTERNAL SIGNAL

TERMINAL BLOCK

AZ22846

SHEET NO.
K01

PAGE NO.
006

006