

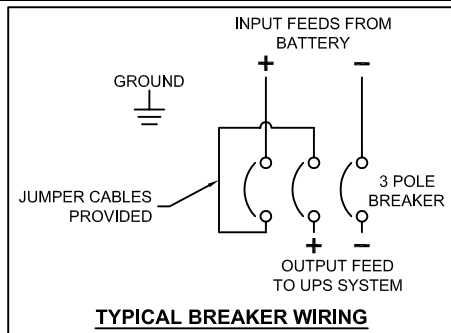
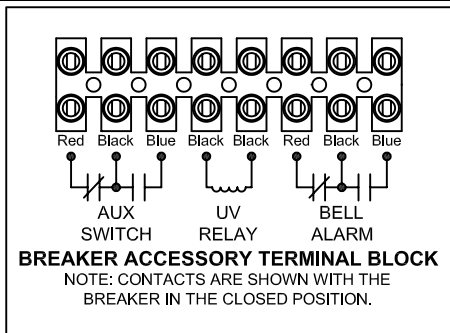
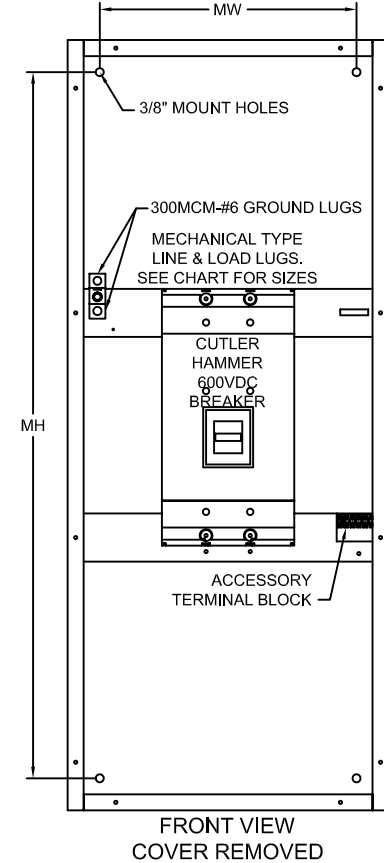
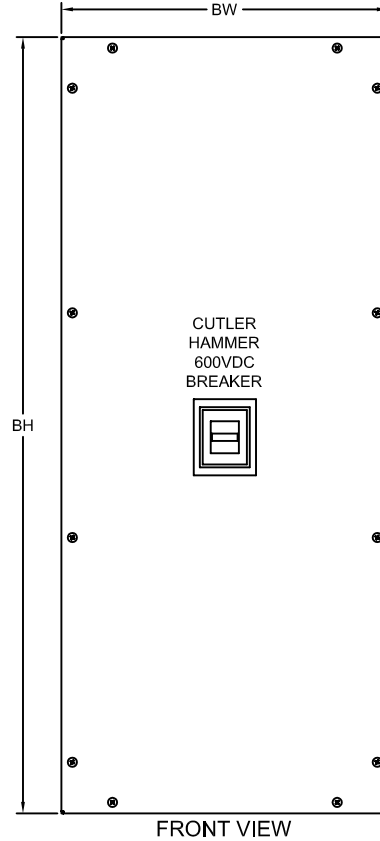


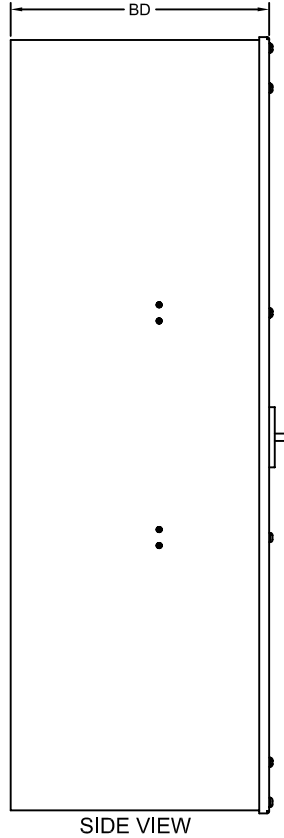

UPS Size	100 KVA	150 KVA	225 KVA	300 KVA	375 KVA	500 KVA	500 KVA	500 KVA
Disconnect Part #	DC-98100-1	DC-98150-1	DC-98225-1	DC-98300-1	DC-98375-1	DC-98500-1	DC-98500-2	DC-98500-3
"BW" Box Width	14"	14"	16"	16"	20"	20"	20"	20"
"BH" Box Height	28"	28"	36"	36"	48"	48"	48"	48"
"BD" Box Depth	12"	12"	12"	12"	16"	16"	16"	16"
"MW" Mounting Width	10"	10"	12"	12"	16"	16"	16"	16"
"MH" Mounting Height	24"	24"	32"	32"	44"	44"	44"	44"
Breaker Frame Type	HJDDC	HKDDC	HLDDC	HMDL	NBDC	NBDC	NBDC	NBDC
Breaker Size Amps	225A.	350A.	500A.	700A.	900A.	1200A.	1200A.	1200A.
A.I.C. Rating, 600VDC	35,000 A.I.C.	35,000 A.I.C.	35,000 A.I.C.	35,000 A.I.C.	50,000 A.I.C.	50,000 A.I.C.	50,000 A.I.C.	50,000 A.I.C.
Input Lug Type	TA250KB	TA350K	TA602LD	TA700MA1	TA1000NB1	TA1200NB1	TA1201NB1	TA1201NB1
Input Lug Size	(1)-350-#4	(1)-500-250	(2)-350-3/0	(2)-500-#1	(3)-400-3/0	(4)-500-4/0	(3)-750-500	(3)-750-500
Output Lug Type	TA250KB	TA350K	TA602LD	TA700MA1	TA1000NB1	TA1200NB1	TA1201NB1	TA1200NB1
Output Lug Size	(1)-350-#4	(1)-500-250	(2)-350-3/0	(2)-500-#1	(3)-400-3/0	(4)-500-4/0	(3)-750-500	(4)-500-4/0
Breaker Tie Cable	(1)-2/0	(1)-4/0	(2)-2/0	(2)-4/0	(3)-4/0	(3)-4/0	(3)-4/0	(3)-4/0
Ground Lug Size	(2)-300-#6	(2)-300-#6	(2)-300-#6	(2)-300-#6	(2)-300-#6	(2)-300-#6	(2)-300-#6	(2)-300-#6
UV, Alarm & Aux.	YES	YES	YES	YES	YES	YES	YES	YES
Weight	70 lbs.	70 lbs.	110 lbs.	120 lbs.	150 lbs.	150 lbs.	150 lbs.	150 lbs.

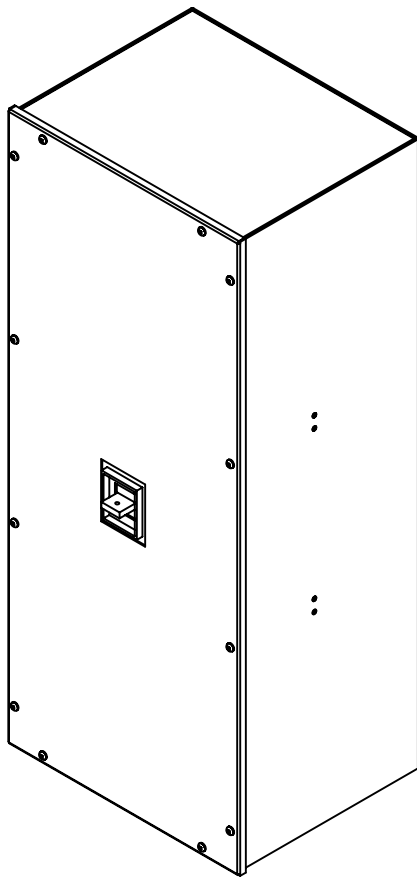

MITSUBISHI ELECTRIC
VERNON HILLS, ILLINOIS

REVISIONS

PART NO.: C91830-480

B	REVISED TABLE, DRAWING & BREAKER	*	ADDED SIGNATURE	DESCRIPTION: 9800AD SERIES, 480VDC, UPS DISCONNECTS
-	WIRING SCHEME 10-20-03	-		MEAU APPROVED: <i>Carl C. Lucette</i>
C	ADDED SECOND GROUND LUG AND	-		DATE: 02/07/03
	REVISED TABLE 4-22-04	-		DRAWN BY: MTO
				CAD FILE: 91830-SD04
				DRAWING NO.: 91830-SD04
				SHEET: 1 OF 1